




*Revised*

# ESSENTIAL FISH HABITAT ASSESSMENT

## Addressing the Proposed Champlain Hudson Power Express Transmission Line Project

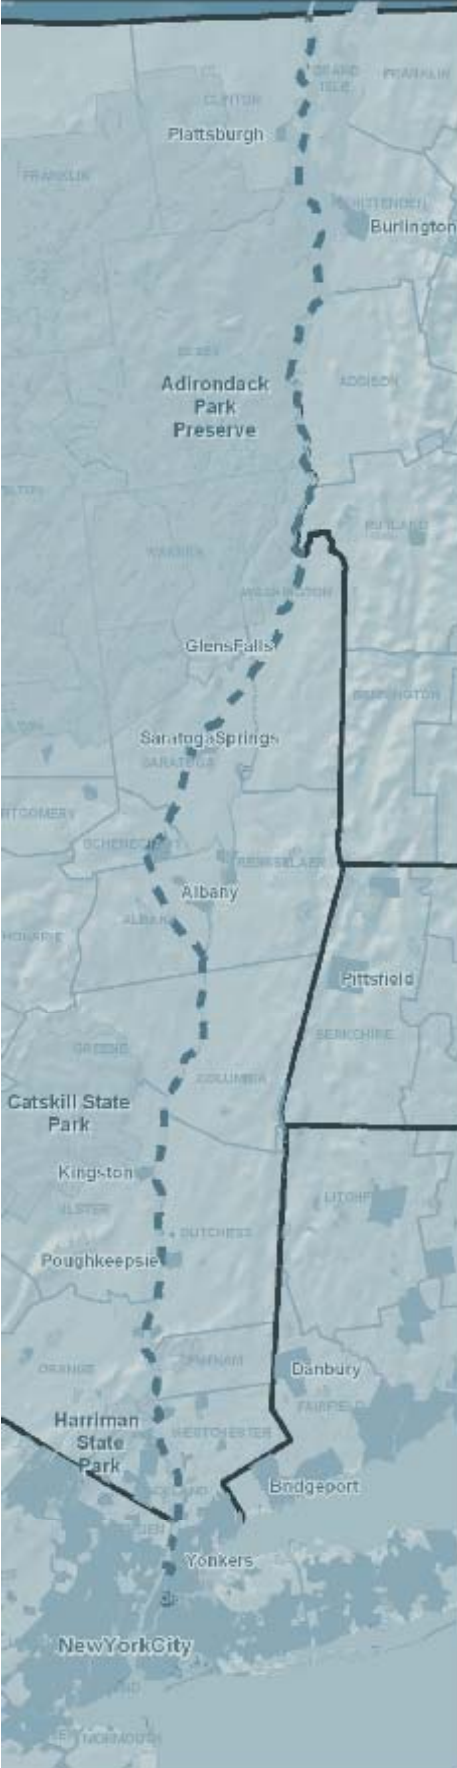

U.S. DEPARTMENT OF ENERGY  
OFFICE OF ELECTRICITY DELIVERY AND ENERGY RELIABILITY  
WASHINGTON, DC

June 2014

## ACRONYMS AND ABBREVIATIONS

µg/L	micrograms per liter	km	kilometer
µV/cm	microvolts per centimeter	kV	kilovolt
AIM	Algonquin Incremental Market	mG	milligauss
BMP	best management practice	mg/L	milligrams per liter
°C	degrees Celsius	MP	milepost
°F	degrees Fahrenheit	MSA	Magnuson-Stevens Fishery Conservation Management Act
AC	alternating current	mV/cm	millivolts per centimeter
CFR	Code of Federal Regulations	MW	megawatt
CHPE	Champlain Hudson Power Express	NEPA	National Environmental Policy Act
cm	centimeter	NMFS	National Marine Fisheries Service
CMP	Coastal Management Program	NOAA	National Oceanic Atmospheric Administration
cSEL	cumulative sound exposure level	NYISO	New York Independent System Operator
CSX	CSX Transportation	NYSDEC	New York State Department of Environmental Conservation
ConEd	Con Edison	NYSDOS	New York State Department of State
CP	Canadian Pacific	NYSDOT	New York State Department of Transportation
dB	decibel	NYSDPS	New York State Department of Public Service
dB re 1 µPa	decibels relative to 1 micropascal	NYSPPSC	New York State Public Service Commission
dB re 1 µPa <sup>2</sup> -s	decibels relative to 1 micropascal-squared second	PCB	polychlorinated biphenyl
DOE	U.S. Department of Energy	ppt	parts per thousand
DC	direct current	psi	pounds per square inch
EFH	essential fish habitat	rms	root mean square
EIS	Environmental Impact Statement	ROI	region of influence
EMF	electromagnetic field	ROW	right-of-way
EM&CP	Environmental Management and Construction Plan	SAV	submerged aquatic vegetation
ERRP	Emergency Repair and Response Plan	SCFWH	Significant Coastal Fish and Wildlife Habitat
ESA	Endangered Species Act	SPL	sound pressure level
FWCA	Fish and Wildlife Coordination Act	TSS	total suspended solids
G	gauss	U.S.C.	United States Code
HAPC	habitat area of particular concern	USACE	U.S. Army Corps of Engineers
HDD	horizontal directional drilling	USEPA	U.S. Environmental Protection Agency
HDPE	high-density polyethylene	XLPE	cross-linked polyethylene
HVAC	high-voltage alternating current		
HVDC	high-voltage direct current		
Hz	hertz		

*REVISED*

**ESSENTIAL FISH HABITAT ASSESSMENT**  
**ADDRESSING THE**  
**PROPOSED CHAMPLAIN HUDSON POWER EXPRESS**  
**TRANSMISSION LINE PROJECT**

---

**U.S. DEPARTMENT OF ENERGY**  
**OFFICE OF ELECTRICITY DELIVERY AND ENERGY RELIABILITY**



**JUNE 2014**





**ESSENTIAL FISH HABITAT ASSESSMENT  
FOR THE  
CHAMPLAIN HUDSON POWER EXPRESS TRANSMISSION LINE PROJECT**

**TABLE OF CONTENTS**

**ACRONYMS AND ABBREVIATIONS.....INSIDE FRONT COVER**

**1. INTRODUCTION.....1-1**

**2. DESCRIPTION OF THE PROPOSED PROJECT.....2-1**

2.1 Description of the Route Segments Used in the EIS Analyses .....2-1

2.2 Region of Influence .....2-6

2.3 Descriptions of Construction Methods.....2-8

2.3.1 Aquatic Direct Current Transmission Cable .....2-8

2.3.2 Horizontal Directional Drilling .....2-10

2.3.3 Terrestrial Direct Current Transmission Cable .....2-13

2.3.4 Cooling Stations .....2-14

2.3.5 Luyster Creek HVDC Converter Station.....2-14

2.3.6 Astoria Annex Substation Interconnection.....2-14

2.3.7 Astoria to Rainey Interconnection.....2-14

2.4 Additional Engineering Details .....2-15

2.5 Construction and Schedule.....2-17

2.5.1 Aquatic Transmission Cable Installation.....2-17

2.5.2 Terrestrial Direct Current Transmission Cable Installation .....2-19

2.5.3 Staging Areas .....2-21

2.5.4 Operations and Maintenance .....2-21

**3. EFH SPECIES AND FWCA RESOURCES DESIGNATIONS IN THE ROI.....3-1**

3.1 EFH Species Designations .....3-1

3.2 Fish and Wildlife Coordination Act Resource Designations.....3-8

3.2.1 Fish .....3-8

3.2.2 Shellfish and Benthic Communities .....3-9

3.2.3 Submerged Aquatic Vegetation.....3-10

**4. ASSESSMENT OF POTENTIAL EFFECTS .....4-1**

4.1 Effects from Construction .....4-1

4.2 Effects from Operations, Maintenance, and Emergency Repairs.....4-13

4.3 Cumulative Effects .....4-19

**5. CONCLUSIONS .....5-1**

5.1 EFH Species .....5-1

5.2 FWCA Resources .....5-1

**6. AVOIDANCE AND MINIMIZATION MEASURES.....6-1**

**7. REFERENCES.....7-1**

**ATTACHMENTS**

**Attachment 1. Resources along the Proposed CHPE Project Route in the Hudson River**

**FIGURES**

2-1. Lake Champlain Segment ..... 2-2  
2-2. Overland Segment ..... 2-3  
2-3. Hudson River Segment ..... 2-4  
2-4. Proposed CHPE Project near Haverstraw Bay ..... 2-5  
2-5. New York City Metropolitan Area Segment ..... 2-7  
2-6. Example Aquatic HVDC Transmission Cable Cross-Section ..... 2-9  
2-7. Representative Schematic of Protective Measures for Aquatic Transmission Cables ..... 2-9  
2-8. Example of Grapnel Used for Debris Removal ..... 2-10  
2-9. Example HDD Techniques ..... 2-11  
2-10. Example Terrestrial HVDC Transmission Cable Cross-Section ..... 2-13  
2-11. 200-mG Magnetic Field Strengths with Cable Spacings of 1 Foot and 3 Feet ..... 2-16

**TABLES**

2-1. Magnetic Field Levels for the Proposed CHPE Transmission Cables ..... 2-16  
2-2. Underwater Construction Windows ..... 2-19  
3-1. Species with EFH in the ROI ..... 3-2  
3-2. Summary of EFH Types and Associated Fish Species in the Hudson River Segment ..... 3-3  
3-3. Designated EFH Descriptions and Associated Fish Species Occurrence within the ROI ..... 3-4  
4-1. Summary of the Effects of the Proposed CHPE Project on EFH ..... 4-2  
4-2. Underwater Sound Pressure Levels for Various Vessels ..... 4-10  
4-3. Other Actions Considered for Potential Cumulative Impacts ..... 4-19

## 1. Introduction

1  
2 The U.S. Department of Energy (DOE) has prepared this Essential Fish Habitat (EFH) Assessment in  
3 support of the National Environmental Policy Act (NEPA) review of potential environmental impacts  
4 related to the proposed Champlain Hudson Power Express (CHPE) Transmission Line Project (proposed  
5 CHPE Project). The DOE released the Draft Environmental Impact Statement (EIS) for the proposed  
6 CHPE Project in September 2013 (DOE 2013). The Magnuson-Stevens Fishery Conservation and  
7 Management Act (MSA) requires Federal agencies to consult with the National Marine Fisheries Service  
8 (NMFS) on any action authorized, funded, or undertaken or proposed to be authorized, funded, or  
9 undertaken by the agency that may adversely affect EFH identified under the MSA (16 United States  
10 Code [U.S.C.] Part 1855[b][2]). The goal of the consultation is to develop EFH conservation measures  
11 and to satisfy the response requirements of U.S.C. Part 1855 (b)(4)(A) and 1855(b)(4)(B) of the MSA.  
12 Federal agencies initiate consultation by preparing and submitting to NMFS a written assessment of the  
13 effects of the proposed Federal action on EFH. To promote efficiency and avoid duplication, this EFH  
14 Assessment is being submitted to NMFS in support of EFH consultation under the MSA for the proposed  
15 CHPE Project that is integrated into the existing environmental review under NEPA.

16 EFH is defined in the MSA implementing regulations at 50 Code of Federal Regulations (CFR) Part  
17 600.10 as “those waters and substrates necessary to fish spawning, breeding, feeding, or growth to  
18 maturity. ‘Waters’ include aquatic areas and their associated physical, chemical, and biological properties  
19 that are used by fish and may include aquatic areas historically used by fish where appropriate; ‘substrate’  
20 includes sediment, hard bottom, structures underlying the waters, and associated biological communities;  
21 ‘necessary’ means the habitat required to support a sustainable fishery and the managed species’  
22 contribution to a healthy ecosystem; and ‘spawning, breeding, feeding, or growth to maturity’ covers a  
23 species’ full life cycle.” All of the EFH that occurs within the proposed CHPE Project route occurs in the  
24 seawater zone and the mixing zone of the Hudson River Estuary (NOAA 1998a). Therefore, EFH within  
25 the proposed CHPE Project area occurs in the Hudson River just south of Poughkeepsie, New York,  
26 which is the approximate northern limit of the mixing zone, and continues south through the Harlem and  
27 East rivers (NOAA 1997).

28 Pursuant to 50 CFR Part 600.810(a), an adverse effect on EFH is defined as any impact that substantially  
29 reduces the quality or quantity of EFH. An adverse effect can result from direct impacts  
30 (e.g., contamination or disturbance), indirect impacts (e.g., loss of prey or change in quantity or quality of  
31 habitat), and individual or cumulative impacts. Adverse effects on EFH could result from actions  
32 occurring within or outside of EFH. If a Federal agency determines that an action will not adversely  
33 affect EFH, no consultation is required. Per the EFH Final Rule (67 *Federal Register* 2354), temporary  
34 effects are those that would have limited durations and that would allow the environment to recover  
35 without a noticeable effect. Minimal effects are those that could result in relatively small changes to the  
36 affected environment and insignificant changes in ecological function.

37 NMFS EFH Consultation Guidance indicates that the Fish and Wildlife Coordination Act (FWCA)  
38 requires consultation “with the U.S. Fish and Wildlife Service, National Oceanic Atmospheric  
39 Administration (NOAA) Fisheries, and appropriate state agencies whenever any body of water is  
40 proposed to be modified in any way and a Federal permit or license is required. These agencies  
41 determine the possible harm to fish and wildlife resources, the measures needed to both prevent the  
42 damage to and loss of these resources, and the measures needed to develop and improve the resources, in  
43 connection with water resource development. NOAA Fisheries submits comments to Federal licensing  
44 and permitting agencies on the potential harm to living marine resources caused by the proposed water  
45 development project, and recommendations to prevent harm” (NMFS 2004).

- 1 This EFH Assessment provides a description of the proposed CHPE Project, defines the region of
- 2 influence (ROI) wherein effects on EFH could occur, provides detailed EFH descriptions and analyses on
- 3 potential effects from the CHPE Project, and addresses avoidance and minimization measures intended to
- 4 reduce potential effects (NMFS 2004).

## 2. Description of the Proposed Project

The proposed CHPE Project would include construction, operation, and maintenance of an approximately 336-mile (541-kilometer [km])-long, 1,000-megawatt (MW), high-voltage electric power transmission system that would have both aquatic (underwater) and terrestrial (underground) portions. The underwater portions of the transmission line (196 miles [316 km]) would be buried in the beds of Lake Champlain and the Hudson, Harlem, and East rivers, and the terrestrial portions of the transmission line (140 miles [225 km]) would be buried underground, principally in railroad and roadway rights-of-way (ROWs).

The transmission system would consist of one 1,000-MW, high-voltage direct current (HVDC) transmission line; communications cable; and ancillary aboveground facilities, including cooling stations at selected locations where required and a direct current (DC)-to-alternating current (AC) converter station. The transmission line would be a bipole consisting of two transmission cables, one positively charged and the other negatively charged.

### 2.1 Description of the Route Segments Used in the EIS Analyses


For the purposes of understanding the various environmental settings associated with the proposed CHPE Project, and to facilitate the analysis in the EIS, the transmission line route was divided into four geographically logical segments as follows:

- **Lake Champlain Segment**
- **Overland Segment**
- **Hudson River Segment**
- **New York City Metropolitan Area Segment.**

From the U.S./Canada border, the HVDC transmission line would be located in the bed of Lake Champlain for approximately 101 miles (163 km), from near the Town of Champlain, New York, to the Town of Dresden, New York. This portion of the route composes the *Lake Champlain Segment* (see **Figure 2-1**).

The *Overland Segment* begins at the southern end of Lake Champlain at the Town of Dresden, where the HVDC transmission line would exit the water at milepost (MP) 101 and be installed underground in the New York State Department of Transportation (NYSDOT) ROW, the Canadian Pacific (CP) railroad ROW, and the CSX Transportation (CSX) railroad ROW for 127 miles (204 km) until the transmission line would enter the Hudson River at MP 228 in the Town of Catskill, New York (see **Figure 2-2**).

The *Hudson River Segment* begins at MP 228 where the HVDC transmission line would be buried in the bottom of the Hudson River for approximately 67 miles (108 km) to the Town of Stony Point, New York, where the transmission line would exit the river and follow a terrestrial route along the CSX railroad ROW and the U.S. Route 9W ROW between MPs 295 and 303 to bypass Haverstraw Bay (see **Figure 2-3**). The transmission line would be buried underground through this entire terrestrial stretch before reentering the Hudson River at MP 303. The Hudson River Segment originally involved continuous installation of the transmission line within the river through Haverstraw Bay. During the New York State Public Service Commission (NYSPSC) Article VII permitting process for the proposed CHPE Project, the route was altered for approximately 8 miles (13 km) to bypass Haverstraw Bay, thus avoiding potential adverse effects on EFH in the bay (NYSPSC 2013) (see **Figure 2-4**). The transmission line would then reenter the Hudson River at MP 303 for approximately 21 miles (34 km) until it reaches the end of the Hudson River Segment at Spuyten Duyvil Creek and the Harlem River in New York City at MP 324. A detailed description of alternatives considered for the proposed CHPE Project is presented in Section 2.5 of the EIS.

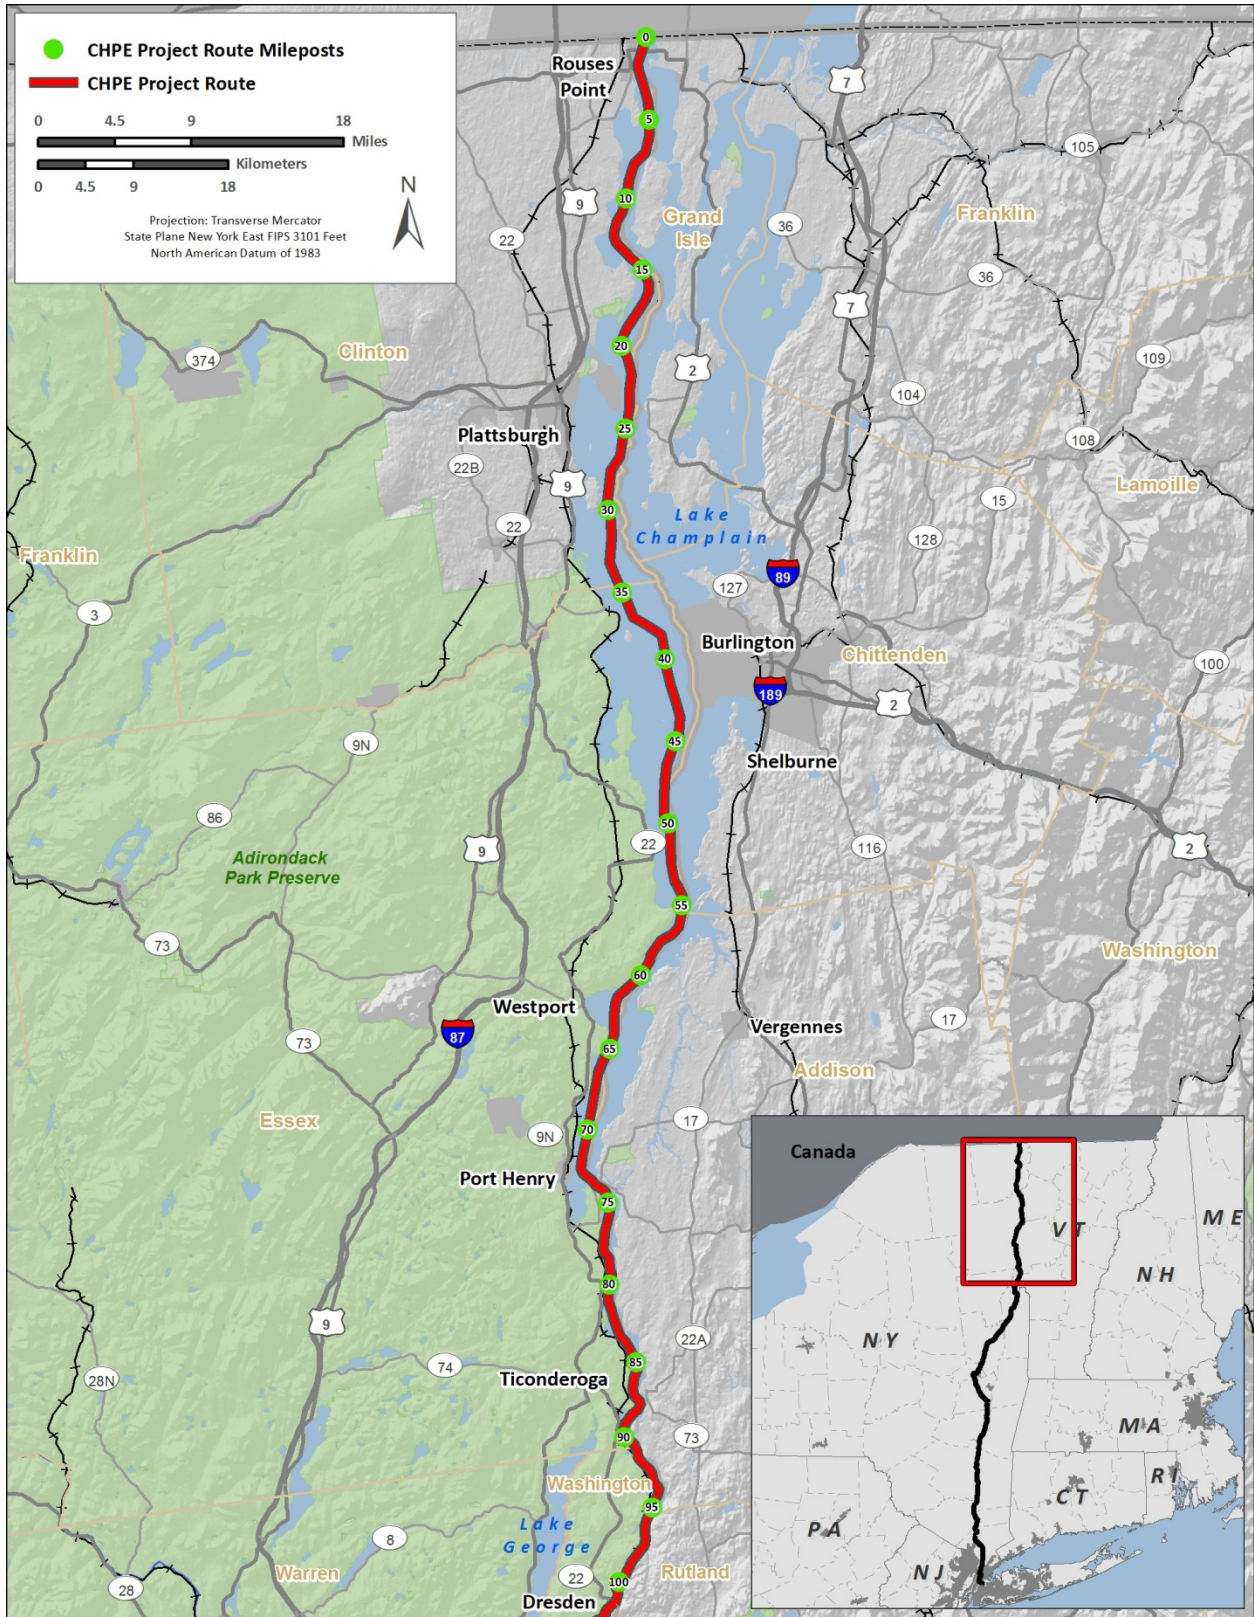


1

2

Figure 2-1. Lake Champlain Segment




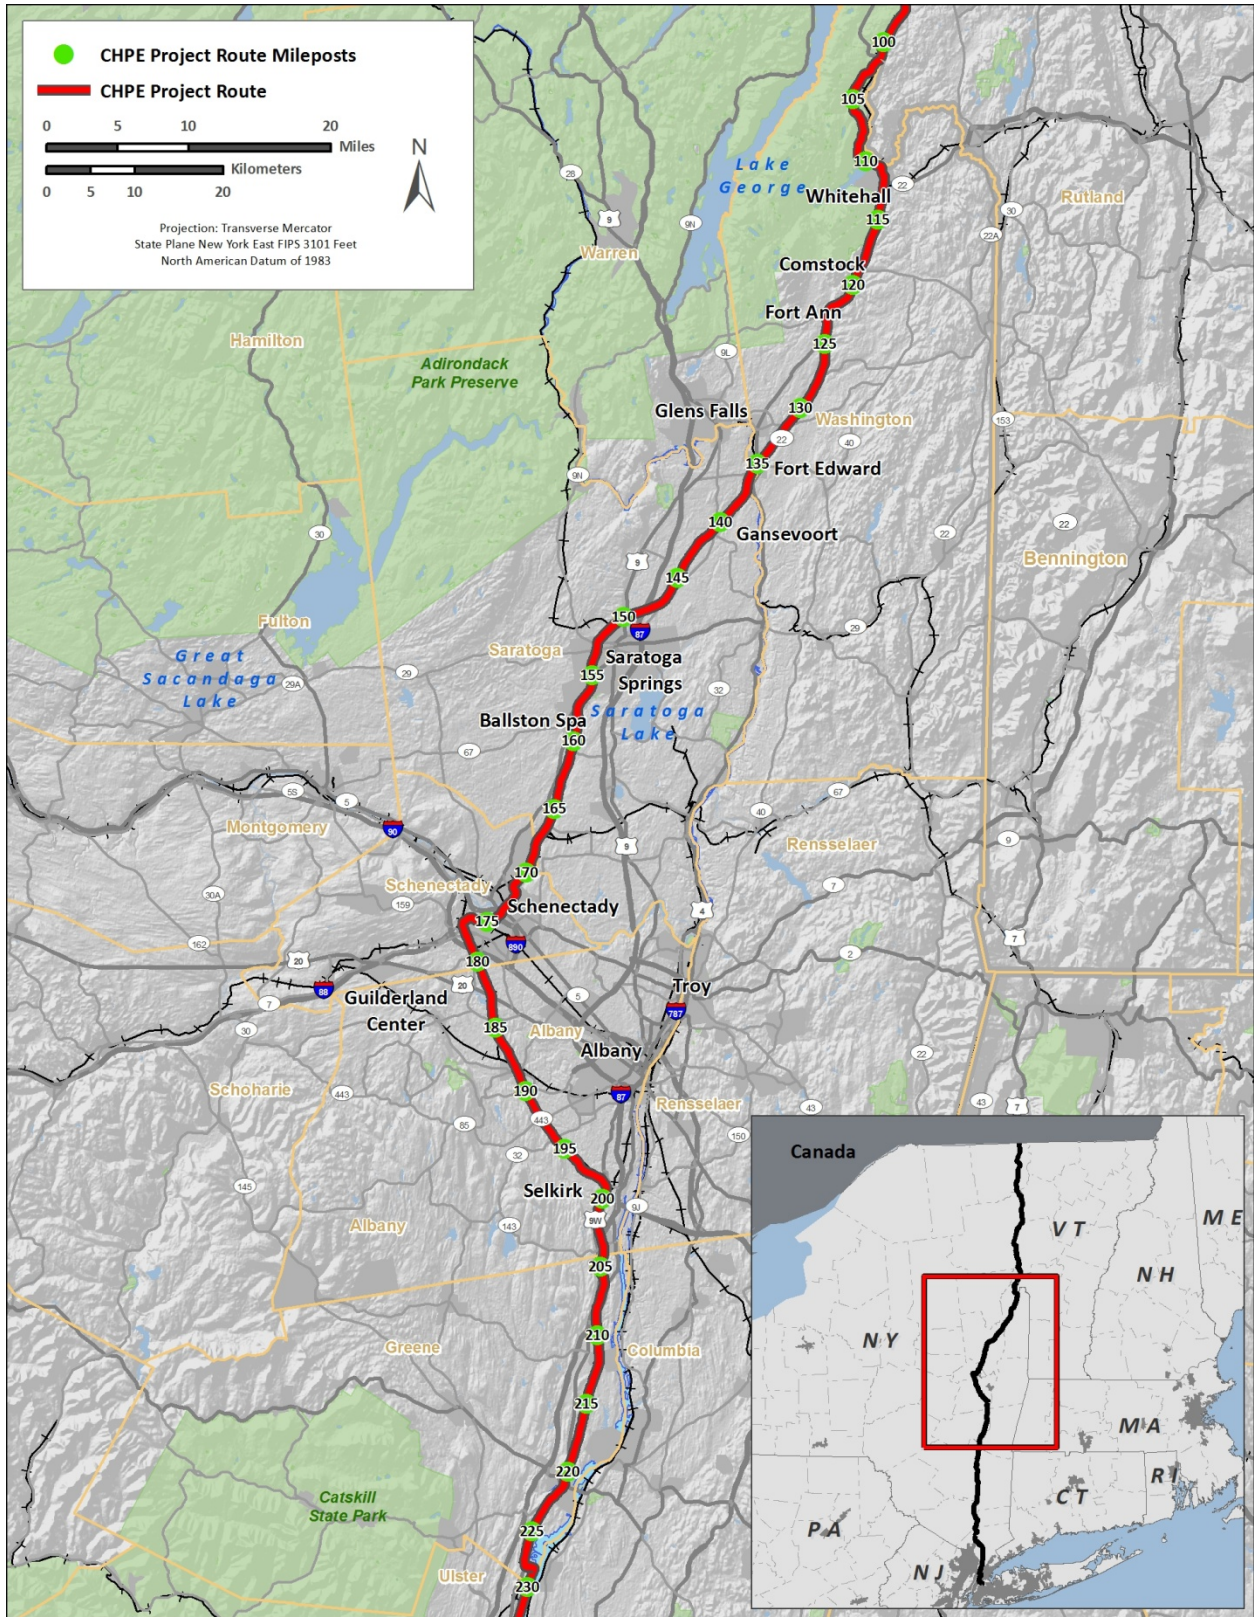

1  
2

**Figure 2-2. Overland Segment**



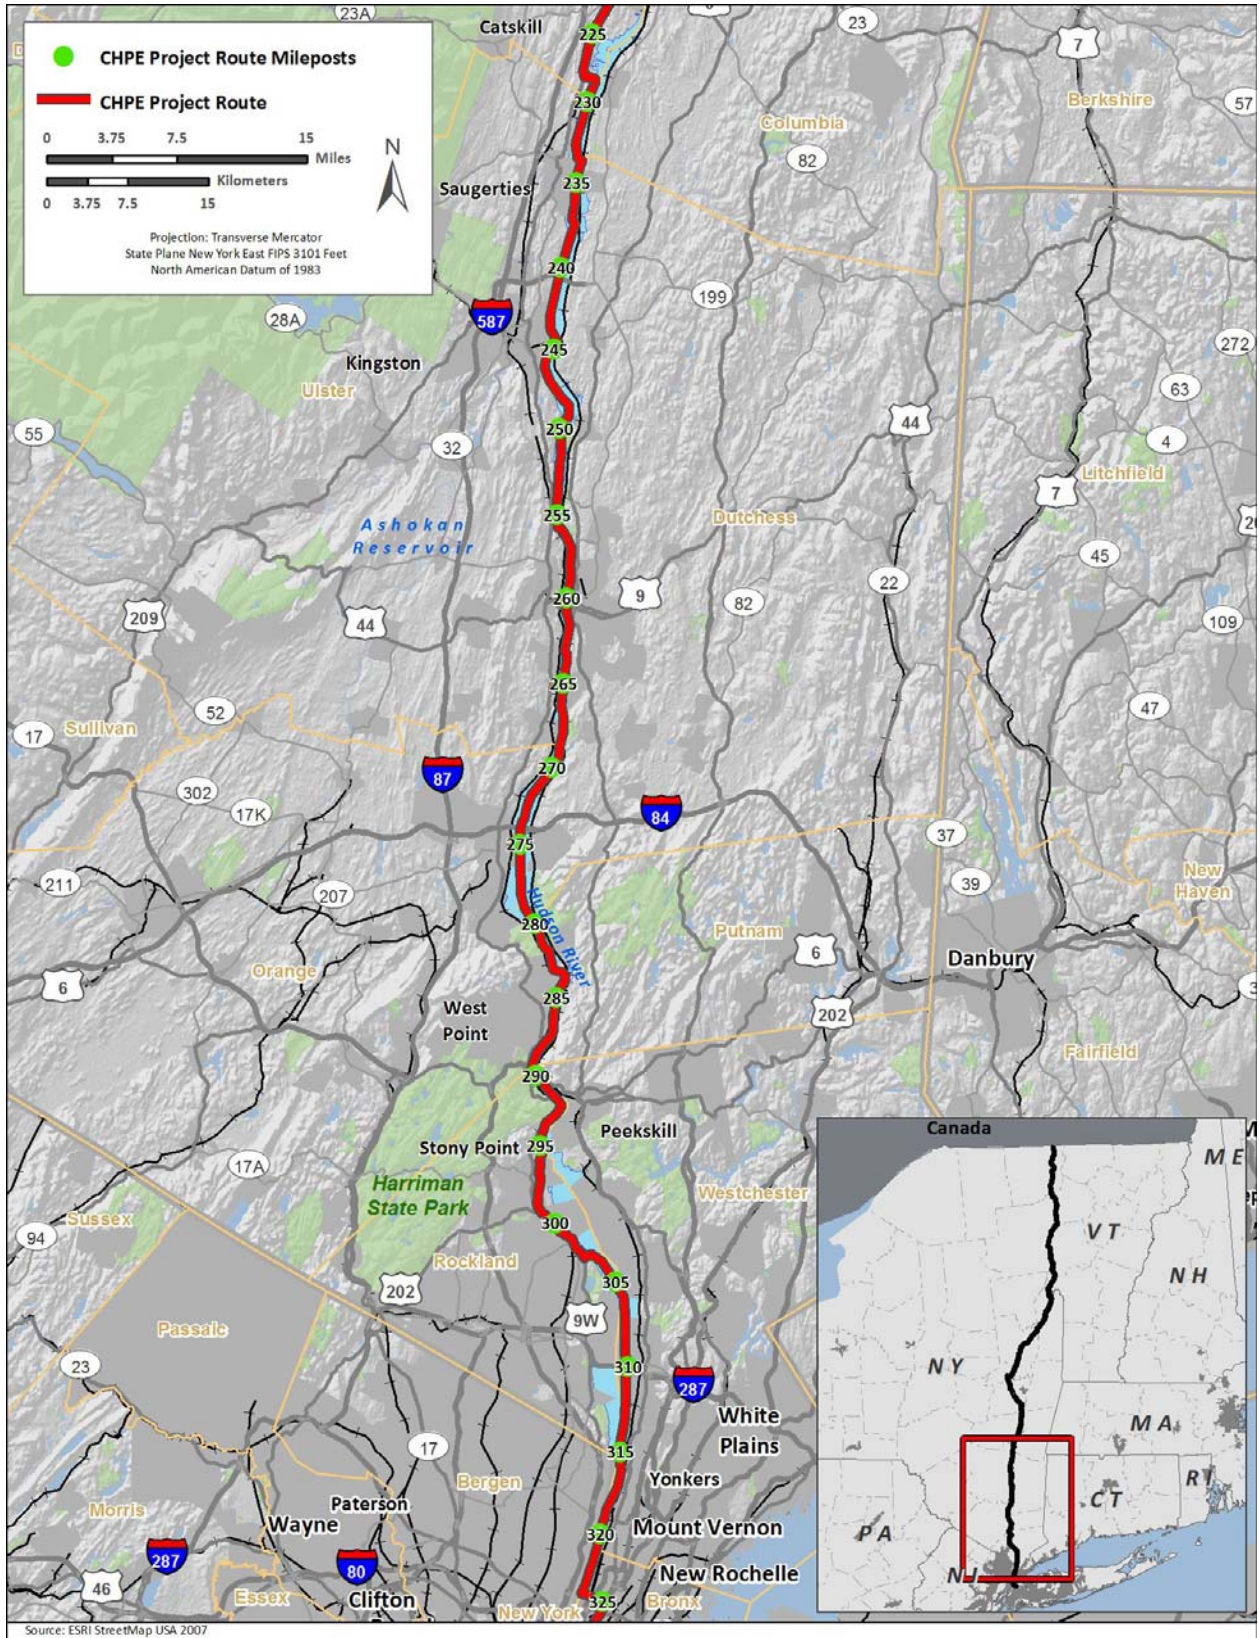

1  
2  
3

Figure 2-3. Hudson River Segment





1  
2  
3

Figure 2-4. Proposed CHPE Project near Haverstraw Bay

1 The *New York City Metropolitan Area Segment* begins at Spuyten Duyvil (the area where the Harlem  
2 River shipping channel connects to the Hudson River) at MP 324, where the HVDC transmission line  
3 would enter the Harlem River and continue south in the river for a distance of approximately 6 miles  
4 (10 km) to a point north of the Willis Avenue Bridge in the borough of the Bronx at MP 330 (see  
5 **Figure 2-5**). The transmission line would exit the river and proceed east through the NYSDOT railroad  
6 corridor and rail yards along the northern side of the Bronx Kill to the East River at MP 331 and cross  
7 under the river via HDD southeast to the site of the Consolidated Edison (ConEd) Charles Poletti Power  
8 Plant complex in Astoria, Queens, New York, at MP 332.


## 9 2.2 Region of Influence

10 The ROI for this assessment is the Hudson, Harlem, and East rivers within the Hudson River Segment  
11 (see **Figure 2-3**) and the New York Metropolitan Area Segment (see **Figure 2-5**). EFH within the ROI  
12 includes the entire Hudson River from as far north as the City of Poughkeepsie, New York (MP 260), and  
13 continues south through the Harlem and East rivers (see **Attachment 1** for a mapbook of the route  
14 through the Hudson, Harlem, and East rivers). EFH that occurs along the proposed CHPE Project route  
15 occurs in the seawater zone and mixing zone of the Hudson River Estuary (NOAA 1997, NOAA 1998a).  
16 No EFH is designated along any portion of the Lake Champlain or Overland segments of the proposed  
17 CHPE Project route. Species not managed by NMFS, such as anadromous fish (e.g., river herring,  
18 American shad, and striped bass), shellfish, and other benthic resources, are considered in this analysis  
19 throughout the ROI (i.e., not limited to EFH).

20 This EFH Assessment analyzes potential effects on EFH in the Hudson River from Poughkeepsie south to  
21 Spuyten Duyvil into the Harlem and East rivers. Habitat parameters of each waterway are described as  
22 follows:

- 23 • The Hudson River is tidally influenced from its mouth to a distance as far north as 150 miles  
24 upriver (SUNY 2013, Geyer and Chant 2006). Generally, the Hudson River Estuary can be  
25 divided into three salinity zones that transition with the influx of fresh water with distance upriver  
26 (NOAA 1997). These salinity zones are seawater (greater than 25 parts per thousand [ppt]),  
27 mixing (0.5 to 25.0 ppt), and tidal fresh (less than 0.5 ppt). The location of these zones varies  
28 seasonally and daily depending on tidal and fresh water inputs. A vertical salinity gradient  
29 (i.e., salt wedge) is prominent in the region of the estuary located between 20 and 40 miles (32 to  
30 64 km) upriver where the channel deepens and irregularities create turbulence and vertical  
31 mixing. The upper limit of the salt line has been approximately 75 miles upriver near  
32 Poughkeepsie, New York, two times in the past 50 years (1964 and 1995) (Geyer and Chant  
33 2006). The river's depth ranges from 30 to 708 feet (9 to 216 meters). Average water  
34 temperatures within the estuary generally follow mean air temperature. Temperatures range from  
35 32 degrees Fahrenheit (°F) (0 degrees Celsius [°C]) in January to a July maximum of 81 °F  
36 (27 °C). In the spring and summer, temperature decreases toward Battery Park (i.e., “the  
37 Battery”) in Manhattan as colder saline water enters with tidal flow. This horizontal temperature  
38 gradient reverses in late fall and winter because salt water cools to a lesser extent than shallow  
39 fresh water (Historic Hudson River 2004).
- 40 • The Harlem River is an approximately 7-mile (11-km)-long, narrow, tidally dominated strait that  
41 separates the Manhattan Borough from the Bronx Borough in New York City and connects the  
42 Hudson River with the East River as part of the Hudson River Estuary. The channel depth ranges  
43 from 15 to 22 feet (5 to 7 meters) and the salinity is less than 30 ppt (Riverkeeper 2013). NOAA  
44 (1997) designates the Harlem River as mixing zone. Temperature ranges are the same as the  
45 Hudson River.



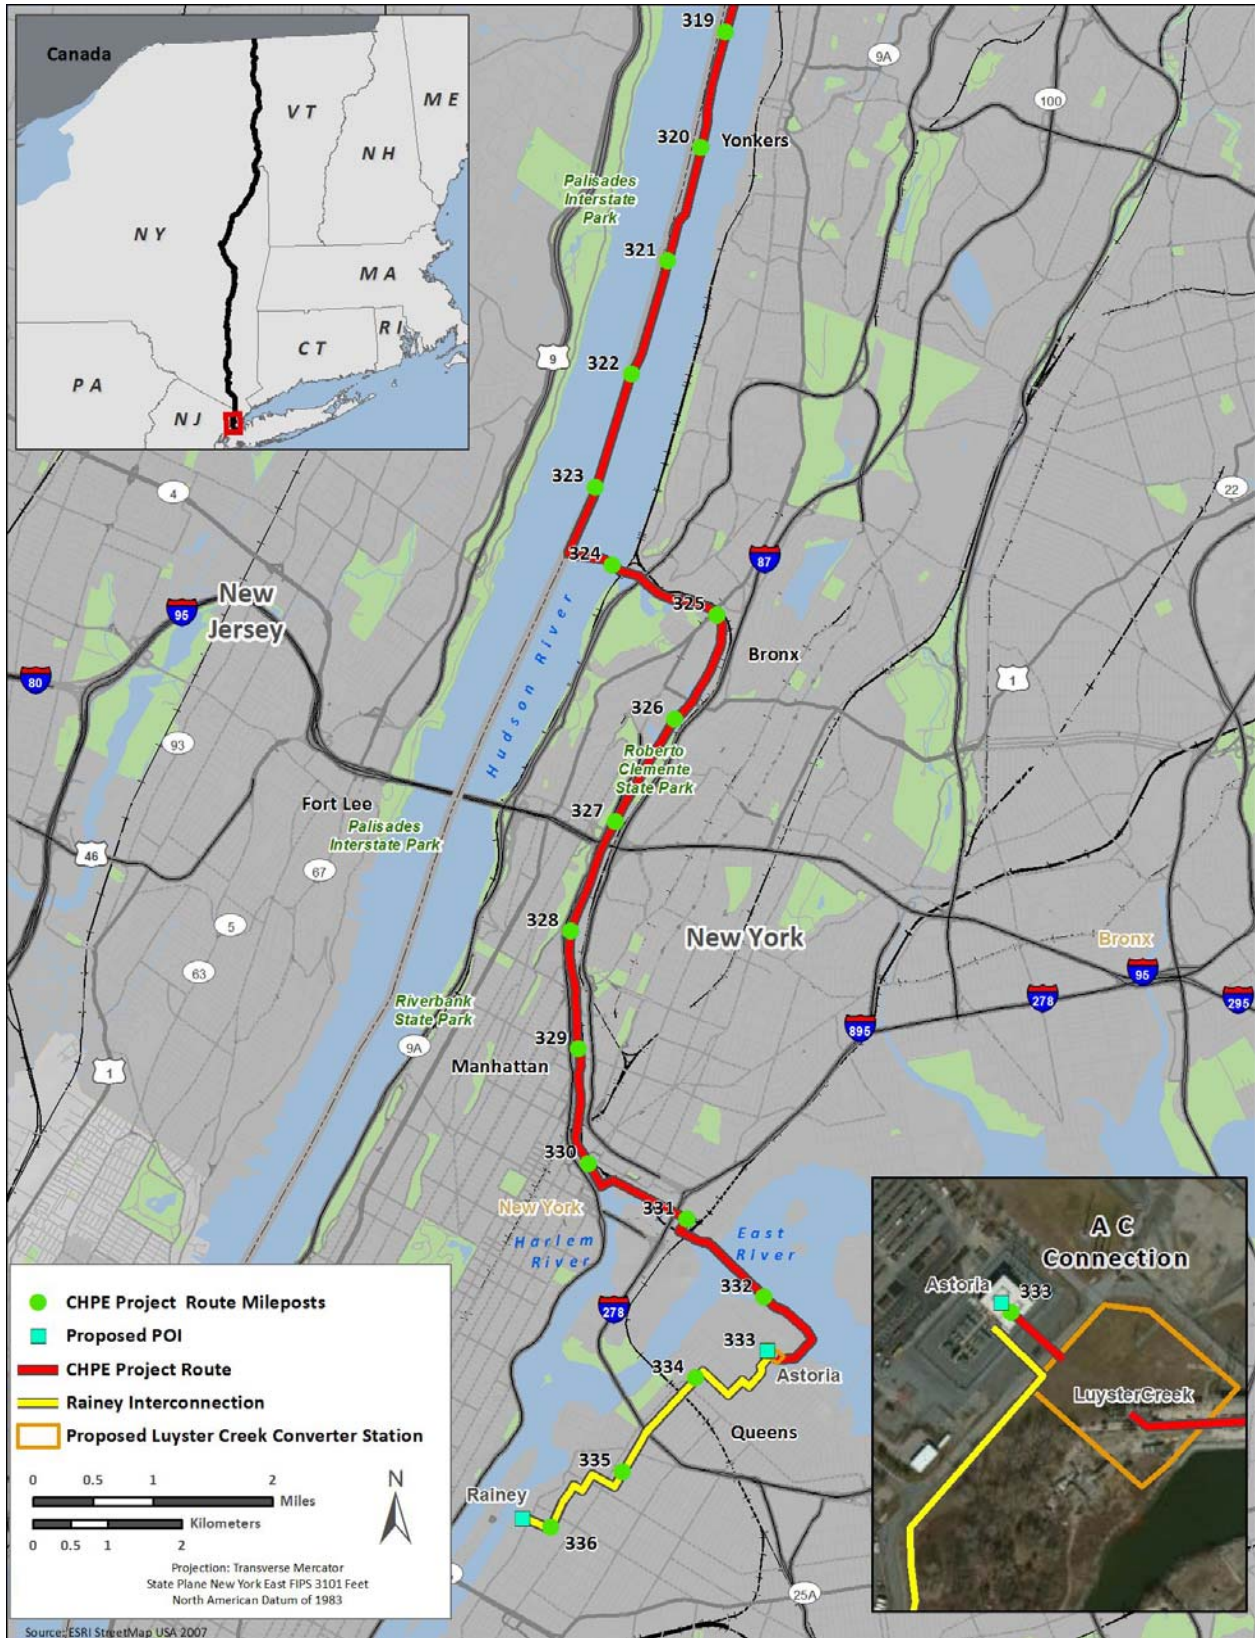

1

2

Figure 2-5. New York City Metropolitan Area Segment

- 1 • The East River is a narrow, tidally dominated straight that connects Long Island Sound with the  
2 upper part of New York Harbor. From its origin near the Battery to the end of Long Island  
3 Sound, the East River extends approximately 17 miles (27 km). Salinity ranges from 20 ppt near  
4 the Battery to 25 ppt near Long Island Sound, varying seasonally with tidal influx and vertical  
5 mixing. NOAA (1997) designates the East River as mixing zone. The river's depth ranges from  
6 30 feet (10 meters) to 99 feet (30 meters) (Blumberg and Pritchard 1997) and the temperature  
7 range is the same as the Hudson River.

8 Since the water quality, bottom habitats, and EFH within the aquatic portions of the Hudson River and  
9 New York City Metropolitan Area segments of the proposed CHPE Project route are nearly identical and  
10 support nearly identical species, the analysis in this EFH Assessment describes impacts applicable for  
11 both segments and does not differentiate between them.

## 12 2.3 Descriptions of Construction Methods


13 The following subsections describe the specific engineering details of the transmission system as  
14 approved by the NYSPSC Order granting the Certificate of Environmental Compatibility and Public Need  
15 (Certificate) for the proposed CHPE Project issued to the Applicant in April 2013 (NYSPSC 2013). The  
16 following subsections also discuss how the Applicant proposes to install and operate the transmission line  
17 and aboveground facilities of the proposed CHPE Project.

### 18 2.3.1 Aquatic Direct Current Transmission Cable

19 The transmission cables proposed for installation in the aquatic portions of the Lake Champlain, Hudson  
20 River, and New York City Metropolitan Area segments would be cross-linked polyethylene (XLPE)  
21 HVDC cables rated at 300 to 320 kilovolts (kV). An armored layer of galvanized steel wires embedded  
22 in bitumen provides additional protection for the aquatic transmission cables (see **Figure 2-6**). The  
23 transmission cables would be buried beneath the beds of Lake Champlain and the Hudson, Harlem, and  
24 East rivers at a depth of at least 4 to 8 feet (1.2 to 2.4 meters) to prevent disturbance to the cables from  
25 unrelated marine operations in the waterways. The depth of burial that can be achieved would depend on  
26 available marine construction equipment, soil types and depth to bedrock, existing utilities, and the types  
27 of marine activities occurring and their potential threat to cable integrity (TDI 2010).


28 Where the transmission cables cross bedrock (approximately 11 locations in the Hudson River) or an  
29 existing utility such as a pipeline or another cable (approximately 66 locations in the Hudson River and  
30 26 locations in the Harlem River), it would be laid over the rock or existing utility and a protective  
31 covering, such as an articulated concrete mat, would be installed over the cable crossing (CHPEI 2012a)  
32 (see **Figure 2-7**). Concrete mats would be 40 feet (12 meters) long, 8 feet (2.4 meters) wide, and 9 inches  
33 (23 centimeters [cm]) deep. An average of three concrete mats would be placed lengthwise end-to-end  
34 over each crossing. Physical surveys, including diver surveys of each utility, would be performed prior to  
35 cable installation in an attempt to reduce the requirement for concrete mats.

36 In the year preceding transmission line installation, debris would be removed from the route (i.e., route  
37 clearing). Debris removal would occur from September 15 through October 30 in the Hudson River  
38 within the appropriate construction windows and would be accomplished in 20 calendar days during 12-  
39 hour shifts. Debris removal would occur in the Harlem River during the May 31 to November 30  
40 construction window. Route clearing could require one to three stages based on the site conditions. All  
41 stages of route clearing would use a tug and barge equipped with cutter wheel equipment, or with a  
42 smaller tug if possible. Support vessels would include a crane barge to remove larger debris as required  
43 or a debris barge to transport recovered riverbed debris. The initial stage of route clearing is designed to  
44 find and remove debris lying on and just below the river floor. This stage is performed with large grapnel  
45 equipment (see **Figure 2-8**). In areas of extensive debris or suspect areas, a second stage clearing would

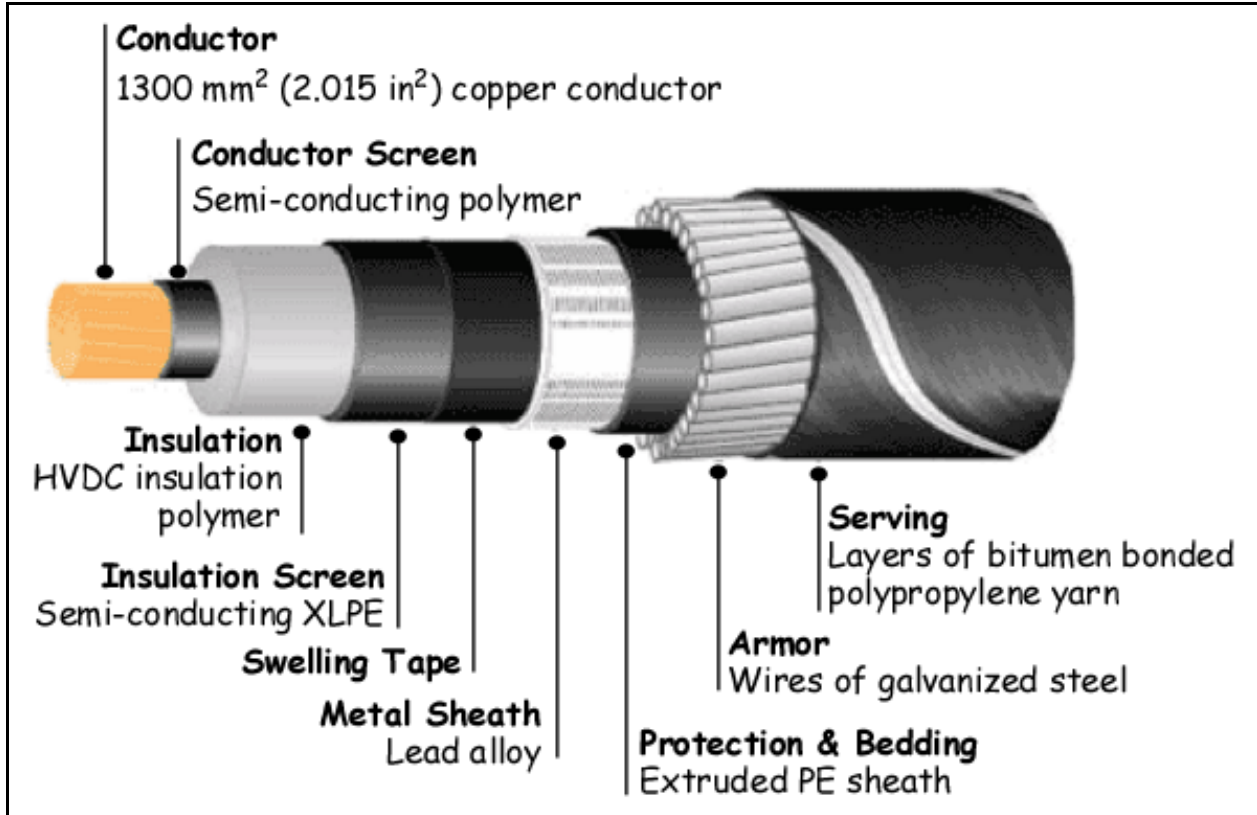

Source: Cross-Sound Cable Company 2012

**Figure 2-6. Example Aquatic HVDC Transmission Cable Cross-Section**

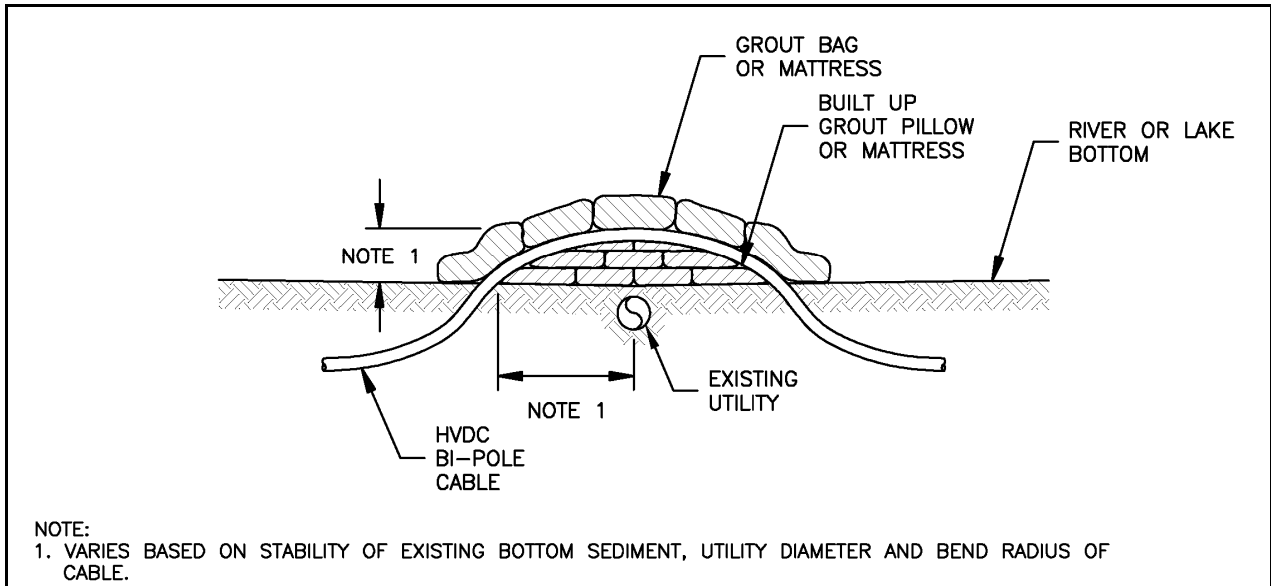

Source: CHPEI 2012a

**Figure 2-7. Representative Schematic of Protective Measures for Aquatic Transmission Cables**



Source: Kingbird 2014

**Figure 2-8. Example of Grapnel Used for Debris Removal**

1  
2 be performed with a de-trenching grapnel. This grapnel provides penetration of up to 3 feet (0.9 meters)  
3 into the riverbed.

4 After completion of the grapnel runs, a third stage of clearing (i.e., plow pre-rip) would be required if the  
5 site conditions indicate the potential for sub-surface debris. The plow pre-rip is designed to clear and  
6 prove the entire route to the full burial depth, and would be performed in the Hudson and Harlem rivers  
7 using a jet plow but without the cables loaded.

8 Transit routes for the route clearing equipment would vary based on the location of marine-based yards  
9 along the route, but the yards would generally be no more than 50 miles (81 km) from the equipment's  
10 location. Temporary marine yards would be set up and moved as the route clearing operation progresses.  
11 Transit speeds would be no faster than 8 to 12 knots depending on weather, currents, and barges in tow.  
12 Vessel drafts would vary from 8 feet (2.4 meters) for supply barges to 16 feet (5 meters) for supply tug  
13 boats, with 4-foot (1.3-meter) drafts for local push tugs. Work barges would generally draw 12 feet (4  
14 meters), depending on the load. This level of activity and associated vessel speeds are consistent with  
15 existing vessel use on the Hudson River. During debris removal, the barge would proceed at a speed of  
16 1.5 knots or less. In areas with significant side-scan and magnetometer targets, the speed would be  
17 reduced to less than 1 knot. The route transected for clearing would follow the path of the proposed  
18 transmission line.

### 19 2.3.2 Horizontal Directional Drilling (HDD)


20 HDD would be used to install the transmission cables in transition areas between aquatic and terrestrial  
21 portions of the proposed CHPE Project route at the transitions from water to land and land to water at  
22 MPs 101, 228, 295, 303, and 330; at environmentally sensitive areas such as wetlands or streams; under  
23 roadway or railway crossings where trenching is not possible; and under the East River.

24 The HDD operation at a water-to-land transition would include an HDD drilling rig system, a drilling  
25 fluid collection and recirculation system, temporary cofferdam installed at the water exit to maintain exit  
26 pit stability following dredging of the pit, and associated support equipment (see **Figure 2-9**). For each  
27 proposed HDD location, two separate drill holes would be required, one for each cable. During  
28 installation, a drill rig would be placed on shore behind a temporary fluid return pit and a 40-foot  
29 (12-meter) drill pipe with a cutting head would be set in place to begin the drilling process. As the initial  
30 pilot borehole is drilled, slurry composed of water and bentonite would be pumped into the hole to  
31 transport the drill cuttings to the surface, to aid in keeping the borehole stable, and to lubricate the drill.  
32 After the final drill length has been achieved, high-density polyethylene (HDPE) conduits would be



NOTES:

1. COFFERDAM TO BE UTILIZED WHERE NECESSARY TO STABILIZE BOTTOM SEDIMENT AT HDD TERMINUS. OTHER ALTERNATIVES PROVIDING EQUIVALENT ENVIRONMENTAL PROTECTION MAY BE EMPLOYED WHERE BOTTOM CONDITIONS DO NOT PERMIT DRIVEN PILES.
2. PILES SHALL BE REMOVED OR CUT BELOW THE MUD LINE. AT COMPLETION OF CABLE INSTALLATION IN COORDINATION WITH THE BMP REQUIREMENTS.
3. COFFERDAM WILL EXTEND ABOVE THE WATERLINE IN SHALLOW WATER. EXPOSED STRUCTURE WILL BE MARKED BY BUOYS AND OTHER NAVIGATION AIDS. A NOTICE TO MARINERS WILL BE ISSUED WHEN APPROPRIATE.
4. COFFERDAMS IN DEEP WATER NOT BE EXTENDED TO THE WATER SURFACE. EACH INSTALLATION WILL BE MARKED BY BUOYS AND OTHER NAVIGATION AIDS. A NOTICE TO MARINERS WILL BE ISSUED WHERE APPROPRIATE.

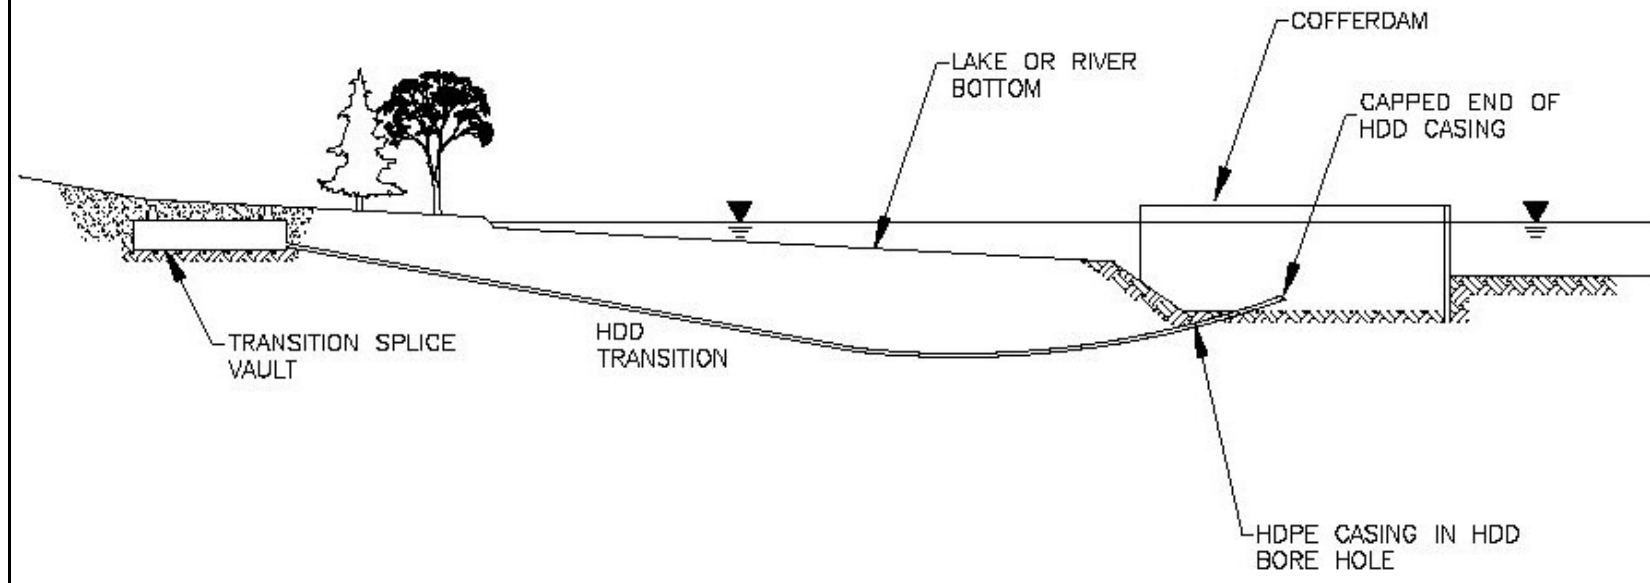

Source: CHPEI 2012c. Note: Not to scale.

Figure 2-9. Example HDD Techniques

1  
2

1 pulled into the drilled hole. Once the HDPE conduits are in place, the transmission cables would be  
2 pulled through these pipes and into a transition splice vault, which would remain in place to protect the  
3 transmission cable.

4 Cofferdams would be installed in the Hudson River at approximate MPs 228, 295, and 303. The  
5 anticipated dimensions of each cofferdam would be approximately 16 feet (4.9 meters) by 30 feet  
6 (9 meters) or 480 square feet (44 square meters). Dredging activities associated with the proposed CHPE  
7 Project would only be for cofferdam installation, which is expected to last from 5 to 10 days using a  
8 single dredge and result in a total dredged area limited to less than 1 acre in the Hudson River. Dredging  
9 and cofferdam installation would occur during the construction windows established for this project,  
10 which are outside of shortnose and Atlantic sturgeon spawning season. The spawning seasons for these  
11 species are approximately April 1 to June 30 for shortnose sturgeon and approximately April 15 to mid-  
12 summer for Atlantic sturgeon depending on where spawning is occurring on the Hudson River).

13 Material would be dredged using a closed clamshell dredge (also known as an environmental bucket) and  
14 removed by barge to an appropriately permitted processing facility. Dredging would be conducted during  
15 8- to 12-hour shifts daily. The cofferdam would extend 6 feet (1.8 meters) below the mudline.  
16 Approximately 107 cubic yards (82 cubic meters) would be removed from within each cofferdam, for a  
17 total of 321 cubic yards (246 cubic meters) of dredge material removed from all three cofferdam sites on  
18 the Hudson River. A barge or dredge scow could hold up to 2,500 cubic yards (1,923 cubic meters) of  
19 material. Therefore, only one barge trip should be needed to remove all material. Silt curtains would be  
20 used as required around the work area; however, it is not anticipated that any silt would escape from  
21 within the cofferdam.

22 Sheet pile used to construct cofferdams would be installed with a vibratory hammer, and would be  
23 installed in pairs with 8 to 10 pairs of sheets installed per day. Each pair of sheets would provide a wall 4  
24 feet (1.3 meters) wide and approximately 50 feet (15 meters) tall. A single pair of sheets can be installed  
25 in 30 to 120 minutes depending on the geotechnical conditions. After the vibratory penetration, each  
26 sheet would be “seated” into hard strata as required. Approximately 4 to 6 strikes per pair of sheets  
27 would be required to “seat” the pile wall. The Applicant has committed to using soft starts for vibratory  
28 installation. Each cofferdam would be constructed within 25 to 30 days, for a total duration of sheet pile  
29 installation of 75 to 90 days for all three cofferdams. All cofferdams would be inspected for trapped fish  
30 following installation. It is anticipated that the cofferdam would be cut at the mudline using divers and  
31 underwater cutting or burning equipment such as exothermic rods when installation activities are  
32 completed.


33 A visual and operational monitoring program would be developed and conducted during HDD operations  
34 to detect any losses of drilling fluid. Visual observations of drilling fluid in the water, or excessive loss of  
35 volume or pressure in the borehole would trigger response actions by the HDD operator, including halting  
36 drilling activities and initiating cleanup of released bentonite. A barge with a pumping system would be  
37 positioned at the cofferdam during drilling to collect any drilling fluid released into the cofferdam  
38 enclosure.

39 HDD could also be used to install the transmission cables beneath other sensitive areas such as wetlands,  
40 streams, and existing infrastructure along the terrestrial portions of the proposed CHPE Project route, and  
41 in special circumstances to avoid obstacles along the CHPE Project route, such as road or railroad  
42 crossings where open trenching would not be possible (TDI 2010). It is expected that at least three  
43 different sized HDD rigs would be employed on the project, requiring varying staging area sizes  
44 depending on the length of the drill at the particular location, proximity to sensitive areas such as  
45 wetlands, access limits, and other constraints.



### 2.3.3 Terrestrial Direct Current Transmission Cable

Approximately 42 percent of the proposed CHPE Project route would be composed of underground (terrestrial) portions. For the underground portions of the transmission line route, the two cables within the bipole system would typically be laid side-by-side in a trench. After the cables are laid in the trench, the trenches would be backfilled with low thermal resistivity material, such as well-graded sand to fine gravel, stone dust, or crushed stone. For the underground transmission cables, the outer sheathing insulation would be composed of an ultraviolet-stabilized, extruded polyethylene layer (see **Figure 2-10**). The underground transmission cables would have an outside diameter of 4.5 inches (11 cm), and each cable would weigh approximately 20 pounds per foot (2.8 kilograms per meter) (TDI 2010). A protective cover of HDPE, concrete, or polymer blocks would be placed directly above the low thermal resistive backfill material.

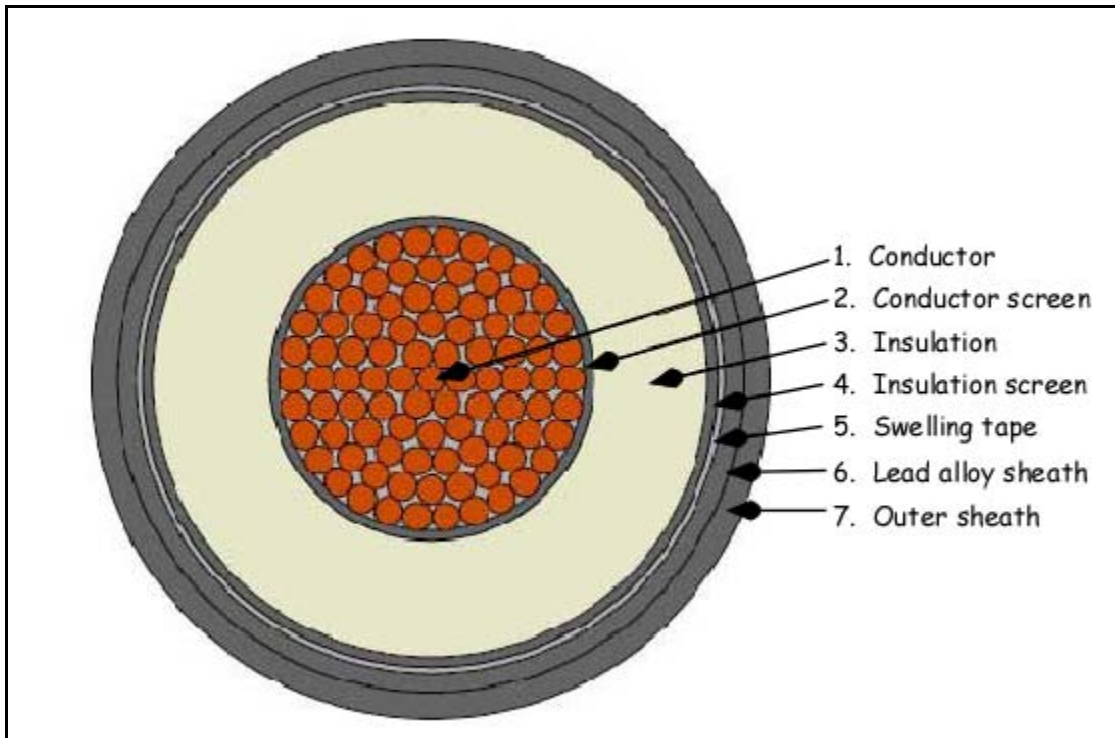

Source: CHPEI 2012d

**Figure 2-10. Example Terrestrial HVDC Transmission Cable Cross-Section**

A combination of HDD and trenching techniques would be used to install the transmission line underground along upland portions of the route. Trenchless technologies would be used where roadways and railroad beds would be crossed by the transmission line. Trenchless technologies could include HDD, horizontal boring, or pipe jacking. Following completion of the transmission cable installation, the excavated area would be backfilled and regraded, and the disturbed area would be returned to its previous condition as much as possible (CHPEI 2012b).

The proposed CHPE Project would be in the existing ROW of both the CP and CSX railway systems between MPs 112 and 228 and MPs 295 and 301. The Applicant has stated that drafts of Occupancy Agreements for easements along the railroad corridor have been exchanged with CP and CSX and are currently under negotiation. The final agreements would establish the terms of occupancy of the ROWs and refine required offsets of the transmission cables from the track centerline.

## 1 2.3.4 Cooling Stations

2 In certain situations where there is a long segment of cable installed by HDD, heat can accumulate in the  
3 HDPE conduit and reduce the performance of the transmission system. The Applicant has identified  
4 16 sections of underground cabling where the potential for heat accumulation could require that cooling  
5 equipment stations be installed at approximate MPs 110, 112, 145, 146, 158, 185, 208, 227, 228, 296, two  
6 at 298, 299, two at 302, and 331. Each cooling station would consist of a chiller unit and pumping system  
7 within the building and this equipment would circulate chilled water through tubing in a closed-loop  
8 system alongside the HVDC cable to cool the cables. The heat emitted from the cables within the buried  
9 conduit would then be transferred by the coolant back to the cooling station and then to the outside  
10 atmosphere above ground. It is anticipated that the cooling systems would be operated primarily during  
11 peak electric load conditions (CHPEI 2012c).

## 12 2.3.5 Luyster Creek HVDC Converter Station

13 An HVDC converter station would be constructed near Luyster Creek in Astoria, New York, to convert  
14 the electrical power from DC to AC. The converter station site would be approximately 4.5 acres  
15 (1.8 hectares) in size. The HVDC converter station building would be approximately 165 feet by 325 feet  
16 (50 meters by 99 meters) with a building footprint of 1.2 acres (0.5 hectares) and a height of  
17 approximately 70 feet (21 meters), with transformers, cooling equipment, and power line carrier filters  
18 being installed outside of the building. The converter station would be powered by electricity taken  
19 directly from the proposed CHPE Project transmission line and would not require onsite personnel during  
20 normal operations.

## 21 2.3.6 Astoria Annex Substation Interconnection

22 The Luyster Creek Converter Station would deliver its energy by underground cable to the Astoria  
23 345-kV, sulfur hexafluoride gas-insulated substation that serves as the primary point of interconnection to  
24 the grid. The Applicant has proposed to modify the electrical configuration of the Astoria Annex  
25 Substation by adding a four-breaker, gas-insulated switch ring bus to connect both the cable from the  
26 Luyster Creek Converter Station and the Astoria-Rainey Cable to the one remaining empty bus at the  
27 Astoria Annex Substation. This new ring bus could require construction of a new building approximately  
28 72 feet (22 meters) long, 58 feet (18 meters) wide, and 40 feet (12 meters) high. If constructed, the new  
29 ring bus building would be 4,176 square feet (388 square meters) in size and would be located on the  
30 same parcel of land as the Luyster Creek Converter Station. The new ring bus would be connected to  
31 both the converter station and the Astoria Annex Substation by gas-insulated switch cables in  
32 underground pipes (CHPEI 2012e). However, no obstacles have been identified that would prevent the  
33 expansion of the existing ring bus at the Astoria Annex Substation to eight breaker positions. Therefore,  
34 it is unlikely that it would be necessary to build a new building to house the ring bus.

## 35 2.3.7 Astoria to Rainey Interconnection

36 The Applicant would also construct a 345-kV high-voltage alternating current (HVAC) cable circuit from  
37 the Astoria Annex Substation to ConEd's Rainey Substation in Queens to deliver power reliably into  
38 ConEd's 345-kV system. This interconnection would consist of HVAC cables buried beneath city streets  
39 for approximately 3 miles (5 km) (see **Figure 2-5**). The XLPE HVAC cables would be buried in a trench  
40 to a depth of more than 4 feet (1.2 meters) with a separation distance of 9 inches (23 cm) between the  
41 cables in the trench.

## 2.4 Additional Engineering Details

**Heat.** Ambient water temperatures in the Hudson, Harlem, and East rivers range from 32 °F (0 °C) in January to a July maximum of 81 °F (27 °C) (Historic Hudson River 2004, Riverkeeper 2013, Blumberg and Pritchard 1997). The proposed CHPE Project's HVDC cables would be designed to operate at normal temperature of 158 °F (70 °C). Under limited durations (i.e., maximum of 2 hours) of emergency overload conditions, the temperature would be limited to 176 °F (80 °C). At these temperatures, heat must be carried away from the conductors for them to operate efficiently, and soils in and around a trench perform this for underground cables. Where required on land, a clean, low thermal resistive backfill material would be used instead of native soil in the trench around the cables to ensure sufficient standard heat transfer to the surrounding soils and groundwater.

It is estimated that that for cable burial at 4 and 8 feet (1.2 and 2.4 meters), the maximum expected temperature change would be less than 1 °F (0.0001 °C and 0.0002 °C for 4- and 8-foot [1.2- and 2.4-meter) burial, respectively) in the water column above the riverbed, approximately 1.8 °F (1.20 °C and 1.24 °C, respectively) at the riverbed surface, and 9 °F and 4 °F (5 °C and 2.46 °C), respectively, at 0.2 meters below the riverbed surface. This is based on modeling that used a flow rate of 1.38 feet (0.4 meters) per second (CHPEI 2012j). This flow rate might be considered conservative inasmuch as Nepf and Geyer (1996) indicated ebb tide velocities can reach approximately 6.6 feet (2 meters) per second in the Hudson River under normal flow conditions. While the temperature change is not directly linear, it is reasonably expected that based on these calculations that the expected water, surface, and subsurface temperatures that would be expected at a burial depth of 7 feet (2.1 meters) would be closer to those identified for the 8-foot (2.4-meter) burial rather than the 4-foot (1.2-meter) burial.

Where the transmission cables cannot be buried to their full depth due to utilities or bedrock and must be covered with concrete mats, the estimated increase in ambient water temperature surrounding the cables covered by the concrete mats is expected to be negligible (less than 0.25 °F [0.14 °C]). This is expected to be within the range of daily variation of water temperatures experienced in the Hudson and Harlem rivers. The highest increase in ambient temperature in the top 2 inches (5 cm) of sediment along the sides of the concrete mat is expected to be 1.26 °F (0.7 °C) or less (Exponent 2014). This assumes a river depth of 16 feet (5 meters) and an average water velocity of 1.38 feet (0.4 meters) per second.

**Electric and Magnetic Fields.** Operation of the proposed CHPE Project transmission line would produce electric and magnetic fields. Transmission lines, like all electric devices, produce electric and magnetic fields, or electromagnetic fields (EMFs). Voltage, the force that drives the current, is the source of the electric field. Current, the flow of electric charge in a wire, produces the magnetic field. The strength of the EMF depends on the design of the electrical line and the distance from it. EMF is found around any electrical wiring, including household wiring, electrical appliances, and equipment.

Electric fields are measured in volts per meter or kV per meter. Electric field strength is reduced by shielding or by intervening objects such as structures and vegetation. The proposed CHPE Project transmission line cables would be shielded within a lead-alloy sheath (see **Figure 2-10**) and buried, which would effectively eliminate any exposure to the electric field (Cross-Sound Cable Company 2012, WHO 2012). In areas where the cable cannot be buried (e.g., when installed over existing utility lines or bedrock), protective covering, such as concrete mats, would be installed over them.

Magnetic fields diminish with distance from the source. Unlike electric fields, however, intervening objects between the source and the receptor, such as structures or soil over a buried transmission line, do not reduce magnetic field strength. Consequently, while electrical appliances can produce the highest localized magnetic fields, power lines serving neighborhoods and distribution lines and transformers

1 serving individual homes or businesses are a common source of longer-term magnetic field exposure  
 2 (BPA 2010).


3 Magnetic fields are measured in units of gauss (G) or milligauss (mG). The average magnetic field  
 4 strength in most homes (away from electrical appliances and wiring) is typically less than 2 mG. Outdoor  
 5 magnetic fields in publicly accessible places can range from less than a few mG to 300 mG or more,  
 6 depending on proximity to power lines and the voltage of the power line.

7 **Table 2-1** and **Figure 2-11** provide the magnetic field strengths for the proposed CHPE Project  
 8 transmission lines at an assumed burial depth of 3.3 feet (1.0 meter). The table and figure demonstrate  
 9 that magnetic field levels are reduced the closer the cables are to each other.

10 **Table 2-1. Magnetic Field Levels for the Proposed CHPE Transmission Cables**

Distance From Cables (feet)	Levels at Various Spacing Between Cables (values in mG)			
	1 foot	2 feet	3 feet	6 feet
+5	161.8	322.7	481.6	932.3
+10	76.9	154.1	231.9	472.1
+15	41.0	82.1	123.5	251.3
+20	24.8	49.6	74.6	151.0
+25	16.4	32.9	49.4	99.6
+30	11.6	23.3	34.0	70.4
+50	4.3	8.6	12.9	25.9

Source: CHPEI 2012i

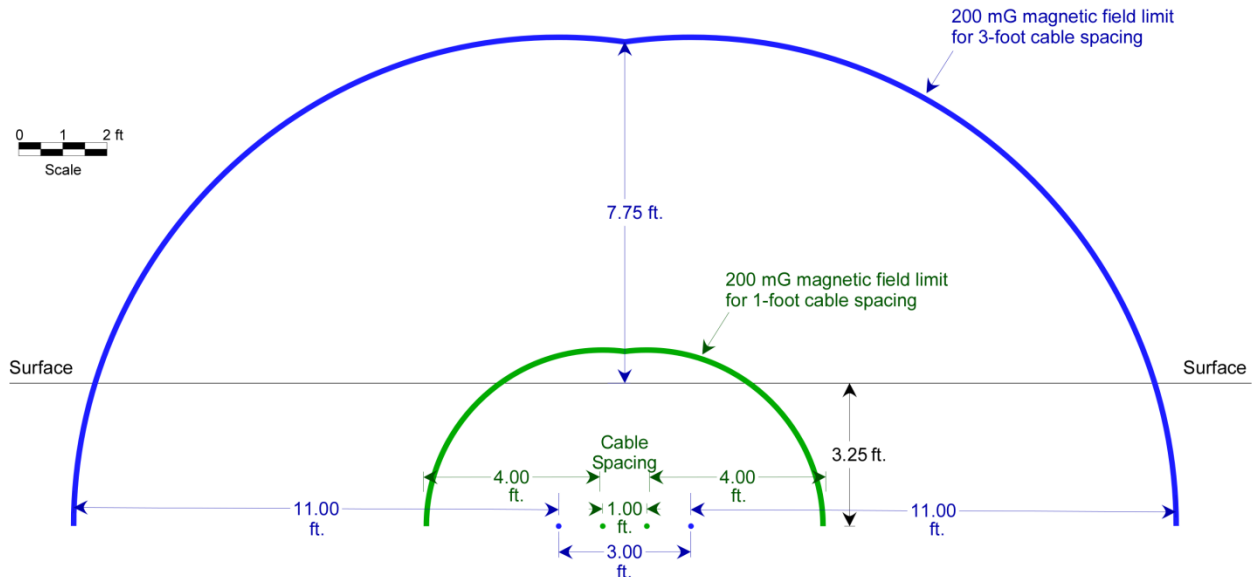

11  
 12 **Figure 2-11. 200-mG Magnetic Field Strengths with Cable Spacings of 1 Foot and 3 Feet**

## 2.5 Construction and Schedule

The Applicant anticipates that the initial permitting phase of the proposed CHPE Project would continue through early 2014, with major construction commencing later in 2014. Installation of the transmission cables is proposed to be completed in three phases between 2014 and 2017. The Applicant anticipates that the commercial operation date for the proposed CHPE Project would be 2017 (TDI 2010, CHPEI 2012h).

### 2.5.1 Aquatic Transmission Cable Installation

To the extent practical, the aquatic transmission cables would be buried beneath the beds of existing waterways at depths ranging between 4 and 8 feet (1.2 and 2.4 meters) beneath the bed surface. In Lake Champlain, the cables would be buried in the lake bottom to a target depth of 8 feet (2.4 meters) in the soft sediment within the Federal navigation channel, and at least 4 feet (1.2 meters) in the lakebed outside of the navigation channel. In the Hudson River, the cables would be buried to a minimum depth of 7 feet (2.1 meters); the transmission line would not traverse the federally maintained navigation channel in the Hudson River. Cable installation in the Harlem River would be entirely within the navigation channel at depths of 8 feet (2.4 meters) in the soft sediment and 6 feet (1.8 meters) in rock. The transmission line would be installed along the entire East River route using HDD; therefore, trench burial depths would not apply.

Aquatic installation and burial of the transmission line would occur via jet plow in all locations except where installed by shear plow in southern Lake Champlain (south of MP 74), HDD at water-to-land transitions and under the East River, laid on the surface over bedrock or utility line crossings and covered with concrete mats (total of 3.0 miles [4.8 km] for the entire proposed CHPE Project route), or blasting of 460 feet (140 meters) of trench at MP 324.5 in the Harlem River. The jet plow is fitted with hydraulic pressure nozzles that create a downward and backward flow to fluidize the sediment within a trench approximately 2 feet (0.4 meters) wide and 4 to 8 feet (1.2 to 2.4 meters) deep depending on the burial requirements, allowing the transmission cables to settle to the bottom of the trench under their own weight before the sediments settle back into the trench.

The Applicant would employ a fleet of approximately four vessels, including the cable-laying vessel, survey boat, crew boat, and tugboat or tow boat, which would be used to coordinate laying of cable. The plowing process would be conducted using a dynamically positioned cable barge and towed plow device that simultaneously lays and embeds the aquatic transmission cables in a trench. The transmission cables composing the bipole would be deployed from the vessel to a funnel device on the plow. The plow is lowered to the lake or river bed, and the plow blade cuts into the lake or riverbed while it is towed along the pre-cleared route to carry out a simultaneous lay-and-burial operation. The plow would bury both cables of the bipole in the same trench at the same time. Anchorage of vessels during installation of the aquatic transmission line would be used in the event that bottom conditions are encountered that either stop forward progress at reasonable tow tension or result in excessive rolling or pitching of the jet plow. Specific areas where anchorage would be anticipated include construction and removal of temporary cofferdams and cable landings at water-to-land transitions, marine splicing locations (although this could also be accomplished using dynamically positioning), and possibly along the 460-foot (140-meter) length of bedrock trenching in the Harlem River (at MP 324.5).

Burial depths could vary in response to site-specific factors (e.g., presence of existing infrastructure or archaeological resources, localized geological or topographical obstacles, or other environmental concerns) identified along the proposed CHPE Project route. Where the transmission cables would cross areas that contain surficial bedrock or existing infrastructure (e.g., other cables or pipelines), the transmission cables would generally be laid atop the existing bedrock or infrastructure and protected by

1 material placed over the transmission cables. Protective material could include concrete (e.g., rip-rap or  
2 concrete mattresses), protective cable ducts, or other low-impact protective armoring (TDI 2010).

3 The burial depth for the area of rock excavation in the Harlem River is stated in the U.S. Army Corps of  
4 Engineers (USACE) Public Notice for the proposed CHPE Project Clean Water Act Section 404 Permit  
5 Application as being 6 feet (1.8 meters) below waterbody bottom (USACE 2013). The proposed  
6 transmission line would cross exposed bedrock for approximately 460 feet. Geologic maps indicate this  
7 rock is Fordham gneiss having unconfined compressive strength that is too hard to remove by cutterhead,  
8 ripping, hoe-ramming, or non-explosive methods. Blasting trials would be conducted using a  
9 pre-packaged chemical demolition agent (e.g., Green Break or RocKracker) that would be inserted into  
10 holes drilled into rock. These packaged demolition agents would be loaded into boreholes and when  
11 ignited would generate an expansive force to fracture the rock. The rock fragments would then be  
12 removed by long-reach hydraulic excavating buckets and deposited in a barge. If the trials are successful,  
13 a vertical pattern of holes would be drilled into the rock to form a trench. The broken rock would be  
14 dredged sequentially from each end of the trench progressing towards the middle with the rock fragments  
15 placed into a barge. Turbidity would be generated as a result of operations. However, impacts are  
16 expected to be minimal because of the crystalline nature of the rock and because silt curtains would be  
17 used to surround the operations to avoid the spread of a turbidity plume.

18 In the event that trials with the pre-packaged chemical demolition agent are unsuccessful, due to the  
19 rock's hardness or other reasons, it would be necessary to use water gel dynamites to fracture the rock so  
20 it can be dredged. The dynamite would produce a shock wave upon detonation. The force of the shock  
21 wave could be decreased by stemming the top of the blast holes with pea gravel, which might require an  
22 increase in the number of boreholes needed to be drilled to get the powder factor (i.e., pounds of dynamite  
23 per cubic yard of rock) required to break the rock. Each blast hole would be detonated in a controlled  
24 sequence to move the rock towards the open end of the trench, and to minimize vibrations that would  
25 travel towards the shoreline. Explosives would be detonated during each delay (typically 8 milliseconds  
26 apart). Blasting would occur within the proposed CHPE Project construction window for the Harlem  
27 River (see **Table 2-2**).

28 The blasting program in the Harlem River is estimated to last 10 weeks, requiring approximately 300 drill  
29 holes with each drill taking 30 to 60 minutes to complete. Nominal noise, vibration, and turbidity are  
30 expected from the drilling process, which would employ small diameter drill holes (~1.5 inches  
31 [~3.8 cm]) that generate a small amount of suspended sediment. The sediment would be contained by  
32 means of floating silt curtains as appropriate. Air compressors mounted on the barge would generate  
33 additional construction noise. Drilling is anticipated to be conducted from a barge on spuds. Prior to  
34 blasting, the barge would be moved off the drilled holes with clearance of the vicinity as required by the  
35 fire marshal and the harbormaster.

36 The blast events are anticipated to last only a few seconds, but they would be preceded and followed by  
37 warnings and clearings of the area for inspections, all of which could take approximately 2 hours. The  
38 exact production schedules would be developed by the blasting construction contractor. Preliminary  
39 construction sequencing studies indicate that 15 to 20 separate blasts could be required. Peak ground  
40 vibrations are predicted to range from 0.25 inches (0.64 cm) per second at a distance of 200 feet  
41 (61 meters) from the trench, 1 inch (2.5 cm) per second at a distance of 75 feet (23 meters), 2 inches  
42 (5.1 cm) per second at 50 feet (15 meters), and 4 inches (10.2 cm) per second at 30 feet (9 meters). Peak  
43 water pressures are predicted to be 10 pounds per square inch (psi) at 200 feet (61 meters), 30 psi at 75  
44 feet (23 meters), 50 psi at 50 feet (15 meters), and 85 psi at 30 feet (9 meters) from the trench.

45 Following clearance by the blaster, mucking of blasted trench materials would be completed with  
46 long-reach backhoes to lift muck out of the trench and, if the fragmentation is good, put it to the side.

1 Large rocks would require removal to shore and disposal. An estimated 1,200 tons of rock material  
 2 would be anticipated to be removed from the trench and temporarily stored on the river bottom adjacent  
 3 to the trench. The cables would be laid over a sand backfill in the trench and covered with sand layer.  
 4 The remainder of the trench would be backfilled with the blasted aggregate materials.

5 The NYSPSC Certificate issued for the proposed CHPE Project established construction work schedule  
 6 windows identifying times of the year when work associated with the underwater portion of the  
 7 transmission line may take place (NYSPSC 2013). These established work windows and time of year  
 8 restrictions were developed in part to avoid impacts on overwintering, spawning migrations, spawning  
 9 activity, and larval stages of Endangered Species Act (ESA)-listed fish species. **Table 2-2** presents the  
 10 underwater construction windows for the Hudson, Harlem, and East rivers. The New York State  
 11 Department of State (NYSDOS) has conditionally concurred with these construction windows as part of  
 12 its Coastal Management Program (CMP) consistency certification for the proposed CHPE Project.  
 13 Restriction of construction activities to specific windows of time would protect EFH fish species during  
 14 spawning migrations, which are vital and sensitive stages of their lifecycle.

15 **Table 2-2. Underwater Construction Windows**

CHPE Milepost	Location	Construction Window	Primary Construction Method
<b>Hudson River</b>			
228 to 269	Cementon (Catskill) to New Hamburg	August 1 to October 15 <sup>a</sup>	Jet Plow
269 to 295	New Hamburg to Stony Point	September 15 to November 30	Jet Plow
303 to 324	Clarkstown to Harlem River	July 1 to October 31	Jet Plow
<b>Harlem and East Rivers</b>			
324 to 330	Harlem River	May 31 to November 30 <sup>b</sup>	Jet Plow
331 to 331	East River	May 15 to November 30	HDD

Source: NYSPSC 2013, CHPEI 2014a

Notes:

<sup>a</sup> The transmission line would be installed between MPs 245 and 269 between September 14 and November 30 to avoid impacts on the Kingston-Poughkeepsie Deepwater Significant Coastal Fish and Wildlife Habitat (SCFWH).

<sup>b</sup> Blasting would take place between July 1 and November 30.

16 **2.5.2 Terrestrial Direct Current Transmission Cable Installation**

17 The general sequence for installing the terrestrial DC transmission cables along the road and railroad  
 18 ROWs would be conducted in steps as follows (CHPEI 2010a):

- 19       • Initial clearing operations (where necessary) and storm water- and erosion-control installation  
 20       • Trench excavation  
 21       • Cable installation  
 22       • Backfilling  
 23       • Restoration and revegetation.

24 The typical trench would be up to 9 feet (2.7 meters) wide at the top and approximately 3 feet (0.9 meters)  
 25 deep to allow for proper depth and a 1-foot (0.3-meter) separation required between the two transmission  
 26 cables to allow for heat dissipation. If shallow bedrock is encountered, the rock would be removed by the  
 27 most suitable technique given the relative hardness, fracture susceptibility, and expected volume of

1 material. The operation of the transmission cables would result in the generation of heat, which would  
2 reduce the electrical conductivity of the cables; therefore, prior to laying the cables, the trenches would be  
3 backfilled with low thermal resistivity material such as sand to prevent heat from one cable affecting a  
4 nearby cable. There would be a protective concrete cover consisting of a layer of weak concrete directly  
5 above the low thermal resistive backfill material. The whole assembly would have a marker tape placed  
6 1 to 2 feet (0.3 to 0.6 meters) above the cables (CHPEI 2010a).

7 For crossings of waterbodies, the following five dry-ditch crossing methods would be used for installation  
8 of the transmission line:

- 9 • *Attachment to a Bridge.* Where available and feasible, the transmission line would be affixed  
10 directly to an existing railroad bridge as it spans the waterbody.
- 11 • *Flume Crossing Method.* This method involves installing a flume pipe to carry the stream around  
12 the work area in an enclosed pipe, allowing the trenching to be done in a dry condition, limiting  
13 the amount of sediment that can enter the waterbody.
- 14 • *Dam and Pump Crossing Method.* For this method, the stream is dammed upstream of the work  
15 area and a pump and hose are used to transport the stream flow to bypass the trenching area to a  
16 point downstream where it would be discharged back to the streambed.
- 17 • *HDD.* Under this method, cable conduits would be installed under the streambed using HDD and  
18 avoiding any disturbance to the streambed, and the cables would then be pulled through the  
19 conduits.
- 20 • *Open Cut.* The open cut method of construction involves digging an open trench across the  
21 streambed, laying the cable, and backfilling the trenched area without diverting the stream around  
22 the work area.

23 The waterbody crossing methods would be determined based on the New York State Department of  
24 Public Service (NYSDPS) stream width classification, New York State Department of Environmental  
25 Conservation (NYSDEC) stream type classification, and conditions present during the time of  
26 construction; and would be in accordance with NYSDPS's *Environmental Management and Construction*  
27 *Standards and Practices for Underground Transmission and Distribution Facilities in New York State*  
28 (NYSPSC 2003).

29 In wetland areas, the cables would generally be installed by trenching. The typical sequence of activities  
30 would include vegetation clearing, installation of erosion controls, trenching, cable installation,  
31 backfilling, and ground surface restoration. Equipment mats or low-ground-pressure tracked vehicles  
32 would be used to minimize compaction and rutting impacts on wetland soils. To expedite revegetation of  
33 wetlands, the top 1 foot (0.3 meters) of wetland soil would be stripped from over the trench, retained, and  
34 subsequently spread back over and across the backfilled trench area to facilitate wetland regrowth by  
35 maintaining physical and chemical characteristics of the surface soil and preserving the native seed bank.  
36 Trench plugs or other methods would be used to prevent draining of wetlands or surface waters down into  
37 the trench.

38 The permanent ROW required for maintenance and operation of the transmission line along the terrestrial  
39 portions of the proposed CHPE Project route would be up to 20 feet (6.1 meters) for both railroad and  
40 roadway ROWs. The permanent ROW would provide protection of the transmission cables against  
41 third-party damage and would facilitate any required maintenance or repairs (TDI 2010).



### 1 2.5.3 Staging Areas

2 ***Aquatic Transmission Cable Support Facilities.*** For the portions of the proposed CHPE Project route  
3 where aquatic transmission cables would be installed, it is anticipated that minimal land-based support  
4 would be required. Transport of the aquatic transmission cables would occur via the cable-laying vessel,  
5 supported by resupply barges operated from a temporary storage area on land. This land-based support  
6 facility is expected to be no greater than 200 by 300 feet (61 by 91 meters), and would be at an existing  
7 port with heavy lift facilities, likely the Port of Albany or the Port of New York and New Jersey  
8 (CHPEI 2010b).

9 ***Terrestrial Transmission Cable Support Facilities.*** For the terrestrial portions of the proposed CHPE  
10 Project route where underground transmission cables would be installed, additional nearby temporary  
11 aboveground support facilities would be established. Support facilities could include contractor yards,  
12 storage areas, access roads, and additional workspace. Additional workspace might be required at HDD  
13 locations, cable jointing locations, and areas with steep slopes. The support facilities would be sited  
14 within the existing road and railroad ROWs (CHPEI 2010b).

### 15 2.5.4 Operations and Maintenance

16 The proposed CHPE Project has an expected life span of 40 years or more (CHPEI 2012c). During this  
17 period, it is expected that the transmission system would maintain an energy availability factor of  
18 95 percent, meaning that the transmission system would be delivering electricity 95 percent of the time,  
19 with the remaining 5 percent allocated for scheduled and unscheduled maintenance.

20 The HVDC and HVAC transmission cables would be designed to be relatively maintenance-free and  
21 operate within the specified working conditions. However, selected portions or aspects of the  
22 transmission system would be inspected to ensure equipment integrity is maintained (CHPEI 2010b).

23 ***ROW Maintenance.*** During operation of the proposed CHPE Project, vegetation clearing in the  
24 transmission line ROW would be performed on an as-needed basis. Vegetation management would  
25 include mowing, selective cutting to prevent the establishment of large trees (i.e., greater than 20 feet  
26 [6 meters] tall) directly over the transmission line, and vegetation clearing on an as-needed basis to  
27 conduct repairs.

28 ***Transmission Cable Repairs.*** While not anticipated, it is possible that over the lifespan of the proposed  
29 CHPE Project, the transmission cables could be damaged, either by human activity or natural processes.  
30 Before operation of the proposed CHPE Project begins, an Emergency Repair and Response Plan (ERRP)  
31 would be prepared to identify procedures and contractors necessary to perform maintenance and  
32 emergency repairs. The typical procedure for repair of a failure within the aquatic and terrestrial portions  
33 of the proposed CHPE Project route is described as follows:

- 34 • ***Aquatic Transmission Cable Repair.*** In the event of aquatic cable repair, the location of the  
35 problem would be identified and crews of qualified repair personnel would be dispatched to the  
36 work location. A portion of the transmission cable would be raised to the surface, the damaged  
37 portion of the cable cut, and a new cable section would be spliced in place by specialized jointing  
38 personnel. Once repairs were completed, the transmission cable would be reburied using a  
39 remotely operated vehicle jetting device (CHPEI 2010b).
- 40 • ***Terrestrial Transmission Cable Repair.*** In the event of terrestrial transmission cable repair,  
41 contractors would excavate around the location of the problem and along the transmission cable  
42 for the extent of cable to be repaired or replaced. Specialized jointing personnel would remove

1 the damaged cable and install new cable. Once complete, the transmission cable trench would be  
2 backfilled and the work area restored using the same methods described for the original  
3 installation (CHPEI 2010b).

4 **Transmission Service.** The maximum electrical power delivery capability for the proposed CHPE  
5 Project under normal conditions would be 1,000 MW. The ultimate maximum capacity would be  
6 determined during final design of the proposed CHPE Project. The estimated short-time (i.e., 2-hour)  
7 emergency overload capability would be approximately 1,150 MW for the transmission system  
8 (TDI 2010).

9 The New York Independent System Operator (NYISO) would be the controlling authority for the  
10 proposed CHPE Project and the operator of the system where the energy would originate, Hydro-Québec,  
11 would coordinate with the NYISO.

12 **Decommissioning.** The Applicant proposes to de-energize and abandon the proposed CHPE Project  
13 transmission line in place following expiration of its useful life. This proposed approach or any changes  
14 to the plan for decommissioning would be subject to applicable Federal and state regulations in place at  
15 that time.

### 3. EFH Species and FWCA Resources Designations in the ROI

#### 3.1 EFH Species Designations

The NOAA NMFS Web site, *Guide to Essential Fish Habitat Designations in the Northeastern United States*, and the complementary *Guide to Essential Fish Habitat Descriptions*, were used to determine which species have designated EFH in waterbodies associated with the proposed CHPE Project (NOAA 1998a, NOAA 1998b, NOAA 1998c). The NMFS guides present information on species with EFH in tabular format for 10 x 10 minute squares of latitude and longitude. For the proposed CHPE Project, squares 4040/7350 and 4040/7400 covering the ROI were analyzed to determine which species life stages had potential EFH within the ROI. NMFS also presents information on species with EFH in estuaries in a tabular format. For the proposed CHPE Project, the table covering the Hudson River/Raritan/Sandy Hook Bays in the New York/New Jersey area was used. Further, the written EFH designations on the NMFS Web site were used as the final determination for which species and life stages had EFH designated in the ROI.

Of the species with EFH identified in the previously described NMFS guides, cobia, Spanish mackerel, king mackerel, Atlantic mackerel, pollock, and sand tiger shark would not likely be found within the ROI for the proposed CHPE Project. The written EFH designations for these species include higher salinity regimes or other habitat parameters described as follows that do not occur within the ROI:

- EFH for coastal migratory pelagic fish species, including cobia, Spanish mackerel, and king mackerel, is designated as sandy shoals of capes, offshore bars with high profile rock bottoms, and barrier island oceanside waters from the surf zone to the shelf break. These types of habitats are not found within the ROI. Additionally, cobia EFH includes high-salinity (i.e., greater than 25 ppt) bays and bays and estuaries with seagrass habitats. These salinities and habitats do not occur within the proposed CHPE Project ROI.
- Atlantic mackerel prefer salinities greater than 25 ppt (NOAA 1998b, NOAA 2013). Because salinity levels in the proposed CHPE Project ROI do not exceed 25 ppt, EFH for these species would not generally be expected to occur within the Hudson, Harlem, or East rivers.
- The EFH designated for juvenile and adult pollock includes saline environments with salinity levels greater than 30 ppt and only occurs in Long Island Sound (NOAA 1998c). Because salinity levels in the proposed CHPE Project ROI do not exceed 25 ppt, EFH for these species would not generally be expected to occur within the Hudson, Harlem, or East rivers.
- The EFH description indicates that sand tiger shark juveniles and adults are not generally found north of Barnegat Inlet, New Jersey. Neonates could occur farther north; however, the closest they occur to the proposed CHPE Project area is the southeastern end of Long Island (NOAA 1998b, NOAA 2009). Therefore, EFH for sand tiger sharks is not designated in the CHPE Project ROI.

Because designated EFH for these species would not occur within the proposed CHPE Project ROI, they are excluded from further discussion in this assessment. **Table 3-1** presents the species and life stages with designated EFH in the ROI. These species are managed by the New England Fishery Management Council, Mid-Atlantic Fishery Management Council, and NMFS Highly Migratory Species Division.

The species with designated EFH in the ROI include benthic/demersal (bottom of the water column at the sediment) and pelagic (within the water column) species. These species, while predominantly marine, have one or more life stages that occur in the fresh or brackish waters of the Hudson River Estuary

1

**Table 3-1. Species with EFH in the ROI**

Species	Life Stage				
	Eggs	Larvae	Juveniles	Adults	Spawning Adults
Atlantic butterfish ( <i>Peprilus triacanthus</i> )		X	X	X	
Atlantic sea herring ( <i>Clupea harengus</i> )		X	X	X	
Black sea bass ( <i>Centropristus striata</i> )			X	X	
Bluefish ( <i>Pomatomus saltatrix</i> )			X	X	
Red hake ( <i>Urophycis chuss</i> )		X	X	X	
Scup ( <i>Stenotomus chrysops</i> )	X	X	X	X	X
Summer flounder ( <i>Paralichthys dentatus</i> )		X	X	X	
Winter flounder ( <i>Pleuronectes americanus</i> )	X	X	X	X	X
Windowpane flounder ( <i>Scophthalmus aquosus</i> )	X	X	X	X	X
Clearnose skate ( <i>Raja eglanteria</i> )			X	X	
Little skate ( <i>Leucoraja erinacea</i> )			X	X	
Winter skate ( <i>Leucoraja ocellata</i> )			X	X	

Sources: NOAA 1998a, NOAA 1998b, NOAA 1998c, NOAA 2014

2 (NOAA 1998c). EFH generally includes pelagic and demersal waters and benthic substrates. Some  
3 species are more structure-oriented and have EFH composed of artificial or natural reefs (e.g., existing  
4 infrastructure such as docks), sand/shell fragments, biogenic structures (e.g., algae-covered rocks), and  
5 aquatic vegetation. However, many species have soft-bottom EFH composed of sand or mud or a  
6 sand/mud mixture. **Table 3-2** provides a summary of the EFH types associated with fish with designated  
7 EFH in the ROI, along with the species and life stages associated with the habitat type. The habitat  
8 associations (e.g., salinity, temperature, depth, habitat type), time of occurrence, and relative abundance  
9 for each life stage of the 12 fish species that have EFH designated within the ROI are presented in  
10 **Table 3-3**.

11 Winter flounder could be particularly vulnerable to the impacts of the proposed CHPE Project. Sensitive  
12 life stages of this species tolerate wide salinity ranges, including 10 ppt to 30 ppt for eggs and 4 ppt to  
13 30 ppt for larvae (NOAA 1999h), and are expected to be found in the ROI. Winter flounder migrate into  
14 shallow water or estuaries and coastal ponds to spawn, and tagging studies show that most return  
15 repeatedly to the same spawning grounds (Lobell 1939, Saila 1961, Grove 1982). They typically spawn  
16 in the winter and early spring although the exact timing is temperature-dependent and thus varies with  
17 latitude (Able and Fahay 1998). Winter flounder have demersal eggs that sink and remain on the bottom  
18 until they hatch. Winter flounder eggs, once deposited on the substrate, are vulnerable to sedimentation  
19 with decreased hatching success of eggs observed when covered in as little as 0.04 inches (1 millimeter)  
20 of sediment and burial in sediments greater than 0.1 inch (2.5 millimeters) have been shown to cause no  
21 hatch (Berry et al. 2011). After hatching, the larvae are initially planktonic, but following metamorphosis  
22 they assume an epibenthic existence. Winter flounder larvae are negatively buoyant (NOAA 1999h), and  
23 are typically more abundant near the bottom (Able and Fahay 1998).

24

1 **Table 3-2. Summary of EFH Types and Associated Fish Species in the Hudson River Segment**

Specific EFH Type	Species	Life Stage	
<b>Substrate</b>			
Artificial and Natural Reefs and Shipwrecks	Black sea bass	A	
Rock, Pebbles, Gravel, and Shell Fragments	Winter flounder	E, J, A, SA	
Sand/Shell Fragment Mix	Black sea bass	J, A	
	Red hake	J	
Biogenic Structure: Algae-covered Rock, Aquatic Vegetation, Shell Beds, and Sponges	Black sea bass	J, A	
	Summer flounder	J	
Macrophytes/Aquatic Vegetation	Summer flounder	J, A	
	Scup	J	
Sand, Silt, and Mud	Red hake	A	
	Summer flounder	J	
	Windowpane flounder	J, A, SA	
	Winter flounder	E, J, A, SA	
	Clearnose skate	J, A	
	Little skate	J, A	
	Winter skate	J, A	
Rock and Gravel	Scup	J, A	
	Clearnose skate	J, A	
	Little skate	J, A	
	Winter skate	J, A	
	<b>Waters</b>		
	Demersal	Black sea bass	J, A
Summer flounder		J, A	
Winter flounder		L	
Scup		J, A	
Pelagic	Winter flounder	L	
	Atlantic butterfish	L, J, A	
	Atlantic sea herring	L, J, A	
	Bluefish	J, A	
	Windowpane flounder	L	
Surface	Scup	E, L	
	Red hake	L	
	Summer flounder	L	
Marsh Creeks	Windowpane flounder	E	
	Summer flounder	J	

Source: NOAA 1998c

Key: E = Eggs; L = Larvae; J = Juveniles; A = Adults; SA = Spawning Adults

Table 3-3. Designated EFH Descriptions and Associated Fish Species Occurrence within the ROI

Species	Life Stage	EFH Characteristics <sup>1,2,3,4,5</sup>				
		Salinity (ppt)	Temp (°F)	Depth (feet)	Habitat Type	Relative Abundance and Occurrence
Atlantic butterfish <sup>6</sup> ( <i>Peprilus triacanthus</i> )	Egg	25–33	53–73	30–4,000	ND	Not present
	Larvae	25–33	39–82	30–5,800	Pelagic waters; typically estuaries	Common: July–August Rare: September–November
	Juvenile	3–34.7	40–85	30–1,100	Pelagic waters	Common: May–November
	Adult	3.8–33	40–79	30–1,200	Pelagic waters	Common: May–November
	Spawning Adult	ND	> 59	ND	ND	ND
Atlantic sea herring <sup>7</sup> ( <i>Clupea harengus</i> )	Egg	ND	ND	ND	ND	Not present
	Larvae	32	< 61	160–300	Pelagic waters	Common: April–May Rare: June
	Juvenile	26–32	< 50	50–450	Pelagic waters and demersal habitats	Common: January–May Rare: June–December
	Adult	> 28	< 50	66–430	Pelagic waters and demersal habitats	Common: January–May Rare: June–December
	Spawning Adult	ND	ND	ND	ND	ND
Black sea bass <sup>8</sup> ( <i>Centropristus striata</i> )	Egg	ND	ND	ND	ND	ND
	Larvae	ND	52–79	100–160	ND	ND
	Juvenile	20–33	37–73	10–75	Demersal waters; Substrate with sand/shell fragment mix; biogenic structure*	Rare: April–November
	Adult	20–33	52–73	16–66	Demersal waters; Substrate with sand/shell fragment mix; biogenic structure*; artificial and natural reefs (including shipwrecks)	Rare: April–November
	Spawning Adult	ND	ND	ND	ND	ND

Species	Life Stage	EFH Characteristics <sup>1,2,3,4,5</sup>				
		Salinity (ppt)	Temp (°F)	Depth (feet)	Habitat Type	Relative Abundance and Occurrence
Bluefish <sup>9</sup> ( <i>Pomatomus saltatrix</i> )	Egg	ND	46–79	100–230	ND	ND
	Larvae	ND	63–79	100–230	ND	ND
	Juvenile	19–32	54–75	16–66	Pelagic waters	Abundant/Common: June–September
	Adult	29–36	46–68	3–330	Pelagic waters	Common: May–October
	Spawning Adult	ND	ND	ND	ND	ND
Red hake <sup>10</sup> ( <i>Urophycis chuss</i> )	Egg	> 30	41–50	ID	ND	Not present
	Larvae	> 0.5	< 66	< 660	Surface waters	ID
	Juvenile	31–33	< 60	< 330	Substrate of sand/shell fragment mix	Common: November -May Rare: June
	Adult	33–34	< 54	33–430	Substrate of sand, silt, and mud	Common: March-May Rare: November-February
	Spawning Adult	> 30	41–50	ND	ND	ND
Scup <sup>11</sup> ( <i>Stenotomus chrysops</i> )	Egg	> 15	55–73	< 98	Pelagic waters in estuaries	May–August
	Larvae	> 15	55–73	< 66	Pelagic waters in estuaries	May–September
	Juvenile	> 15	> 45	0–125	Demersal waters and inshore estuaries; Substrate of various sands, mud, mussel and eelgrass beds	Common: May–November Rare: November–April
	Adult	> 15	> 45	7–607	Demersal waters and inshore estuaries	Common: April–December
	Spawning Adult	15	48–75	< 98	Substrate from weedy to sandy	May–August

Species	Life Stage	EFH Characteristics <sup>1,2,3,4,5</sup>				
		Salinity (ppt)	Temp (°F)	Depth (feet)	Habitat Type	Relative Abundance and Occurrence
Summer flounder <sup>12</sup> ( <i>Paralichthys dentatus</i> )	Egg	ND	ND	ND	ND	ND
	Larvae	0.5–25	ID	100–750	Surface waters	Rare: April–June
	Juvenile	0.5–25	> 36	Shore to 1,600	Demersal waters, marsh creeks; Substrate with biogenic structure*, macrophytes and aquatic vegetation, sand, silt, and mud	Common: May–October Rare: November–December and March–April
	Adult	0.5–25		Shore to 1,600	Demersal waters; Substrate with macrophytes, and aquatic vegetation; all native species of macroalgae, seagrasses, and freshwater and tidal macrophytes in any size bed; and loose aggregations, within adult and juvenile summer flounder EFH	Common: May–October Rare: November–December and March–April
	Spawning Adult	ID	ID	ID	ND	Not present
Windowpane flounder <sup>13</sup> ( <i>Scophthalmus aquosus</i> )	Egg	< 25	< 68	< 230	Surface waters	Common: April–October
	Larvae	< 25	< 68	< 230	Pelagic waters	Common: April–November
	Juvenile	5.5–36	< 77	3–330	Substrate of sand, silt, and mud	Common: January–December
	Adult	5.5–36	< 80	3–250	Substrate of sand, silt, and mud	Common: January–December
	Spawning Adult	5.5–36	< 70	3–250	Substrate of sand, silt, and mud	ID
Winter flounder <sup>14</sup> ( <i>Pleuronectes americanus</i> )	Egg	10–30	< 50	< 300	Demersal waters; Substrate with rocks, pebbles, gravel, shell fragments, sand, silt, and mud	Abundant/Common: November–April
	Larvae	4–30	< 59	< 300	Pelagic and demersal waters	Abundant/Common: November–May Rare: June
	Juvenile	4–30	< 59	< 20	Demersal waters; Substrate with rocks, pebbles, gravel, shell fragments, sand, silt, and mud	Abundant/Common: January–December
	Adult	15–33	< 77	3–330	Demersal waters; Substrate with rocks, pebbles, gravel, shell fragments, sand, silt, and mud	Abundant/Common: January–June Rare: July–December
	Spawning Adult	5.5–36	< 59	< 260	Demersal waters; Substrate with rocks, pebbles, gravel, shell fragments, sand, silt, and mud	Abundant/Common: November–May



Species	Life Stage	EFH Characteristics <sup>1,2,3,4,5</sup>				
		Salinity (ppt)	Temp (°F)	Depth (feet)	Habitat Type	Relative Abundance and Occurrence
Clearnose skate <sup>15</sup> ( <i>Raja eglanteria</i> )	Egg	ND	ND	ND	ND	ND
	Larvae	22–30	45–75	16–46	ND	ND
	Juvenile	> 22	48–68	3–100	Demersal habitats with substrate of rock, gravel, silt and mud	Common: May–October Rare: April, November
	Adult	> 27	48–70	16–26	Demersal habitats with substrate of rock, gravel, silt and mud	Common: May–October Rare: April, November
	Spawning Adult	ND	ND	ND	ND	ND
Little skate <sup>16</sup> ( <i>Leucoraja erinacea</i> )	Egg	ND	> 45	ND	ND	ND
	Larvae	ND	ND	ND	ND	ND
	Juvenile	15–35	36–72	12–80	Demersal habitats with rocks, gravel, sand, silt, and mud	Relative abundance unknown; January–December
	Adult	15–35	36–72	12–80	Demersal habitats with rocks, gravel, sand, silt, and mud	Relative abundance unknown; January–December
	Spawning Adult	ND	ND	ND	ND	ND
Winter skate <sup>17</sup> ( <i>Leucoraja ocellata</i> )	Egg	ND	ND	ND	ND	ND
	Larvae	ND	ND	ND	ND	ND
	Juvenile	15–34	36–79	13–72	Demersal habitats with sand, gravel, or mud	Common
	Adult	30–35	36–66	3–1,000	Demersal habitats with sand, gravel, or mud	Not present
	Spawning Adult	30–35	36–66	3–1,000	ND	ND

Sources: (1) NOAA 1998b, (2) NOAA 1998c, (3) NOAA 2014, (4) NYSDEC 1986, (5) NMFS 2013, (6) NOAA 1999a, (7) NOAA 1999e, (8) NOAA 2007, (9) NOAA 2006a, (10) NOAA 1999b, (11) NOAA 1999g, (12) NOAA 1999c, (13) NOAA 1999f, (14) NOAA 1999d, (15) NOAA 2003a, (16) NOAA 2003b, (17) NOAA 2003c

Key: ID = insufficient data; ND = none designated

Note: \* = Biogenic structure is derived from biological material such as algae-covered rock, aquatic vegetation, shell beds, and sponges.

## 3.2 Fish and Wildlife Coordination Act Resource Designations

FWCA resources primarily consist of fish, shellfish and benthic communities, and submerged aquatic vegetation (SAV). These resources can be used by species with EFH in the ROI for food, shelter, or spawning.

### 3.2.1 Fish

Section 3.3.4 of the EIS for the proposed CHPE Project indicates that up to 128 fish species could occur in the Hudson River. Anadromous American shad (*Alosa sapidissima*), river herring, striped bass (*Morone saxatilis*), Atlantic sturgeon (*Acipenser oxyrinchus*), and catadromous American eel (*Anguilla rostrata*) have historically supported important commercial fisheries in the Hudson River (NYSDEC 2012). Life history characteristics of representative marine, diadromous, and freshwater species of the Hudson River are presented in Table H.2-3 in Appendix H of the EIS.

Section 3.4.4 of the EIS indicates that a variety of habitats in the Harlem and East rivers in the New York City Metropolitan Area Segment support marine, estuarine, anadromous, and catadromous fish. Despite the relatively low value of the East River as resident fish habitat, it serves as a major migratory route for some species from the Hudson River to the Long Island Sound. Winter flounder, scup (*Stenotomus chrysops*), bluefish, Atlantic silverside, striped killifish (*Fundulus majalis*), common killifish (*Fundulus heteroclitus*), striped bass, Atlantic tomcod, members of the herring family, and American eel are among the species seasonally present in the Harlem and East rivers (MTA 2004). Table H.2-3 in Appendix H of the EIS identifies the general spawning periods of marine and estuarine fish species in the Hudson River Estuary, which includes the Harlem and East rivers.

The proposed CHPE Project would intersect the following Significant Coastal Fish and Wildlife Habitats (SCFWHs) in the Hudson River:

- Catskill Creek (MPs 221 to 222)
- Esopus Estuary (MPs 234 to 235)
- Kingston-Poughkeepsie Deepwater Habitat (MPs 245 to 267 and MPs 268 to 270)
- Hudson Highlands (MPs 276 to 295)
- Lower Hudson Reach (MPs 317 to 325).

The shallow, subtidal beds of the Esopus Estuary SCFWH provide spawning, nursery, and feeding habitats for anadromous fish such as striped bass, American shad, and the semi-anadromous white perch (*Morone americana*); and for resident freshwater species, such as largemouth bass (*Micropterus salmoides*), brown bullhead (*Ameiurus nebulosus*), yellow perch (*Perca flavescens*), American eel, carp, and shiners (*Cyprinidae*). Kingston-Poughkeepsie Deepwater Habitat SCFWH supports anadromous fish such as alewife (*Alosa pseudoharengus*), American eel, American shad, blueback herring (*Alosa aestivalis*), and striped bass; estuarine fish such as fourspine stickleback (*Apeltes quadracus*), hogchoker (*Trinectes maculatus*), killifish (*Fundulus diaphanous*), threespine stickleback (*Gasterosteus aculeatus*), and white perch; and freshwater fish such as bluegill (*Lepomis macrochirus*), brown bullhead, common carp (*Cyprinus carpio*), golden shiner (*Notemigonus crysoleucas*), largemouth bass, pumpkinseed (*Lepomis gibbosus*), smallmouth bass (*Micropterus dolomieu*), spottail shiner (*Notropis hudsonius*), white catfish (*Ameiurus catus*), and yellow perch. The Hudson Highlands SCFWH provides striped bass spawning habitat with swift currents, rocky substrate, and freshwater inflow and has some of the highest striped bass egg abundance in the Hudson River Estuary. The Lower Hudson Reach SCFWH provides important wintering habitat for large numbers of young-of-year, yearling, and older striped bass between mid-November and mid-April, with the distinguishing feature being the salt front. Other estuarine/marine

1 fish that use the Lower Hudson Reach SCFWH include yearling winter flounder in winter months  
2 (generally from December to April); summer flounder; white perch; and marine fish such as Atlantic  
3 tomcod, Atlantic silversides, bay anchovy, hogchokers, and American eel in significant numbers. This  
4 area of the river could also be important for marine fish such as bluefish and weakfish young-of-year  
5 (NYSDOS 2014).

6 The transmission line is routed on land to avoid the Haverstraw SCFWH, which provides important  
7 habitat for freshwater, anadromous, estuarine, and marine fish. The SAV in Haverstraw Bay SCFWH  
8 provides food for fish, invertebrates, and waterfowl and refuge for fish and invertebrates. This SCFWH  
9 regularly composes a substantial part of the nursery area for anadromous and estuarine fish such as striped  
10 bass, American shad, white perch, Atlantic tomcod, and Atlantic sturgeon. It is also a major nursery and  
11 feeding area for marine species such as bay anchovy, Atlantic menhaden, and Atlantic blue crab  
12 (*Callinectes sapidus*). River herring spawn in upstream freshwater areas and move south and concentrate  
13 in Haverstraw Bay SCFWH before leaving the river in the fall (NYSDOS 2014).

14 Atlantic and shortnose sturgeon overwinter in Haverstraw Bay. Adult Atlantic tomcod, bluefish,  
15 fourspine stickleback, hogchoker, killifish, rainbow smelt, Atlantic silverside, summer flounder,  
16 threespine stickleback, white perch, common carp, American eel, and white catfish are also found in this  
17 area (NYSDOS 2014).

### 18 3.2.2 Shellfish and Benthic Communities

19 Benthic community structure and population density are dependent on factors including water quality,  
20 sediment type, the presence or absence of SAV, and human alterations. Benthic communities vary in  
21 distribution in the Hudson River depending on bottom type (i.e., hard or soft substrate), salinity, SAV,  
22 and location along the river.

23 Broad-scale sediment type data from the NYSDEC Hudson River Estuary Program indicate that the  
24 sediments along the transmission line route primarily consist of sand, sandy mud, muddy sand, and mud.  
25 The transmission line occasionally crosses or travels near areas of sandy gravel, gravelly sand, or gravelly  
26 mud. There are a couple of locations where the transmission line crosses gravel or travels near gravel.  
27 These areas are near MP 269 (Hudson River mile 67) and MP 310 (Hudson River mile 27). The sediment  
28 type interpretation is based on the grain size analysis of the cores and grabs with some guidance from the  
29 backscatter data. The sediment profile imagery data has also been used to supplement these  
30 interpretations. These data represent general trends and are not meant for finescale interpretation (Bell et  
31 al. 2006).

32 The primary purpose of sediment cores sampled during the marine survey conducted for the proposed  
33 CHPE Project in 2010 was for geotechnical and chemical characterization of sediments along the route.  
34 These cores indicate that surficial sediments (0 to 63 inches [0 to 160 cm] from the sediment surface)  
35 along the cable route consists primarily unconsolidated sediments, including the following:

- 36 • A range from well-mixed sand and gravel with cobbles to soft silt/clay (Coxsackie Landing [north  
37 of the transmission line route] to Kingston)
- 38 • Predominantly soft unconsolidated silts with one core with cobble and gravel in a silt/clay matrix  
39 (Kingston to Peekskill)
- 40 • Soft silts and clays with occasional lenses of fine shell hash (Peekskill to Spuyten Duyvil)  
41 (CHPEI 2012).

1 The sediments in the Harlem River were characterized as gray to black sands and silts with trace clay and  
2 organics (CHPEI 2012I). Although these data can provide a qualitative characterization of surficial  
3 sediments, they cannot be used for a quantitative analysis.

4 The benthic macroinvertebrates in the Hudson River Segment form a diverse community that includes  
5 approximately 300 species of annelids, mollusks, crustaceans, and insects. However, the benthic  
6 community has been subject to pollution and human alterations over the past 200 years (Levinton and  
7 Waldman 2012). Shellfish data are not available for the entire proposed CHPE Project route in the  
8 Hudson River, but limited data are available for three discrete areas. Available shellfish information  
9 indicates that zebra mussel beds occur sporadically between approximate MP 232 to MP 246 (NYSDEC  
10 2014a). No shellfish beds have been recorded between approximately MP 261 and MP 281 (NYSDEC  
11 2014a). Oyster beds occur from near Ossining at MP 305 to south of the Tappan Zee Bridge near MP 310  
12 (NYSDEC 2014a, AECOM 2011). Section 3.3.4 of the EIS provides additional detail on the shellfish and  
13 benthic communities within the ROI in the Hudson River Segment.

14 The majority of benthic invertebrate species found in the disturbed habitats of the Harlem and East rivers  
15 in the New York City Metropolitan Area Segment are tolerant of highly variable conditions. Biological  
16 surveys of these areas have found the benthic community to be composed of both suspension and deposit  
17 feeders, including polychaetes, crustaceans, and bivalves (Levinton and Waldman 2012). Section 3.4.4 of  
18 the EIS provides additional detail on the shellfish and benthic communities within the ROI in the New  
19 York Metropolitan Area Segment.

### 20 3.2.3 Submerged Aquatic Vegetation

21 Two predominant species of SAV in the Hudson River Segment are the native water celery (*Vallisneria*  
22 *americana*) and the exotic water chestnut (*Trapa natans*). Due to light penetration limits, plants are  
23 generally found in water shallower than 10 feet (3 meters), although beds can be deeper in upriver  
24 sections. Other native species of SAV in the Hudson River include the clasping leaved pondweed  
25 (*Potamogeton perfoliatus*) and slender naiad (*Najas flexilis*). In addition to the water chestnut, other  
26 nonnative species include curly pondweed (*Potamogeton crispus*) and Eurasian watermilfoil  
27 (*Myriophyllum spicatum*) (Findlay et al. 2006, NYSDEC 2013). Mapped *Vallisneria* sp. and *Trapa* sp.  
28 are presented in **Attachment 1**. Section 3.3.4 of the EIS provides additional detail on SAV within the  
29 ROI in the Hudson River Segment.

30 The aquatic vegetation in the Harlem and East rivers in the New York City Metropolitan Area Segment is  
31 tolerant of highly variable and harsh conditions. Freshwater and marine phytoplankton are the dominant  
32 primary producers in these waterbodies. Diatoms are generally the dominant group of phytoplankton.  
33 Residence times of phytoplankton species within New York Harbor are short and individuals move  
34 quickly through the system. While SAV is not typically found in these waterbodies, macroalgae do occur  
35 on hard surfaces and sandy or muddy bottoms (MTA 2004).

## 4. Assessment of Potential Effects

As indicated in **Section 2.2**, the EFH that occurs within the Hudson River and New York City Metropolitan Area segments of the proposed CHPE Project is nearly identical and supports nearly identical species groups. Additionally, effects on EFH species would be similar, if not identical, to effects on other resources covered under FWCA. Therefore, this assessment of direct, indirect, and cumulative effects on EFH and other resources is not differentiated in the following analysis. Effects on EFH could result from construction, operation, and maintenance activities associated with the proposed CHPE Project. These effects are discussed in the following subsections and summarized in **Table 4-1**. No effects on EFH would be expected from decommissioning of the transmission line. The line would be de-energized and abandoned in place, which would not result in any sediment disturbance or other effects on EFH.

### 4.1 Effects from Construction

**Introduction.** During transmission line installation activities in the Hudson, Harlem, and East rivers, vessel operation, and transmission cable installation would result in a temporary disturbance in the water column and substrates from direct bottom disturbance; increased turbidity and associated water quality degradation, lights, noise, and vibrations; and the potential for release of hazardous materials. Sediment disturbance would primarily affect sand, silt, and mud, which serve as EFH for various life stages of red hake, summer flounder, windowpane flounder, winter flounder, scup, clearnose skate, and little skate (see **Table 3-2**). Increased turbidity, noise and vibration, lights, and any release of contaminated materials would affect the water column, designated as EFH for different life stages of various surface water, pelagic, and demersal species, including the black sea bass, summer flounder, winter flounder, Atlantic butterfish, Atlantic sea herring, bluefish, scup, windowpane flounder, and red hake. Forage species for EFH species would be expected to experience similar water column effects. Effects on EFH are expected to be temporary and localized. Fish are expected to move away from the disturbance and would return to the area once the disturbance has ended, minimizing any potential impacts.

As detailed in Sections 5.3.4 and 5.4.4 of the EIS for the proposed CHPE Project, installation of the aquatic transmission line during the spawning season could have a greater impact on fish because it could affect several sensitive life stages, including spawning adults, eggs, and larvae. Impacts could include a behavioral disruption (i.e., interruption or obstruction) of the migration and spawning of adult fish, or physical effects of turbidity on eggs and larvae. However, based on the proposed CHPE Project aquatic construction schedule for the Hudson River Segment (see **Table 2-2**), impacts on most spawning fish and the eggs and larval stages, including the anadromous fish, would be avoided (see Table H.2-3 in Appendix H of the EIS for fish spawning seasons). There is overlap with parts of the spawning seasons for some forage fish such as bay anchovies, killifish, sticklebacks, and sheepshead minnows, and young-of-year for some commercially or recreationally important fish such as Atlantic menhaden and weakfish. The construction window required by the NYSPSC Certificate for the proposed CHPE Project is from May 15 through November 30 in the Harlem and East rivers (CHPEI 2012g, NYSPSC 2013). However, construction activities would be avoided in the Harlem River from December 1 through May 31 (CHPEI 2014a). Restricting construction to this timeframe would avoid impacts on spawning winter flounder, eggs, and larvae. In cases where there is some overlap of spawning and installation activities, impacts are not expected to be significant. Installation activities in any single area would occur over a short period of time, as the cable installation would advance at an average rate of 1.5 miles (2.4 km) per day. The proposed CHPE Project construction corridor, which is 50 feet wide, is approximately 0.9 percent of the total area of the Hudson, Harlem, and East rivers in the vicinity of the proposed CHPE Project. Because available spawning habitat for these species is widespread and the proposed CHPE

1

**Table 4-1. Summary of the Effects of the Proposed CHPE Project on EFH**

Effect	EFH Type	
	Water Column	Sediments (includes sand, silt, mud; sand/shell fragment mix; and sandy shoals in the ROI)
<b>Proposed CHPE Project Construction and Potential Emergency Repairs</b>		
Riverbed disturbance	<ul style="list-style-type: none"> <li>◆ N/A</li> </ul>	<ul style="list-style-type: none"> <li>◆ Alteration of habitat from installation of concrete mats</li> <li>◆ Disruption of habitat features, such as burrows, depressions, and sand waves.</li> <li>◆ Redeposition of sediments</li> </ul>
Sediment resuspension and turbidity	<ul style="list-style-type: none"> <li>◆ Temporary avoidance of turbidity plumes by EFH species (i.e., juvenile, adult, and spawning adult life stages) and forage species</li> <li>◆ Potential for resuspending contaminated sediments</li> </ul>	<ul style="list-style-type: none"> <li>◆ Temporary reductions in benthic food sources</li> <li>◆ Potential for resuspending contaminated sediments</li> </ul>
Spills	<ul style="list-style-type: none"> <li>◆ Decreased water quality</li> <li>◆ Temporary avoidance of contaminated area</li> <li>◆ Temporary introduction of contaminants into the water column</li> </ul>	<ul style="list-style-type: none"> <li>◆ Temporary reduction in benthic food sources</li> <li>◆ Introduction of contaminants to benthic habitat</li> </ul>
Noise	<ul style="list-style-type: none"> <li>◆ Temporary increase in the underwater noise environment and vibrations from construction vessel operation</li> <li>◆ Temporary displacement of EFH species sensitive to noise vibrations (i.e., juvenile, adult, and spawning adult life stages)</li> </ul>	<ul style="list-style-type: none"> <li>◆ N/A</li> </ul>
Blasting	<ul style="list-style-type: none"> <li>◆ Temporary displacement of EFH species</li> <li>◆ Potential for resuspending contaminated sediments</li> </ul>	<ul style="list-style-type: none"> <li>◆ Disruption of habitat features, such as burrows, depressions, and sand waves.</li> <li>◆ Redeposition of sediments</li> </ul>
Vessel strikes	<ul style="list-style-type: none"> <li>◆ Temporary displacement of EFH species within 12 feet (4 meters) of the water surface; expected low chance of vessel-related mortalities</li> </ul>	<ul style="list-style-type: none"> <li>◆ N/A</li> </ul>
Lighting	<ul style="list-style-type: none"> <li>◆ Temporary attraction to vessel lighting and associated increase in predation events</li> </ul>	<ul style="list-style-type: none"> <li>◆ N/A</li> </ul>



Effect	EFH Type	
	Water Column	Sediments (includes sand, silt, mud; sand/shell fragment mix; and sandy shoals in the ROI)
<b>Proposed CHPE Project Operations</b>		
Magnetic and induced electric fields	◆ Minimal effects on EFH species in immediate vicinity of the transmission line from magnetic and induced electric fields	◆ N/A
Heat	◆ Minimal effects on EFH species from increased temperatures	◆ N/A
Decommissioning	◆ No impact	◆ No impact

Key: N/A = Not applicable.

1 Project construction corridor is small, the effects of turbidity are expected to be temporary and localized  
 2 and would not occur throughout spawning habitat for the entire spawning season. These effects would  
 3 not cause spawning failure or decrease a species' ability to survive.

4 SAV is designated as habitat area of particular concern (HAPC) for juvenile summer flounder. SAV  
 5 would be avoided by the proposed CHPE Project (see **Attachment 1**). SAV is generally found in water  
 6 depths of less than 10 feet (3 meters), and the transmission line would generally be installed in deeper  
 7 waters (i.e., greater than 20 feet [6 meters]). Therefore, impacts such as the uprooting and crushing of  
 8 SAV would be avoided. As detailed in Sections 5.3.4 and 5.4.4 of the EIS, impacts on SAV and  
 9 macroalgae could occur from riverbed disturbance, turbidity, and sediment redeposition. These impacts  
 10 would not be significant because the transmission line would not traverse any existing mapped SAV beds  
 11 (NYSDEC 2014b). Little, if any, SAV is present in the Harlem and East rivers; however, macroalgae  
 12 does exist in the area. Because the Harlem and East rivers within the New York City Metropolitan Area  
 13 Segment are already exposed to harsh and variable conditions, impacts are not expected to be significant.  
 14 Any impacted SAV beds would be expected to regrow once construction activities have ceased.

15 Shellfish and benthic invertebrates can provide structure and forage for fish with EFH designated in the  
 16 ROI. Impacts on shellfish and benthic communities could occur from riverbed disturbance and the  
 17 resulting turbidity and sediment redeposition. However, benthic communities in the Hudson River are  
 18 already adapted to human disturbances and other impacts such as degraded water quality, dredging,  
 19 shoreline hardening, and invasive species. Functional communities would be expected to recolonize these  
 20 areas over time. Recovery times for the benthic communities vary from several months to several years  
 21 depending on the community composition and severity and frequency of disturbance (Newell et al. 2004,  
 22 Carter et al. 2008). Construction is expected to occur at MPs 228 through 295 (crossing the Catskill  
 23 Creek, Esopus Estuary, Kingston-Poughkeepsie Deepwater Habitat, and Hudson Highlands SCFWHs)  
 24 from August 1 through November 30 to avoid impacts on overwintering, spawning migrations, spawning  
 25 activity, and larval stages of ESA-listed fish species. Construction is expected to occur at MPs 303  
 26 through 324 (crossing the Lower Hudson Reach SCFWH) from July 1 through October 31. The Lower  
 27 Hudson Reach SCFWH provides important habitat for striped bass from November through April, winter  
 28 flounder spawning from December through April, and overwintering striped bass and winter flounder.  
 29 Impacts would be avoided during that time period. The transmission line is routed on land to avoid the  
 30 Haverstraw Bay SCFWH, which provides valuable habitat for juvenile and adult freshwater, anadromous,  
 31 estuarine, and marine species.

1 **Riverbed Disturbance.** Aquatic installation would occur via jet plow in all locations in the Hudson River  
2 and New York City Metropolitan Area segments, except where HDD is used to cross the East River and  
3 at water-to-land transitions, where the transmission line is laid on the surface over bedrock or utility line  
4 crossings and covered with concrete mats (for a total of 2.4 miles [3.9 km] in the Hudson and Harlem  
5 rivers), and in the Harlem River where a 460-foot (140-meter) trench would be blasted at MP 324.5.

6 Debris removal and installation activities would primarily disturb soft benthic sediments, including silts,  
7 clays, and sands. There could be some areas with mixed sand and gravel or silt and clay with cobbles, or  
8 shell hash mixed with silt and clay, although these areas are not expected to be common (CHPEI 2012i).  
9 Additionally, concrete mats would cover the transmission line in approximately 10 locations in the  
10 Hudson River where bedrock is exposed and approximately 65 locations in the Hudson River and 26  
11 locations in the Harlem River over soft sediments as a protective covering for existing utilities (CHPEI  
12 2012a).

13 Debris removal would occur in the Fall preceding installation activities the next year. During the initial  
14 phase of debris removal, the riverbed would be disturbed less than during installation activities. If plow  
15 pre-rip is also required and the jet plow is used, impacts would be similar to water jetting, with a similar  
16 or smaller impact corridor. Depending on the debris found, it is expected that the total riverbed area  
17 disturbed would be a maximum of 15 feet (5 meters) wide along the 94-mile (151-km) portion of the  
18 transmission line corridor in the Hudson and Harlem rivers, for a maximum total 171 acres (69 hectares).  
19 Along most of the route, it is likely that little or no large debris would be found and the disturbance would  
20 be limited to the 3-foot (0.9-meter) grapnel penetration, which would be much narrower than 15 feet.  
21 Assuming a disturbance width of 5 feet (1.5 meters), this equates to 57 acres (23 hectares). This would all  
22 occur within the area to be disturbed by actual transmission line installation within the following year. A  
23 similar number or fewer vessels would be used during debris removal as would be used during  
24 installation.

25 Installation activities could also result in the disruption of transient habitat features such as burrows,  
26 depressions, and sand waves and the potential displacement of EFH species at various life stages  
27 (e.g., egg, larval, juvenile, adult, and spawning adult). SAV would be avoided (see **Attachment 1**). SAV  
28 is generally found in water depths of less than 10 feet (3 meters) and the transmission line would  
29 generally be installed in deeper waters. Shellfish data are not available for the entire route in the Hudson  
30 River. Zebra mussel beds occur sporadically between approximate MP 232 to MP 246 (NYSDEC  
31 2014a). To avoid the spread of zebra mussels farther in the Hudson River, the Applicant would train and  
32 educate transmission system contractors and subcontractors to identify aquatic invasive species, and site-  
33 specific prescriptions for preventing or controlling their transport throughout or off of the proposed CHPE  
34 Project site. There are no shellfish beds from approximate MPs 261 to 281. The transmission line route  
35 is expected to avoid oyster beds documented from Ossining at MP 305 to south of the Tappan Zee Bridge  
36 near MP 310. Rock and hard bottom would be avoided whenever possible.

37 The approximately 94-mile (151-km) portion of the aquatic transmission line route within the Hudson and  
38 Harlem rivers would be installed and buried using water-jetting techniques. Jet plow activities would  
39 directly affect an area of approximately 25 feet (7.6 meters) on each side of the transmission line (for a  
40 50-foot [15-meter] construction corridor) during cable installation. The total area affected by jet plowing  
41 would be approximately 569 acres (230 hectares), including 533 acres (216 hectares) in the Hudson River  
42 and 36 acres (15 hectares) in the Harlem River. This area includes settlement zones where the majority of  
43 the sediment disturbed by installation of the transmission line would settle. Depressions in the river  
44 bottom over the installed cable are anticipated after installation, but the bathymetry is expected to return  
45 to pre-installation conditions through natural redeposition of the disturbed material into the trench  
46 depression within 3 years (CHPEI 2012c, Newell et al. 1998).

1 Barge positioning, anchoring, anchor cable sweep, and the pontoons on the jet plow could result in  
2 additional riverbed disturbance. Vessel positioning and anchorage during installation of the transmission  
3 line can be used in the event that bottom conditions are encountered that either stop forward progress at  
4 reasonable tow tension or result in excessive rolling or pitching of the jet plow. In such a case, the barge  
5 would be stopped, anchors deployed to hold the barge in position, and obstructions investigated and  
6 remedied. Anchors would also be employed during cable splicing and idle periods due to weather  
7 conditions. Open water anchorages are not envisioned as a common event. Areas where anchorage is  
8 also anticipated include construction of the four temporary water-to-land transition cofferdams in the  
9 Hudson and Harlem rivers, and possibly along the 460-foot (140-meter) length of bedrock trenching in  
10 the Harlem River (MP 324.5). The collective length of all work areas where anchors might be deployed  
11 and potentially result in impacts on benthic habitat is projected to be less than 1 percent of the  
12 approximately 94-mile (151-km) portion of the aquatic transmission line route in the Hudson and Harlem  
13 rivers. The anchors would have a total impact area of approximately 15 square feet (1.4 square meters)  
14 per deployment. Anchors require approximately 200 square feet (18 square meters) (20 feet [6 meters] by  
15 10 feet [3 meters]) to dig in and stabilize. For four anchors, that is a total of 800 square feet (72 square  
16 meters) or 0.02 acres (0.01 hectare). Midline buoys would be used to prevent anchor chain sweeps that  
17 might otherwise affect benthic habitat. Therefore, the total benthic habitat area of Hudson and Harlem  
18 rivers affected by anchorage during cable installation would be small, and the impacts would be  
19 temporary.

20 Recovery rates of benthic macroinvertebrate communities following dredging range from a few weeks or  
21 months to a few years, depending upon the type of bottom material, the physical characteristics of the  
22 environment, and the timing of disturbance (Hirsch et al. 1978, LaSalle et al. 1991). In a 2-year study in  
23 the lower Hudson River, Bain et al. (2006) (as cited in NMFS 2014) reported that within a few months  
24 following dredging, the fish and benthic communities at a dredged location were no different from seven  
25 nearby sites that had not been dredged, and that there were no indications of a lasting effect at the dredged  
26 site.

27 Where appropriate, concrete mats would be installed to help protect the transmission line in areas with  
28 bedrock at or near the surface and over existing submerged infrastructure lines for approximately  
29 1.8 miles (2.9 km) and 1.7 acres (0.7 hectares) of the 88-mile (151-km) aquatic portion of the project  
30 route in the Hudson River, and 0.6 miles (1.0 km) and 0.6 acres (0.2 hectare) of the 6-mile (10-km)  
31 aquatic portion in the Harlem River. This represents approximately 2.6 percent of the aquatic portion of  
32 the transmission line route in the Hudson and Harlem rivers and an even smaller proportion of the habitat.  
33 The transmission line would be installed under the East River via HDD. Of the total to be installed in the  
34 Hudson River, approximately 1.0 miles (1.6 km) and 1.0 acres (0.4 hectares) of concrete mats would be  
35 installed as protective covering for the transmission line in SCFWHs, or less than 0.01 percent of the total  
36 acreage of the affected SCFWHs. SCFWHs that would be affected are the Kingston-Poughkeepsie  
37 Deepwater, Hudson Highlands, and Lower Hudson Reach SCFWHs. The transmission line is routed on  
38 land to avoid the Haverstraw Bay SCFWH, which provides valuable habitat for juvenile and adult  
39 freshwater, anadromous, estuarine, and marine species.

40 The majority of these areas are associated with existing infrastructure areas. Other areas not suitable for  
41 cable burial are generally associated with rock outcroppings. The Applicant is committed to burying the  
42 cable where possible, as burial provides the greatest protection against interactions with vessels  
43 (e.g., anchor drops or snags). Physical surveys, including diver surveys of each utility, would be  
44 performed and possibly reduce this estimate. Rock outcroppings would be avoided wherever possible. In  
45 the case of the Harlem River, designated cable and pipeline areas extend over substantial areas or occur  
46 frequently along the length of the river, so that the placement of protection over the exposed transmission  
47 line can be continuous over several adjacent infrastructure elements. The detailed design developed as  
48 part of the Environmental Management and Construction Plan (EM&CP) developed for the proposed

1 CHPE Project would optimize the placement of protection to minimize the area of the bottom covered by  
2 concrete mats (CHPEI 2012j).

3 Hard-bottom habitat is not common within the ROI. Installation of concrete mats could alter EFH if the  
4 concrete mats replace soft sediment. The concrete mats would extend 9 inches (23 cm) above the river  
5 bottom. Placement of concrete mats over soft sediments would bury the benthic communities that  
6 directly underlie them, including potential prey of fish species with designated EFH in the area. The mats  
7 could also alter local hydrodynamic conditions such that some sediment deposition or scouring could  
8 occur around the mats. However, the overall change in bathymetry would be minimal relative to the  
9 available soft-bottom habitat in the Hudson and Harlem rivers and the SCFWHs that occur there, and  
10 adjacent habitat would still be available. When the concrete mats are placed in areas of fine sediment, the  
11 spaces between the individual concrete elements would be filled by suspended sediment and the surficial  
12 habitat would be partially restored. New and functional communities would be expected to recolonize  
13 these areas over time. As noted, recovery times for the benthic communities vary from several months to  
14 several years depending on the community composition and severity and frequency of disturbance  
15 (Newell et al. 2004, Carter et al. 2008). Post-installation monitoring efforts for the Long Island  
16 Replacement Cable in 2010 suggested that concrete mats were not a major disturbance to benthic  
17 communities after 2 years (ESS Group 2011).

18 The type of organisms recolonizing over the mats could differ from the original benthic community if  
19 portions of the original substrate were soft sediment. In some locations, protective mats would only be  
20 used in areas where the existing substrate consists of hard bottom, and the communities recolonizing the  
21 new hard bottom created by the mats would be expected to be similar to what had occurred previously.  
22 Post-installation monitoring efforts conducted for the Long Island Replacement Cable in 2010  
23 (construction completed in fall 2008) suggested that concrete mats were not a major disturbance to  
24 benthic communities. The 2010 monitoring revealed that benthic macroinvertebrate assemblages did not  
25 differ significantly in overall abundance, species richness, or community composition between the control  
26 and the concrete mats. This report did not indicate any observations of invasive species, with the  
27 exception of a naturalized macroalgae that was observed in control and impacted sites. No major  
28 seasonal differences in the macroinvertebrate communities were observed (ESS Group 2011). Further,  
29 because impacts from installation of concrete mats are expected to be small and localized, and the  
30 materials to be used (concrete blocks and cables or synthetic ropes) would not promote the introduction of  
31 invasive species any more than other species, significant changes to the benthic community's species  
32 composition would not be expected. The placement of the rip-rap or concrete mats would be very limited  
33 and generally sporadic and, therefore, would not significantly affect foraging or migration (Scenic  
34 Hudson and Riverkeeper 2013). In areas where use of concrete mats or rip-rap could extend some  
35 distance, the width of the armoring would only extend over a small area (approximately 8 feet  
36 [2.4 meters] in width), leaving ample undisturbed foraging habitat available on either side of the  
37 armoring. Species occurring in these affected areas would be able to use adjacent areas for foraging and  
38 other activities. Because the area where the mats would be placed is small (2.6 percent) of the  
39 transmission line route in the Hudson and Harlem rivers, the impact on habitat would be negligible.

40 Riverbed disturbance would also include the redeposition of suspended sediment. The estimated  
41 thickness of the sediment as it settles back to the riverbed would never exceed 0.4 inches (10 millimeters).  
42 Over the 94 miles (151 km) of the Hudson and Harlem rivers that would be plowed during installation of  
43 the transmission line, approximately 32 acres (13 hectares) would accumulate 0.2 inches (5 millimeters)  
44 or greater in sediment depth. The majority of the sediment redeposition would occur in the 569-acre  
45 (230-hectare) area that would be disturbed by the jet plow (CHPEI 2014b). The effects of increased  
46 sedimentation in the habitat could include reduced water quality, reduced ability to locate food, decreased  
47 gas exchange, toxicity to aerobic species, reduced light intensity in the water column, physical abrasion,  
48 and smothering of benthic and demersal species present at the time of the activity (Wilber et al. 2005).

1 Additionally, some fish species (e.g., clearnose skate and winter flounder) deposit demersal eggs that  
2 remain on the bottom until larval hatching, and some of these eggs could be smothered as well.  
3 Redeposition of sediments causes larval mortality by clogging gill tissues and through gill abrasion  
4 (Reine et al. 1998). Previous experiments have shown that a viable hatch of winter flounder eggs is  
5 reduced when the eggs are buried by as little as one half of one egg diameter, approximately 0.02 inches  
6 (0.5 millimeters) of sediment (Berry et al. 2003, USFWS 2002). However, EFH for winter flounder eggs  
7 is in waters with salinities that from 10 to 30 ppt, impacts would only be expected south of the Tappan  
8 Zee Bridge (i.e., near MP 310). The area of impact from sediment redeposition in the lower Hudson  
9 River and the Harlem River is approximately 7 acres (3 hectares), representing approximately 21 percent  
10 of the transmission line installation route in these rivers. However, construction activities would be  
11 conducted in the lower Hudson River from July 1 to October 31 and in the Harlem River from May 31  
12 through November 30. Restricting construction to this timeframe would generally avoid impacts on  
13 spawning winter flounder, eggs, and larvae.

14 Redeposition of sediments could also change the bottom composition of the riverbed if existing coarser  
15 grains lie on top of finer grains. The layering could be reversed after sediments are disturbed because  
16 finer grains take longer to settle out of the water column. Such a change would affect the species  
17 composition of the benthic community, and locally would be composed of those that could thrive in this  
18 sediment. Mobile species that prefer coarser sediment grains would likely relocate to areas with coarser  
19 grains. Sessile (immobile) species would likely die off locally if they could not adapt to the new sediment  
20 conditions (Germano and Cary 2005). However, this effect is expected to be localized and the affected  
21 area would be minimal relative to the available habitat.

22 ***Sediment Resuspension and Turbidity.*** Installation of the aquatic transmission line would increase  
23 turbidity temporarily in the water column as a result of sediment disturbance and resuspension. This  
24 could also disturb previously settled contaminants. Depending on the sediment particle-size composition,  
25 the majority (approximately 70 to 80 percent) of the disturbed sediment would be expected to remain  
26 within the limits of the trench under limited water movement conditions, with 20 to 30 percent of  
27 suspended sediment traveling outside the footprint of the area directly impacted by the plow. With higher  
28 currents, more sediment can be transported outside the trench area (HTP 2008, MMS 2009, CHPEI  
29 2012m). Water quality modeling indicates that, on average, the initial sediment plume would be  
30 approximately 1 mile (1.6 km) long and 500 feet (152 meters) wide (an area of about 60 acres  
31 [24 hectares]). The maximum suspended sediment concentrations would range from 80 to 200 milligrams  
32 per liter (mg/L) range above background (depending on sediment properties) in the water column  
33 immediately above the sediment bed where the jet plow would be operating. The plume concentrations  
34 would be highest near the river bottom. At the surface, concentrations would be approximately one-tenth  
35 of the bottom values. The discernible plume width at the bottom would be approximately 500 feet  
36 (152 meters) wide. Because maximum concentrations are expected to be 200 mg/L, installation is not  
37 expected to exceed 200 mg/L above background at the edge of the 500-foot (152-meter) mixing zone, as  
38 required by the CWA Section 401 Water Quality Certification issued for the proposed CHPE Project  
39 (NYSDPS 2013). At approximately 4,500 feet (1,372 meters) downstream, which is near the edge of the  
40 discernible plume, the maximum concentration would be 10 mg/L above background condition and by  
41 approximately 1 mile (1.6 km) downstream the concentrations would be back to background.

42 Total suspended solids (TSS) would be elevated by 15 mg/L for approximately 9 hours, based on the  
43 assumption of 24-hour-per-day installation operations. However, if installation activities cease for longer  
44 than 2 hours, the plume would dissipate before operations would be restarted. Plumes would be  
45 continually affected by tidal action; over the course of a tidal cycle, they would reverse direction.

46 Reduced jetting speeds (e.g., 4 knots) would be used to reduce turbidity when crossing sensitive areas  
47 such as SCFWs. The most appropriate speeds would be coordinated with the construction contractor.

1 The construction contractor would consider existing sediment conditions, cable weight, and multiple other  
2 factors to arrive at an installation speed that allows for a reduction in impacts and safe and efficient cable  
3 installation. Reductions in TSS would be calculated after the installation specifications have been set as  
4 part of the construction design. Furthermore, the transmission line is routed on land to avoid the  
5 Haverstraw Bay SCFWH, which provides valuable habitat for juvenile and adult freshwater, anadromous,  
6 estuarine, and marine species.

7 The Applicant has developed and would implement a Water Quality Monitoring Plan for the installation  
8 of the proposed CHPE Project transmission line. If TSS concentrations exceed 200 mg/L beyond the  
9 500-foot (152-meter) mixing zone, the Applicant would employ one or more of the following measures:  
10 changing the rate of advancement of the jet plow, modifying hydraulic pressures, or implementing other  
11 reasonable operational controls to reduce suspended sediments.

12 Turbidity associated with anchors and the installation of sheet pile is expected to be similar. Turbidity  
13 levels during these activities would be expected to be less than 50 mg/L above background, diminishing  
14 to 5 to 10 mg/L above background within a few hundred feet (CHPEI 2014b).

15 An environmental bucket, a variation of the conventional clamshell dredge bucket that has been  
16 developed to limit spillage and leakage of dredged material, would be used for the dredging associated  
17 with the cofferdams. The enclosed dredge bucket features covers designed to prevent material from  
18 spilling out of the bucket while it is raised through the water column. The design also employs rubber  
19 gaskets or tongue-in-groove joints that reduce leakage through the bottom of the closed bucket.  
20 Environmental buckets were used for the two dredges used for 91 days of dredging associated with the  
21 Tappan Zee Bridge construction. None of the TSS samples at the 500-foot (152-meter) mixing zone were  
22 more than 200 mg/L over background conditions and more than 90 percent of the TSS samples were less  
23 than 100 mg/L over background (TZC 2014). There were also no observations of turbidity resulting in  
24 substantial visible contrasts from ambient conditions to the Hudson River outside of the 500-foot  
25 (152-meter) mixing zone from dredging. However, sediment properties are site-specific variables that  
26 cannot be controlled. In general, fine-grained, less-cohesive sediments have the greatest potential for  
27 resuspension and would travel farther before resettling to the bottom. The goal would be to eliminate or  
28 minimize to the greatest extent practical sediment resuspension during clamshell dredging. The  
29 Applicants propose to achieve this goal by limiting the amount of dredging to only three small cofferdam  
30 locations; dredging only inside the cofferdam; positioning the receiving barge as close to the dredging site  
31 as possible to minimize dripping into open water; and using well-trained and experienced dredge  
32 operators as smooth and controlled hoisting can limit resuspension during clamshell dredging.

33 The sensitivity of fish to suspended sediment is species- and life-stage-specific, and depends on abiotic  
34 factors of the sediment, sediment concentration, and duration of exposure (Berry et al. 2003). Sensitive  
35 fish would experience lethal effects from TSS levels of approximately 600 mg/L, although effects at  
36 1,000 mg/L would be more typical (NMFS 2014).

37 Suspended sediment could cause pelagic eggs to sink to the bottom. Fish larvae are more sensitive to  
38 suspended sediments than eggs, juveniles, or adult fish. The installation of the proposed aquatic  
39 transmission line would cause a temporary disturbance on benthic habitat, which supports benthic prey  
40 items for some EFH species, but would remain usable as EFH. Temporary and localized reductions in  
41 available benthic food sources are also anticipated because some mortality of benthic infaunal organisms  
42 that serve as prey for EFH species would occur.

43 Studies of the effects of turbid waters on fish suggest that concentrations of suspended solids can reach  
44 thousands of mg/L before an acute toxic reaction is expected (Wilber and Clarke 2001). The studies  
45 reviewed demonstrated lethal effects on fish at concentrations of 580 mg/L over one day for a sensitive



1 species such as Atlantic silversides to no effect at 14,000 mg/L for species such as oyster toadfish and  
2 spot.

3 Jet plowing minimizes dispersal of suspended solids (and any potential sediment contaminants) because  
4 the turbidity plume is small compared to conventional dredging. As described, turbidity plumes are not  
5 expected to extend over long distances or result in any type of barriers to fish movement. However,  
6 turbidity could cause reduced growth rates and increased mortalities in planktonic larvae exposed to the  
7 turbidity plume. Adult and juvenile fish would likely leave the area temporarily to avoid unsuitable  
8 conditions in the water, such as an increase in turbidity (Clarke and Wilber 2000). This could influence  
9 migratory pathways for some fish if the installation of the aquatic transmission lines occurred during  
10 spawning season. However, construction windows were designed to avoid and minimize effects on  
11 spawning adults, eggs, and larvae of anadromous species in the Hudson River and winter flounder in the  
12 lower Hudson River and Harlem River.

13 The resuspension of contaminated sediments from increased turbidity within EFH could also result in  
14 exposure to fish, including some EFH species. If contaminated sediments become bioavailable or  
15 biotransferred within food chains, then, depending on the chemical form in which a contaminant occurs,  
16 effects on EFH species could occur. Water quality modeling for the proposed transmission cable  
17 installation indicates that concentrations of polychlorinated biphenyls (PCBs) would not exceed the water  
18 quality standards required by the Section 401 Water Quality Certificate of 0.09 micrograms per liter  
19 ( $\mu\text{g/L}$ ) from MP 228.5 to MP 272.3 and 0.2  $\mu\text{g/L}$  per aroclor from MP 272.3 to MP 330 (NYSDPS 2013).  
20 Water quality modeling also indicates that the chronic exposure standards for PCBs (0.5  $\mu\text{g/L}$ ) established  
21 by the U.S. Environmental Protection Agency (USEPA) and New York State would not be exceeded  
22 (NYSDPS 2013). These standards have been established to account for long-term, chronic exposures of  
23 aquatic life to PCBs. Since the proposed CHPE Project involves short-term construction activities, the  
24 more relevant guideline for assessing PCB concentrations would be the Engineering Performance  
25 Standard set by the USEPA for dredging resuspension at the Hudson River PCBs Superfund Site.  
26 Following these guidelines, it is expected that PCB concentration increases from resuspension of  
27 sediments would be well below the performance standard. No other state water quality standards would  
28 be exceeded as a result of transmission line installation activities (CHPEI 2012e, USEPA 2012). As such,  
29 contamination effects on EFH and associated EFH species would be negligible. Water quality sampling  
30 and monitoring would be conducted during jet plow pre-installation trials and during cable installation. If  
31 water quality certification criteria are exceeded or any other sampled contaminant, additional water  
32 quality sampling would take place at the location of the exceedance.

33 **Spills.** The vessels involved in construction of the proposed CHPE Project would contain fuel, hydraulic  
34 fluid, and other potentially hazardous fluids. There is a potential for these fluids to leak or spill into the  
35 water causing reduced water quality and potential contamination of sediments and organisms. Hazardous  
36 fluid that settles to the bottom could smother recently spawned eggs of EFH species, benthic prey, and  
37 vegetation that EFH species rely upon during growth to maturation. It is anticipated that the immediate  
38 response of fish to water contaminated with hydrocarbons would be avoidance. Oil has the potential to  
39 affect spawning success because of the physical smothering and the toxic effects on eggs and larvae  
40 (USFWS 2010). Minor releases of hydrocarbons could also affect benthic food sources. Benthic  
41 communities could also be affected by remediation operations or through physical damage to the habitats  
42 in which plants and animals live. Sediments trap the oil and affect the organisms that live in or feed off  
43 the sediments. The organisms could have toxicity effects from dermal contact or consumption of the oil  
44 (USEPA 2011). Small spills of hydrocarbons, particularly diesel fuel, are rapidly dispersed and diluted  
45 (NOAA 2006b). Spills in shallow, nearshore areas where benthic communities are closer to the water  
46 surface would be expected to have a higher potential for effects. Applicant-proposed measures, including  
47 implementation of a spill prevention plan, would prevent and reduce these effects. HDD installation  
48 activities at shorelines could result in the release of drilling fluid into the water. This fluid is composed

1 mainly of bentonite clay and water, and can have a similar impact on benthic communities and finfish as  
 2 suspended sediment. The USEPA considers drilling fluid nontoxic and no toxic additives would be used.  
 3 Therefore, the only effects on EFH from HDD would be temporarily increased turbidity (composed of  
 4 inorganic materials) and associated decreased water quality.

5 **Noise.** Effects of noise on species with EFH designated in the water column or water surface are  
 6 expected during the construction period. Continuous noise associated with vessels and machinery would  
 7 result from the proposed installation of the transmission line under all proposed installation methods.  
 8 Noise could also result from cavitations (i.e., the sudden formation and collapse of low-pressure bubbles  
 9 in the water from rotation of the vessel propeller) during vessel starts and stops. As with other cable  
 10 installation projects (Merck and Wasserthal 2009), the primary source of underwater noise during cable  
 11 installation activities is expected to be the cable-laying vessel. Research indicates that the underwater  
 12 noise temporarily generated by the construction vessels used for cable laying would be similar to that of  
 13 other ships and boats (e.g., pleasure boats, fishing vessels, tug boats, and ferries) already operating in the  
 14 ROI (JASCO 2006, Popper and Hastings 2009).

15 Following are the NMFS criteria for physiological impacts from noise on fish:

- 16 • Peak sound pressure level (SPL): 206 decibels (dB) relative to 1 micropascal (dB re 1  $\mu$ Pa, the  
 17 measurement unit for underwater noise in dB)
- 18 • Cumulative sound exposure level (cSEL) for fish above 0.07 ounces (2 grams): 187 dB relative to  
 19 1 micropascal-squared second (dB re 1  $\mu$ Pa<sup>2</sup>-s)
- 20 • cSEL for fish below 0.07 ounces (2 grams): 183 dB re 1  $\mu$ Pa<sup>2</sup>-s (NMFS 2013).

21 Underwater noise generated by cable-laying vessels for the Vancouver Island Transmission  
 22 Reinforcement Project in British Columbia was similar to that of other ships and boats (e.g., container  
 23 ships, tug boats, fishing vessels, recreational boats) already operating in the area (JASCO 2006). A  
 24 summary of typical underwater source pressure levels for various vessel types is presented in **Table 4-2**.

25 **Table 4-2. Underwater Source Pressure Levels for Various Vessels**

Vessel Description	Length (feet)	Frequency (Hz)	Total Engine Power (horsepower)	Source Level (dB re 1 $\mu$ Pa at 1 meter)
Outboard drive (2 engines, 80 horsepower each)	23	630	80 (two engines)	156
Small Supply Ships	180–279	1,000	N/A	125–135 (at 50 meters)
Mercator TSHD	500	Broadband	29,000	185.7 (dredging)
Semac 1 Pipelay Barge	487	Broadband	N/A	179.2 (pipelaying)
Castoro II Pipelay Barge	426	Broadband	3,350	168.1 (anchor operations)
Setouchi Surveyor Survey Vessel	212	Broadband	2,600 + 2,000 (thruster)	186.0 (using thrusters)
Katun AHTS	222	Broadband	12,240	181.8 (anchor pulling)

Source: Richardson et al. 1995, LGL and JASCO 2005

1 The source for the cable-laying vessel monitoring by JASCO (2006) was 177 dB re 1  $\mu$ Pa at 1 meter  
2 (3.3 feet). The report does not note the ship propulsion system that was monitored or the horsepower of  
3 the ship engines. Due to the acoustic source levels there would be no potential for the construction  
4 vessels to exceed either the Peak SPL of 206 dB re 1  $\mu$ Pa or the cSEL or 187 dB re 1  $\mu$ Pa<sup>2</sup>-s or 187 dB re  
5 1  $\mu$ Pa<sup>2</sup>-s. Noise from vessel movements, cofferdam installation, and rock drilling is not expected to  
6 result in injury to fish and is only considered in terms of behavioral response.

7 NMFS uses a root mean square (rms) SPL of 150 dB re 1  $\mu$ Pa as a conservative indicator of the noise  
8 level at which there is the potential for behavioral effects (NMFS 2013). That is not to say that exposure  
9 to noise levels of 150 dB re 1  $\mu$ Pa rms would always result in behavioral modifications or that any  
10 behavioral modifications would result in harm or harassment of fish, but that there is the potential, upon  
11 exposure to noise at this level, to experience some behavioral response.

12 Behavioral responses could range from a temporary startle to avoidance of an area affected by noise.  
13 Based on the modeled noise of a cable-laying ship, behavioral impacts would occur within 1,250 feet  
14 (380 meters) from the ship. This is an average, based on a range from 853 to 1,640 feet (260 to  
15 500 meters). That is, noise modeling indicates that 95 percent of the noise louder than 130 dB re 1  $\mu$ Pa  
16 would occur within 1,250 feet (380 meters) of the cable-laying vessel with a source level of 177 dB re 1  
17  $\mu$ Pa-1m (JASCO 2006). Based on this information, back calculating the distance to the 150 dB rms SPL  
18 isopleth indicates a radial distance of 100 feet from the cable-laying ship. LGL and JASCO (2005)  
19 modeled broadband source levels for a dynamically positioned vessel. The source level was 188 dB re 1  
20  $\mu$ Pa at 3.3 feet (1 meter) during dynamic positioning (using 2 bow thrusters and and 2 stern thrusters).  
21 Noise propagation modeling indicates the distance to the 150 dB re 1  $\mu$ Pa isopleth is localized, although  
22 the distance is not provided. Noise propagation was also modeled for a single workboat such as Yamaha  
23 FC-26 with a source level of a 157 dB re 1  $\mu$ Pa at 1 meter (3.3 feet). The 95 percent range from a single  
24 workboat to the 110 dB noise level contour was less than 360 feet (110 meters). Most fish have the  
25 capability to leave the area when underwater activities that create noise and sound pressure are occurring  
26 and returning when activities cease, thereby further reducing effects. Currently, there are no clear  
27 indications that noise impacts related to the installation of transmission cables pose a high risk for  
28 harming aquatic fauna (Merck and Wasserthal 2009). Because the anticipated noise levels associated  
29 with cable laying are relatively minimal (Popper and Hastings 2009), and because the Hudson and Harlem  
30 rivers are normally subject to substantial commercial and recreational vessel noise, any incremental  
31 increases in sound associated with the cable-laying barge would not cause physical injury from noise and  
32 are expected to be negligible. Additionally, construction windows have been developed to avoid impacts  
33 on sensitive life stages of anadromous fish, sturgeon, and winter flounder.

34 Noise from cofferdam installation and rock drilling is also not expected to result in injury to fish and is  
35 only considered in terms of behavioral response. Sheet pile cofferdams would be installed with a  
36 vibratory hammer. Jones and Stokes (2009) indicated that installation of piles with a vibratory hammer  
37 did not result in average peak noise levels greater than 206 dB re 1  $\mu$ Pa or cSEL greater than 187 dB re 1  
38  $\mu$ Pa<sup>2</sup>-s (NMFS 2014). Vibratory installation noise levels of piles in the Hudson River have been  
39 measured at 170 to 185 dB re 1  $\mu$ Pa peak SPL at 33 feet (10 meters), which is well below the threshold  
40 expected to cause injury to fish. The maximum 90 percent rms SPL ranged from 158 to 169 dB re 1  $\mu$ Pa  
41 at 33 feet (10 meters) and dropped to 106 to 130 dB re 1  $\mu$ Pa at 2,500 feet (762 meters) (Martin et al.  
42 2012). NMFS (2014) indicates that the footprint of the area where noise greater than 150 dB re 1  $\mu$ Pa  
43 rms SPL would be experienced is within 33 feet (10 meters) of the pile being installed. Therefore, the  
44 behavioral effects associated with cofferdam construction are expected to be localized. Cofferdam  
45 construction would be limited to the three HDD water-to-land transition locations in the Hudson and  
46 Harlem rivers. Rock drilling, such as that required for blasting, has been measured at 165 dB re 1  $\mu$ Pa  
47 peak SPL and 151 dB re 1  $\mu$ Pa rms SPL at 231 feet (70 meters) (Martin et al. 2012). Therefore,  
48 behavioral effects are expected to be localized. Measures to startle fish or keep fish away immediately

1 prior to blasting activities, such as use of sparkler guns or bubble curtains, would be used as conditions  
2 dictate. Additionally, rock drilling would only occur in the Harlem River.

3 Generally, construction is being scheduled to avoid impacts on sensitive life stages of anadromous fish  
4 and winter flounder (e.g., spawning migrations, spawning activity, and larval stages). Most of these  
5 impacts would be either temporary or intermittent and would be an insignificant effect on fish species in  
6 the Hudson River, including species with EFH designated.

7 **Blasting.** The burial depth at MP 324.5 where blasting excavation would occur in the Harlem River is  
8 specified in the USACE Public Notice as being 6 feet (1.8 meters) below the authorized depth. The  
9 planned excavation will cross a former rock peninsula approximately 460 feet (140 meters) in length.  
10 Blasting would disturb the river bottom and a trench would be backfilled with the blasted aggregate  
11 materials, which would provide habitat for species such as winter flounder and the skate species. Blasting  
12 would reduce biomass and photosynthesis of macroalgae in the immediate area; however, it has been  
13 demonstrated that macroalgae can recolonize a blasting location within 8 weeks. Additionally,  
14 macroalgae are not expected at the depths where the transmission line would be installed. Invertebrates  
15 are generally insensitive to pressure and other damage related to blasting (Keevin and Hempen 1997).  
16 However, it is assumed that some invertebrates would be crushed or damaged in the immediate vicinity of  
17 the blasting and mucking.

18 If pre-packaged chemical demolition agent was used to excavate the rock, pressure impacts on fish  
19 species would not be expected because a shock wave would not be produced. However, if water gel  
20 dynamite is used, a shock wave would be produced upon detonation. Fish injury and mortality associated  
21 with underwater blasting is related to pressure, energy flux density, and impulse (large, rapid pressure  
22 variations) (Keevin and Hempen 1997). Energy flux density is the rate of transfer of energy through a  
23 surface and determines the intensity of the shock wave (rate of energy transfer per unit area). The most  
24 common injury is swim bladder damage, although other organs, such as gills, kidney, liver, and spleen,  
25 can also be damaged. In fish with less well-developed swim bladders, neither the kidneys nor air bladder  
26 are injured, indicating that the presence of a swim bladder plays an important role in injuries to other  
27 organs. The thickness, location, and physiological connections of the swim bladder also play a role in the  
28 occurrence of injuries. Fish with swim bladders connected to the circulatory system appear to be more  
29 susceptible to injuries than fish with swim bladders connected to the esophagus. External injuries related  
30 to blasting appear to be species-specific and the magnitude of the pressure wave. The presence of the  
31 swim bladder might also be related to external injuries. Factors such as size, age, general health, water  
32 temperature, and reproductive condition can influence fish mortality related to blasting. Underwater  
33 explosions can result in structural abnormalities and mortality of fish eggs. Mortality decreased with  
34 distance to the explosion (Keevin and Hempen 1997). Impulse was determined to be the critical factor to  
35 result in mortality of larval fish because of the high magnitude over the long distance, although estimates  
36 for one project did not predict population-level impacts based on the number of larvae potentially killed  
37 (Govoni et al. 2008).

38 All blasting-related activities are anticipated to be completed from July through November outside of  
39 overwintering season for young-of-year, yearling and older striped bass, spawning season for winter  
40 flounder, overwintering of winter flounder, and spawning migration for river herring. This is within the  
41 construction windows agreed upon by the settlement parties, including the NYSDEC and the NYSDOS.  
42 Minimization of blasting effects on fish can be accomplished by means of avoiding blasting during slack  
43 tides, chasing fish from the site with an air-gun prior to blasts, or surrounding the site with a bubble  
44 curtain to minimize fish entry into the shock zone. Blasting activities would be performed in strict  
45 adherence to all industry standards applying to control of blasting and blast vibrations limits in  
46 compliance with the Applicant's blasting plan as part of its EM&CP.

1 **Vessel Strikes.** The Applicant proposes to use an installation barge, survey boat, crew boat, and tugboat  
2 or towboat to coordinate laying of cable. During installation, there would be potential for impacts on fish  
3 from vessel strikes. Large vessels such as cable-laying ships have been implicated of vessel strikes  
4 because of their deep draft (up to 40 to 45 feet [12 to 14 meters]), which increases the probability of  
5 vessel collision, relative to smaller vessels [less than 20 feet (5 meters)] such as those used for installation  
6 of the proposed CHPE Project. Vessel strikes of sturgeon have only been identified as a significant  
7 concern in the Delaware and James rivers in the Northeast and Mid-Atlantic United States where several  
8 vessel-struck individuals are found each year, possibly because unique geographic features in these areas  
9 (e.g., potentially narrow migration corridors combined with shallow and narrow river channels) that  
10 increase the risk of interactions between vessels and fish (NMFS 2014). Vessel strikes are not considered  
11 to be a substantial threat for sturgeon or other fish in the Hudson River because of the depth of the river.  
12 Smaller vessels and those with relatively shallow drafts provide more clearance with the river bottom and  
13 reduce the probability of vessel strikes. Because the construction vessels used for installation of the  
14 proposed CHPE Project transmission line (e.g., tug boats, barge crane, hopper scow) have relatively  
15 shallow drafts, the chance of vessel-related mortalities to fish is expected to be low.

16 The Applicant has proposed measures to minimize impacts from construction vessels on fish, including  
17 that all vessels associated with the installation activities would operate at “no wake/idle” speeds (less than  
18 4 knots) at all times in the construction area (defined as marine areas which have a nominal 50-foot  
19 [15-meter] width centered along the cable alignment) and in-water depth areas where the draft of the  
20 vessel provides less than a 4-foot (1.2-meter) clearance from the bottom. In areas with substantial objects  
21 recorded in side-scan sonar and magnetometer surveys, the speed would be reduced to less than one knot.  
22 Decreased vessel speeds in shallow waters would provide fish an opportunity to move out of the way of  
23 moving vessels, thereby making it unlikely that a collision would occur. Construction would not occur  
24 during spawning migration of sturgeon (as described in the Biological Assessment) and other anadromous  
25 fish (see **Table 2-2**), avoiding this vital and sensitive portion of their lifecycle.

26 Based on the types of vessels to be employed and their relatively shallow draft, there should always be  
27 sufficient clearance between vessels and the river bottom. The typical draft of the cable installation barge  
28 is approximately 12 feet (4 meters), while the Hudson River has a maintained depth of at least 32 feet  
29 (10 meters) in its navigation channel and the Harlem River has a maintained depth of at least 15 feet  
30 (5 meters). Additionally, reduced vessel speeds would help to avoid vessel strikes for fish near the  
31 surface. As such, the possibility of a vessel striking a sturgeon or other fish is discountable.

32 **Lighting.** Effects of vessel lighting on EFH species in surface or pelagic waters would occur during  
33 nighttime installation of the transmission line. Larval, juvenile, and adult fish could be attracted to lights,  
34 making them vulnerable to predation or vessel strikes. To avoid this, the lights used during construction  
35 would be intentionally positioned to avoid illumination of surrounding waters, thereby reducing the  
36 potential to attract fish. Vessels operating during night construction activities would be equipped with  
37 identification lights, and working decks would be illuminated for safety. Because lighting would not be  
38 expected to reach the riverbed, effects on demersal fish species and their EFH would be unlikely.

## 39 4.2 Effects from Operations, Maintenance, and Emergency Repairs

40 During operational activities in the Hudson, Harlem, and East rivers, an increase in temperature and  
41 magnetic and induced electric fields would be generated by the submerged transmission cables. The  
42 transmission line would be installed in a trench at a target depth of approximately 4 to 8 feet (1.3 to  
43 2.4 meters). The Applicant proposes to place the transmission line in a single trench, which would serve  
44 to reduce magnetic field levels. The sheathing and insulation around the cables and their burial would  
45 effectively eliminate the electric field produced by the cables (Normandeau et al. 2011). The magnetic  
46 field associated with the transmission line is calculated at less than 160 mG at the sediment-water

1 interface directly above the buried transmission cables, and up to 600 mG in the areas where concrete  
2 mats would be placed over the unburied transmission line. This magnetic field would be extremely  
3 localized to the area immediately above the transmission line.

4 As detailed in Sections 5.1.4 and other similar sections of the EIS, impacts on fish species from  
5 operational activities including increased temperature, magnetic fields, and weak induced electric fields  
6 would not be expected to be significant because of the localized nature of the impact. Temperature  
7 change in the water column would be less than 0.01 °F (0.006 °C) and would not be expected to impact  
8 finfish behavior and reproduction. Results from experiments evaluating long-term exposure of benthic  
9 species (including flounder [*Plathichthys flesus*]) to a magnetic field of 37,000 mG showed no statistical  
10 differences from non-exposed flounder in survival, condition, or reproductive potential (Bochert and  
11 Zettler 2004). These experimental values were much more intense than those expected from the  
12 transmission line in the Hudson River and New York City Metropolitan Area segments, which are  
13 calculated at less than 160 mG at the sediment-water interface directly above the buried transmission  
14 cables. While electrosensitive organisms such as sturgeon and American eel can detect electric fields,  
15 given the relatively narrow area within which the induced electric field would be detected by fish and the  
16 available information of how induced currents affect fish, no significant effects on fish would be  
17 expected.

18 Impacts on SAV from operational activities are not expected to be significant. Any increase in  
19 temperature or magnetic or induced electric fields would be negligible and extremely localized  
20 (CHPEI 2012g). Additionally, SAV is generally found in water depths of less than 10 feet (3 meters);  
21 however, the transmission line would generally be installed in deeper waters, minimizing the potential for  
22 impact on SAV.

23 As detailed in Sections 5.3.4 and 5.4.4 of the EIS, impacts on shellfish and benthic communities could  
24 occur from increases in temperature and magnetic and induced electric fields. For a cable buried 3.3 feet  
25 (1.0 meter) below the surface, the estimated ambient temperature increase at 8 inches (20.3 cm) below the  
26 surface of the sediments would be 9 °F (5.0 °C); however, the ambient temperature increase at the  
27 sediment surface directly above the cable is estimated at 1.8 °F (1.0 °C) (CHPEI 2012f, CHPEI 2012j).  
28 This is likely overestimated because the cooling effect from natural water flow, which would result in  
29 further heat dissipation, and the insulation provided by the sheathing surrounding the transmission cables  
30 are not taken into account (CHPEI 2012e, CHPEI 2012g). Overall, heat would dissipate in the sediments,  
31 just below the sediment and water interface, which is the biologically productive zone in the sediments.  
32 The intensity of the magnetic field is calculated at less than 160 mG at the sediment-water interface, much  
33 less intense than experimental exposure values described in Section 5.1.4 of the EIS. The survival and  
34 reproduction of benthic organisms are not thought to be affected by long-term exposure to static magnetic  
35 fields (Normandeau et al. 2011).

36 Pre- and post-energizing monitoring programs for benthic communities, sediment temperature, and  
37 magnetic fields would be implemented as required by Condition 163 of the NYSPSC Certificate issued  
38 for the proposed CHPE Project to evaluate potential operational impacts on benthic communities during  
39 the lifespan of the transmission line. The post-energizing benthic surveys would be conducted at the  
40 following milestones: (a) 3 years after installation assuming cable energizing, and (b) when the  
41 transmission system is operating at 500 to 1,000 MW if it is not doing so 3 years after installation.  
42 Sediment post-energizing sampling would be conducted 3 years after installation during the same season  
43 as the first benthic sampling event. All studies would be developed in consultation with appropriate  
44 resource agencies (NYSPSC 2013).

45 **Magnetic and Electric Fields.** The proposed aquatic transmission cables would emit magnetic fields and  
46 a weak induced electric field that could be detected by electrosensitive organisms. Additionally, effects

1 from magnetic and induced electric fields associated with the proposed CHPE Project transmission line  
2 could occur on EFH. However, given the relatively narrow area along the transmission line within which  
3 the fields might be detected by fish and the available information on how induced electric fields affect  
4 fish or the habitats used by fish, these effects are expected to be minimal. As described in the following  
5 paragraphs, no significant impacts on fish are expected due to induced electric fields and magnetic fields  
6 associated with operation of the transmission line.

7 The movement of charges in a magnetic field can cause an induced electric current (Normandeau et al.  
8 2011). Induced electric fields can be created by water currents such as waves and tides, or the movement  
9 of an organism through the Earth's naturally occurring geomagnetic field. Induced electric fields can be  
10 increased with the perpendicular movement of an organism or water current relative to a magnetic field  
11 associated with a DC transmission line. Induced electric fields can vary with sediment or substrate type  
12 (Normandeau et al. 2011). Increases in the induced electric currents would result from operation of the  
13 proposed CHPE Project transmission line.

14 Based on the prevailing geomagnetic field in the area of the proposed CHPE Project, a fish moving east to  
15 west perpendicular across the transmission cables at a rate of 4.5 feet (1.4 meters) per second (2.7 knots)  
16 would incur a naturally occurring induced electric current of  $72 \times 10^{-5}$  millivolts/cm (mV/cm); a fish  
17 moving north to south at the same rate would incur an induced electric current of  $67 \times 10^{-5}$  mV/cm. The  
18 maximum induced electric current associated with the transmission cables would be  $11.5 \times 10^{-5}$  mV/cm  
19 over 1 foot (0.3 meters) above riverbed at the centerline of the cables. The induced electric field from the  
20 transmission cables would therefore contribute, at most, a 17 percent increase in the total induced electric  
21 field at all locations compared to the induced electric field due to earth's geomagnetic field in these  
22 scenarios ( $11.5 \times 10^{-5}$  mV/cm [the maximum induced electric field]/ $67 \times 10^{-5}$  mV/cm [the ambient induced  
23 electric field that results in the maximum percent increase]) (Bailey and Cotts 2012).

24 Evidence indicates that electrosensitive organisms such as sturgeon can detect induced electric fields  
25 (CMACS 2003, Normandeau et al. 2011). Fish responses to induced currents have been identified as  
26 searching for the source and beginning active foraging, or avoiding the source. The evidence for a similar  
27 response of sturgeon to bioelectric or simulated electric fields is much more limited. In the context of the  
28 environment around the proposed CHPE Project cables, these considerations suggest that sturgeon would  
29 likely be able to detect induced electric fields from the ambient geomagnetic field and other existing  
30 ambient sources in the environment, and to detect alterations in this field by the cable system. However,  
31 the change in the induced electric field calculated from the proposed CHPE Project is a small fraction of  
32 that produced by the ambient geomagnetic field and quickly diminishes with distance from the  
33 transmission cables. The induced electric field from the Earth or the transmission cables is also  
34 considerably weaker than the electric field measured over certain marine sediments. Therefore, the  
35 increment in the ambient marine electric field even over the buried cable would not be a unique or novel  
36 stimulus nor would it be strong enough to produce physiological responses (Bailey and Cotts 2012).

37 Because the induced electric field from water flow in a magnetic field is essentially a static DC electric  
38 field, it would not seem to be a powerful stimulus to foster feeding behavior as is reported for the low-  
39 frequency AC fields that distinguish the bioelectric fields of prey and other fish. Rather than feeding  
40 responses associated with AC electric stimuli, electric fields from static DC sources (DC cable and  
41 corrosion potentials) might elicit temporary investigatory behavior as has been seen in anecdotal  
42 observations of sharks (Tricas and McCosker 1984). Hence, the induced electric field resulting from  
43 water current flow or sturgeon swimming in the static magnetic fields in the Hudson River would be more  
44 similar to the galvanic electric fields produced by the corrosion potentials from pilings, ships, gas and  
45 petroleum pipelines, and virtually all sunken or constructed metal infrastructure (Bailey and Cotts 2012).  
46 Altogether, the data are consistent with the idea that a behavioral response of sturgeon to the induced DC  
47 electric field from the proposed CHPE Project in the Hudson River, if any, is more likely to be an



1 investigative response (temporary and time-limited because of habituation) than a feeding response  
2 associated with the low-frequency AC field such as those produced by the bioelectric electric field  
3 produced by fish prey that would be more persistent (Bailey and Cotts 2012).

4 In experiments based on AC cables, sturgeon (*Acipenser gueldenstaedtii* and *Acipenser ruthenus*)  
5 responded to 50- Hz electric fields that ranged from 0.2 to 6.0 mV/cm (Normandeau et al. 2011). At  
6 range frequencies of 1.0 to 4.0 Hz and 16 to 18 Hz with field intensities of 0.2 to 3.0 mV/cm, the sturgeon  
7 response was to search for the source and begin active foraging. At 50 Hz and field intensities of 0.2 to  
8 0.5 mV/cm, the response was to search for the source and to begin active foraging. At 50 Hz at field  
9 intensities of 0.6 mV/cm or greater, the response was to avoid the source (Basov 1999). However, these  
10 intensities were orders of magnitude higher than any potential induced currents expected from the  
11 proposed DC transmission line.

12 The depth of the transmission line trench is proposed to be at least 6 feet (1.8 meters) with 1 foot (0.3  
13 meters) or less of horizontal separation between the two cables, which would be collocated in the same  
14 trench. Because the magnetic field is strongest at the transmission line and declines rapidly with distance,  
15 deeper burial would reduce the magnetic field, but would not eliminate it entirely (CMACS 2003,  
16 Normandeau et al. 2011). The magnetic field levels at the riverbed surface directly over the transmission  
17 line centerline were calculated to be less than 162 mG, and up to 600 mG in the areas where concrete  
18 mats would be placed over the unburied transmission line (CHPEI 2012k, CHPEI 2012i). These  
19 magnetic field levels are below the thresholds at which fish behavioral effects have been observed.

20 Information on the impacts of magnetic fields on fish is limited. A number of fish species, including  
21 sturgeons, eels, and salmon, are suspected of being sensitive to such fields because they have  
22 magnetosensitive or electrosensitive tissues, have been observed to use electrical signals in seeking prey,  
23 or use the Earth's magnetic field for navigation during migration (EPRI 2013). Only limited research has  
24 been done, so additional studies are required on the potential effects of magnetic fields on demersal  
25 species. The current state of knowledge about the potential impacts on fish from magnetic and electric  
26 fields emitted by underwater transmission lines is variable and inconclusive (Cada et al. 2011). However,  
27 lake sturgeon (*Acipenser fulvescens*) have exhibited temporarily altered swimming behaviors in response  
28 to AC-generated EMF that ranged from 35,100 mG to 1,657,800 mG, and EMF responses disappeared  
29 below 10,000–20,000 mG (Cada et al. 2011, Bevelhimer et al. 2013). These magnetic fields are much  
30 more intense than those that would be produced by the transmission line, which would be approximately  
31 162 mG at the sediment-water interface or 600 mG at the surface of a concrete mat directly above the  
32 buried transmission cables. No observable changes in activity levels or distribution of fathead minnows  
33 (*Pimephales promelas*), juvenile sunfish (*Lepomis* spp.), juvenile channel catfish (*Ictalurus punctatus*),  
34 and juvenile striped bass (*Morone saxatilis*) were observed in response to static (DC) fields using a  
35 permanent bar magnet (360,000 mG at the magnet surface) (Cada et al. 2011, Cada et al. 2012). The  
36 minnows and sunfish are positioned higher in the water column and, therefore, at a greater distance from  
37 the lake bottom where the proposed cable would be buried, than the sturgeon. Based on the foregoing,  
38 impacts from magnetic field strengths generated from the proposed CHPE Project transmission line on  
39 fish species are not expected to be significant.

40 There has been concern about whether anthropogenic magnetic fields could affect salmonids, which are  
41 thought to use the Earth's magnetic field, and visual and olfactory cues, to navigate to natal streams to  
42 spawn (EPRI 2013). There is very little information on their responses, but no observations indicate an  
43 adverse impact (Gill and Bartlett 2010). American eels rely upon their acute senses of smell to find food  
44 and use their olfactory sense along with magnetic cues to navigate to feeding and spawning habitats  
45 (American Eel Development Team 2000, Fisheries and Oceans Canada 2013). Current knowledge  
46 suggests that magnetic and electric fields emitted from buried submarine transmission cables could  
47 influence temporary changes in the swimming direction of freshwater eels if their migration routes

1 involved crossing over cables; this impact was especially evident in water depths of less than 66 feet  
2 (20 meters) (Gill and Bartlett 2010, Gill et al. 2012). Various field and laboratory studies on eels exposed  
3 to weak magnetic and electric fields showed some evidence that eels respond to stimuli by veering from  
4 the field source (Normandeau et al. 2011, Gill et al. 2012), but the implications of this altered behavior  
5 are not known. However, results from these studies provided little information to suggest that detection  
6 or a temporary veering response correlated further with inhibition of an eel's migrating, homing, or  
7 feeding capabilities. Nonetheless, the predicted magnetic fields for this project are below the thresholds  
8 at which fish behavioral effects have been observed.

9 Several fish species, including sharks, are suspected of being sensitive to such fields because they have  
10 magnetosensitive or electrosensitive tissues, have been observed to use magnetic and electrical signals in  
11 seeking prey, or use the Earth's magnetic field for navigation during migration (EPRI 2013). Research  
12 indicates that fish species with demersal EFH (e.g., summer flounder, winter flounder, and clearnose  
13 skate) are more likely to be exposed to higher field strengths, which are closer to the river bottom where  
14 the transmission line would be buried, as compared to pelagic species, which are found higher in the  
15 water column (Normandeau et al. 2011). However, there are uncertainties about how fish respond to  
16 these fields and whether they would inhibit a species ability to feed, reproduce, and survive. As  
17 described, research indicates that sturgeons in fresh water that were exposed to AC-generated  
18 electromagnetic fields that ranged from 35,100 mG to 1,657,800 mG altered their swimming direction  
19 (Cada et al. 2011). In contrast, research on European flounder (*Plathichthys flesus*) exposed to a  
20 magnetic of field of 37,000 mG showed no behavioral changes or effects on survival (Bochert and Zettler  
21 2004). Results from experiments that exposed fathead minnows, juvenile sunfish, juvenile channel  
22 catfish, and striped bass to 360,000 mG showed no evidence of changes in behavior or activity (Cada et  
23 al. 2011, Cada et al. 2012). In each of these studies, however, the magnetic field levels were orders of  
24 magnitude higher than would be generated by the proposed CHPE Project transmission line; therefore, it  
25 is logical that EFH species would not be adversely affected.

26 Laboratory studies that exposed rainbow trout (*Onchorhynchus mykiss*), brown trout (*Salmo trutta*), carp  
27 (*Cyprinus carpio*), and northern pike (*Esox lucius*) fish eggs and larvae to magnetic fields ranging from  
28 5,000 mG to 150,000 mG resulted in changes in embryonic development and movement (Formicki and  
29 Perkowski 1998, Formicki and Winnicki 1998, Winnicki et al. 2004). However, survivability was not  
30 discussed. These species serve as a surrogate for other species expected to occur in the proposed CHPE  
31 Project ROI. The increase in magnetic field strength at the sediment surface is approximately 162 mG  
32 where the transmission line is buried or 600 mG above concrete mats, and would decrease with an  
33 increase in distance from the river bottom (i.e., in the water column). Because laboratory experiments  
34 used exposures that are 1 to 3 orders of magnitude higher than the magnetic field strengths of those  
35 expected from the proposed CHPE Project transmission line, the effect of the magnetic field on fish eggs  
36 and larvae is expected to be negligible, even for benthic eggs and larvae.

37 Impacts on shellfish and benthic communities associated with operation of the transmission line could  
38 occur due to magnetic fields and increases in temperature. According to studies, the survival and  
39 reproduction of benthic organisms are not thought to be affected by long-term exposure to static magnetic  
40 fields (Normandeau et al. 2011). Several marine benthic invertebrates, including the blue mussel (*Mytilus*  
41 *edulis*) and North Sea prawn (*Crangon crangon*), survived 37,000 mG with no apparent effects (Bochert  
42 and Zettler 2004). However, physiological changes (20 percent decrease in hydration and a 15 percent  
43 decrease in amine nitrogen values) were detected in blue mussels exposed to magnetic fields of 58,000,  
44 80,000, and 800,000 mG. Experiments that exposed two freshwater mollusks, the Asiatic clam  
45 (*Corbicula fluminea*) and the freshwater snail (*Elimia clavaeformis*), to 360,000 mG showed no evidence  
46 of changes in activity (Cada et al. 2011). In these cases, experimental exposure values for magnetic fields  
47 are much more intense than those expected from the proposed CHPE Project transmission line in the  
48 Hudson River, which is calculated at less than 160 mG at the sediment-water interface directly above the

1 buried transmission cables buried at 3.3 feet (1 meter). This field would be extremely localized.  
2 According to studies, the survival and reproduction of benthic organisms are not thought to be affected by  
3 long-term exposure to static magnetic fields (Bochert and Zettler 2004, Normandeau et al. 2011).

4 **Heat.** During operation of the transmission line, heat loss from the cables could be expected, and would  
5 result in increased temperatures in the sediments around the cables. Although there would be some  
6 changes in temperatures in the sediments immediately surrounding the cables, the depth of the burial and  
7 insulating and armoring factors of the cable would minimize effects on the benthic habitats in the  
8 immediate vicinity (CHPEI 2012c). As described in the EIS (DOE 2013), operation of the underwater  
9 cables would not result in more than a negligible increase in water temperature. It is estimated that for  
10 cable burial at 4 and 8 feet, the maximum expected temperature change would be less than 0.001 °F  
11 (0.0001 °C and 0.0002 °C, respectively) in the water above the riverbed, approximately 1.8 °F (1.20 °C  
12 and 1.24 °C, respectively) at the riverbed surface, and 9 °F and 4 °F (5.0 °C and 2.5 °C), respectively, at  
13 0.2 meters below the riverbed surface (CHPEI 2012j). Low and high estimates were calculated for  
14 gravel, sand, and clay/silt sediments, and this range represents the lowest and highest of those estimates.  
15 Heat from the cables and the associated localized increase in temperature would dissipate in the  
16 sediments, just below the sediment and water interface, which is the biologically productive zone in the  
17 sediments.

18 Where the transmission cables cannot be buried to their full depth due to utilities or bedrock and must be  
19 covered with concrete mats, the estimated increase in ambient water temperature surrounding the cables  
20 covered by the concrete mats is expected to be negligible (less than 0.25 °F [0.14 °C]). This is expected  
21 to be within the range of daily variation of water temperatures experienced in the Hudson and Harlem  
22 rivers. The highest increase in ambient temperature in the top 2 inches (5 cm) of sediment along the sides  
23 of the concrete mat is expected to be 1.3 °F (0.7 °C) or less (Exponent 2014). Because the area of  
24 concrete mats is so small, any effects would be localized and not expected to have significant impacts on  
25 EFH.

26 Temperature increases associated with operation of the transmission line would not have more than a  
27 negligible impact on shellfish and benthic communities. The temperature increase in the top 6 inches  
28 (15 cm) of sediment where most benthic infauna (bottom-dwelling aquatic animals) occur would be less  
29 than 9 °F (5.0 °C), diminishing to 1.8 °F (1.0 °C) above ambient conditions at the sediment surface  
30 directly above the cables (CHPEI 2012e, CHPEI 2012g, CHPEI 2012j). Under normal conditions, near-  
31 surface sediments (0–2 inches [0–5 cm]) closely follow the temperature profile of the overflowing water  
32 (Lenk and Saenger 1998 and Clark et al. 1999 as cited in McDonough and Dzombak 2006). As such, any  
33 increase in temperature at the sediment water interface would be expected to be well within the range of  
34 variation throughout the year. Further, this temperature increase would be narrowly focused directly over  
35 the cable line and would dissipate rapidly with distance to either side of the centerline. Any measurable  
36 amount of local heat generation would not pose a physical barrier to fish passage and would allow SAV,  
37 macroalgae, and benthic organisms to colonize and demersal fish species (including demersal eggs and  
38 larvae, such as for winter flounder) to use surface sediments without being affected. Organisms living 2  
39 to 6 inches (5 to 15 cm) below the riverbed surface might be adversely affected but this would be limited  
40 to within a few feet of the transmission line in sediment. Results from the 30-month post-installation  
41 monitoring for the Cross Sound Cable Project in Long Island Sound indicated that the benthos within the  
42 transmission line corridor for this project continues to return pre-installation conditions. The presence of  
43 amphipod and worm tube mats at a number of stations within the transmission line corridor are indicators  
44 that suggest construction and operation of the transmission line did not have a long-term negative effect  
45 on the potential for benthic recruitment to surface sediments (Ocean Surveys 2005). Therefore, the small  
46 increase in riverbed temperature associated with the proposed CHPE Project is similarly considered to be  
47 within normal ranges of variation and would not significantly alter EFH, and no residual effects are  
48 predicted (SSE 2009). A pre- and post-energizing benthic monitoring program would be developed in

1 accordance with Certificate Condition 163 to evaluate operational impacts from magnetic fields and heat  
 2 during the lifespan of the transmission line on benthic communities (NYSPSC 2013).

3 No effects on EFH or fish that use EFH would be anticipated from periodic non-intrusive inspections of  
 4 the transmission line. During emergency repairs, effects from sediment disturbance and turbidity on EFH  
 5 species would be similar to those described during initial construction and installation but on a smaller  
 6 scale and for a shorter duration. Additional impacts associated with emergency repairs could include  
 7 those associated with lighting and noise. Effects associated with emergency repair would be localized  
 8 and temporary, lasting only for the duration of such activities.

9 **Decommissioning.** No effects on EFH or fish that use EFH would be anticipated from decommissioning  
 10 of the proposed CHPE Project transmission line because the line would be de-energized and abandoned in  
 11 place following expiration of its useful life.

### 12 4.3 Cumulative Effects

13 Cumulative impacts result from the “incremental impact of the action when added to other past, present,  
 14 and reasonably foreseeable future actions regardless of what agency (Federal or non-Federal) or person  
 15 undertakes such other actions”; they can result from “individually minor but collectively significant  
 16 actions taking place over a period of time” (40 CFR Part 1508.7). Other actions in the proposed CHPE  
 17 Project area that were considered for potential cumulative effects are summarized in **Table 4-3** and  
 18 described in detail in Section 6.1.1 of the DOE EIS (DOE 2013).

19 Generally, other projects would result in temporary cumulative effects on EFH if construction activities  
 20 overlapped with the proposed CHPE Project. Dredging activities associated with these other projects  
 21 could disturb aquatic substrates, temporarily increase turbidity, resuspend contaminants that might be  
 22 present in the sediment into the water column, temporarily increase noise and vibration, create light  
 23 sources during nighttime construction, and increase the potential for spills. Levels of suspended  
 24 sediments from the combined activities would reduce with distance from the disturbances and would  
 25 diminish after activities have ceased. Recovery times for the benthic communities vary from several  
 26 months to several years depending on the community composition and severity and frequency of  
 27 disturbance (Newell et al. 2004, Carter et al. 2008). Post-installation monitoring efforts for the Long  
 28 Island Replacement Cable in 2010 suggested that concrete mats were not a major disturbance to benthic  
 29 communities after two years (ESS Group 2011). Recolonization of affected areas would begin to occur  
 30 shortly after activities have ceased. Given the limited temporal overlap of the proposed CHPE Project  
 31 and these other projects, cumulative effects on EFH species would be temporary and negligible.

32 **Table 4-3: Other Actions Considered for Potential Cumulative Impacts**

Action	Brief Description	Project Overlap
<b>Hudson River Navigation Channel Dredging</b>	Maintaining the Hudson River Federal Channel between Waterford and New York City to a depth of 32 feet (10 meters).	Current project completion expected prior to construction activities associated with the proposed CHPE Project. The CHPE Project would also be designed not to interfere with potential future dredging projects.
<b>Hudson River PCB Dredging Project</b>	Targeted dredging, removal, and disposal of approximately 2.65 million cubic yards (2 million cubic	Spatially separated upstream from the proposed CHPE Project.

Action	Brief Description	Project Overlap
	meters) of PCB-contaminated sediment from the Upper Hudson River and the Champlain Canal.	
<b>Redevelopment of Stony Point Waterfront</b>	Potential redevelopment of waterfront into 300 housing units, a new marina with 125 boat slips, yacht clubs, and restaurants.	No anticipated cumulative impact due to temporal and spatial separation.
<b>Tappan Zee Hudson River Crossing Project</b>	A replacement Tappan Zee Bridge (Interstate 287/Interstate 87), which crosses the Hudson River between Rockland and Westchester counties.	Anticipated construction overlap could last for approximately 1 to 2 weeks while proposed CHPE Project transmission cables are installed in this area, which could occur between 2014 and 2017.
<b>Spectra-Algonquin Incremental Market (AIM) Natural Gas Pipeline</b>	Creating additional pipeline capacity to deliver natural gas to New York, Connecticut, Rhode Island, and Massachusetts.	The target in-service date for the AIM project is November 2016 with construction proposed to begin in the first quarter of 2015 and scheduled to last 1.5 years, and could overlap with the proposed CHPE Project.
<b>Haverstraw Water Supply Project</b>	A new water source proposal to meet long-term water supply needs in Rockland County, New York.	Construction and installation activities could overlap, spatially and temporally, with the proposed CHPE Project.
<b>Establishment of a Federal Anchorage Ground in the Hudson River</b>	A proposed new Federal anchorage ground, Anchorage Ground No. 18, in the Hudson River west of Yonkers, New York.	The proposed CHPE Project would traverse this anchorage ground between approximately MPs 319 and 320.
<b>West Point Transmission</b>	A proposed 1,000-MW (expandable up to 2,000 MW) electric transmission link that would connect Athens, New York, to Buchanan, New York.	No official timeline; however, these projects could affect similar resources with the Hudson River.
<b>West Point Net Zero Project</b>	Various types of proposed Net Zero energy technology actions that might be implemented alone or in combination to meet U.S. Army Garrison West Point's requirements for energy.	A water intake pipeline would be installed in the Hudson River that would extend approximately 1,500 feet (457 meters) inland from the Hudson River shoreline between MP 283 and 284.
<b>Hudson Project</b>	A 660-MW electric transmission link between Ridgefield, New Jersey, and New York City, running underneath the Hudson River.	This project is approximately 4 miles south of the proposed CHPE Project at its closest and the two are not collocated.

## 5. Conclusions

### 5.1 EFH Species

Based upon the status of EFH designated within the ROI, the primary effects on EFH and associated species from construction activities would include temporary and localized habitat degradation, reduction in prey availability in the immediate area, reduced ability to locate prey from increased turbidity, potential for temporary disturbance of spawning, toxicity effects from sediment resuspension (including potential for resuspending contaminated sediments), behavioral effects from increased noise in the water column, potential for increased predation from vessel lighting on the water during night construction, and the potential for effects from hydrocarbon spills. Impacts on the critical life stages of spawning adults, eggs, and larvae would be avoided based on the construction schedule. Because of the temporary and localized nature of the construction, impacts are not expected to be significant.

Localized effects from heat from the transmission cables and magnetic and induced electric fields generated within the habitat would also occur, and could reduce habitat quality for EFH species as a result of operation of the transmission line. Because the transmission line itself would be designed to be maintenance-free, no effects on EFH or species that use EFH would be anticipated from maintenance activities. Because of localized and negligible increases of induced electric fields, magnetic fields, and temperature, impacts are not expected to be significant.

Effects on EFH from emergency repairs would be similar to, but less than, effects from construction. The DOE has, therefore, determined that implementing the proposed CHPE Project would have no adverse effects on EFH or EFH species and would result in only temporary and minor effects. A summary of effects on each specific type of EFH was presented in **Table 4-1**.

### 5.2 FWCA Resources

Construction of the transmission lines would result in a temporary reduction in shellfish and benthic communities. Benthic communities are expected to recolonize the area within weeks to 2 years. No effects on SAV or macroalgae are expected because they are not expected to occur at the depths where the transmission line is being installed. However, if any macroalgae are affected at the blasting site in the Harlem River, they are expected to recolonize in weeks. Effects on fish that are not managed by NMFS are expected to be similar to those that are managed by NMFS. However, construction of the transmission line would avoid the spawning seasons of anadromous fish.

Pre- and post-energizing monitoring programs for benthic communities, sediment temperature, and magnetic fields would be implemented as required by Certificate Condition 163 (NYSDPS 2013) to evaluate potential operational impacts on benthic communities during the lifespan of the transmission line.

***THIS PAGE INTENTIONALLY LEFT BLANK***



## 6. Avoidance and Minimization Measures

As part of its application development process, the Applicant detailed a number of industry-accepted best management practices (BMPs) that it would undertake to avoid or reduce environmental impacts during construction and operation of the proposed CHPE Project. These impact reduction measures, collectively referred to as BMPs, have been taken into account in the environmental analyses conducted for this EFH Assessment. These measures include spill prevention plans, time-of-year work restrictions, water quality monitoring, and inspection and reporting. A list of specific BMPs proposed by the Applicant as part of the proposed CHPE Project and considered in the EIS analyses is provided in **Appendix G** of the EIS (DOE 2013). The following are Applicant-proposed measures that would avoid and minimize effects on EFH. Minimization measures would continue to be developed with NMFS throughout the consultation process.

- The Applicant has proposed to establish the Hudson River and Lake Champlain Habitat Enhancement, Restoration, and Research/Habitat Improvement Project Trust. The purpose of the Trust will be “protecting, restoring, and improving of aquatic habitats and fisheries resources in the Hudson River Estuary, the Harlem and East Rivers, Lake Champlain, and their tributaries, in order to minimize, mitigate, study, and/or compensate for temporary aquatic effects and potential long-term aquatic effects and risks to these water bodies from Facility construction and operation” (NYSPSC 2013).
- In areas of exposed bedrock and existing submerged utility lines, concrete mats would be installed to help protect the transmission lines.
- Based on the seasonal aquatic construction schedule for the proposed CHPE Project, effects on many spawning fish would be avoided (see **Table 2-2** for the construction schedules in specific areas of the Hudson and Harlem rivers).
- The NYSPSC Certificate requires the Applicant to undertake a series of pre- and post-installation compliance monitoring studies, including benthic habitat and sediment monitoring, bathymetry, sediment temperature, and magnetic fields. Pre-installation surveys would be conducted prior to debris removal. Post-installation bathymetric surveys, conducted 1 and 3 years after installation, would be used to monitor the recovery of the bottom substrate by comparing the results to the pre-installation survey, which would use the same techniques. The overall objective of the surveys would be to obtain the highest quality hydrographic data using commercially available equipment and techniques. Equipment that would be used includes a high resolution side-scan sonar system with a dual frequency (100 and 500 kiloHertz) towfish, a vessel motion sensor (heave, pitch, and roll) and heading sensor, real time kinematic GPS, and a shore-based GPS receiver. The entire cable route would be surveyed in the first year to compare with the bottom elevations of the pre-installation survey. Segments where the substrate has returned to the pre-installation configuration would not be resurveyed. Segments that have not returned to pre-installation condition after 3 years would be resurveyed after 5 years and 8 years after cable installation. Each survey would take about 35 days and would likely be conducted in the late summer and early fall. The speed of the vessel conducting the survey would depend on the water current speed and the weather. It is expected that the average speed of the vessel while surveying would be about 3 to 4 knots. Transit speeds would be 8 to 10 knots. The side-scan sonar system would be operated with a towfish height above the bottom that provides adequate coverage.
- The Applicant would work closely with Federal and state agencies to establish measures prior to construction commencement to avoid or minimize effects on protected aquatic resources along the transmission line route.

- 1 • All in-water work would be conducted within applicable time windows recommended by the  
2 NYSDEC, New York Natural Heritage Program, NMFS, and the U.S. Fish and Wildlife Service  
3 (if applicable) for the protection of EFH along the transmission line route (see **Table 2-2**).
- 4 • HDD techniques would be used for the cable installation where the lines enter and exit  
5 waterbodies to avoid or minimize effects on shoreline and shallow water habitats.
- 6 • A sheet pile cofferdam would be placed at the HDD exit point in the waterbody prior to  
7 excavation of the exit point pit. The cofferdam would remain in place and functional during all  
8 phases of the dredging operations and would be removed upon completion of dredging activities.
- 9 • Weighted silt curtains suspended on floats would be positioned to enclose the work site before  
10 commencing any mechanical dredging. The curtain would remain in place and functional during  
11 all phases of the dredging operations and remain in place for 2 hours after dredging termination.
- 12 • An environmental or closed clamshell dredge would be used during excavation of HDD pits in  
13 waterbodies to minimize suspension of fine-grained unconsolidated (silty) sediments.
- 14 • The Applicant would adhere to all current proper ballast water management regulations.
- 15 • The Applicant would train and educate transmission system contractors and subcontractors to  
16 identify aquatic invasive species and site-specific prescriptions for preventing or controlling their  
17 transport throughout or off of the proposed CHPE Project site.
- 18 • The Applicant would require that vessels, equipment, and materials be inspected for, and cleaned  
19 of, any visible vegetation, algae, organisms and debris, before leaving the waterbody for another.
- 20 • An Environmental Inspector or Aquatic Inspector would have the authority to modify or suspend  
21 construction if any EFH is affected in any way by construction activities.
- 22 • During nighttime construction activities, vessels would be outfitted with identification lights and  
23 working decks would be illuminated for safety. Lights would not be directed into surrounding  
24 waters, thereby reducing the potential for effects on benthic communities and fish.
- 25 • All vessels associated with construction of the proposed CHPE Project would operate at “no  
26 wake/idle” speeds (i.e., less than 4 knots) at all times while in the construction area and while in  
27 water depths where the draft of the vessel provides less than a 4-foot (1.2-meter) clearance from  
28 the bottom. In areas with substantial objects recorded in side-scan sonar and magnetometer  
29 surveys, the speed would be reduced to less than one knot. All vessels would preferentially  
30 follow deepwater routes (e.g., marked channels) whenever possible.
- 31 • Reduced in-water pressure and jetting speeds (e.g., less than 4 knots) would be used to reduce  
32 turbidity when crossing sensitive areas such as SCFWHs. The most appropriate speeds would be  
33 coordinated with the construction contractor, who would consider existing sediment conditions,  
34 cable weight and multiple other factors to arrive at an installation speed that allows for a  
35 reduction in impacts and safe and efficient cable installation. Reductions in TSS would be  
36 calculated after the installation specifications have been set as part of the construction design  
37 phase.
- 38 • Commencement of in-river work south of the Haverstraw Bay SCFWH would occur during the  
39 high, or flood, tide condition to avoid or minimize impacts of re-suspended sediments on  
40 Haverstraw Bay, which contains important habitat for protected and sensitive species.
- 41 • Blasting would occur between July 1 and November 30. Measures to startle fish or keep fish  
42 away immediately prior to underwater blasting activities, such as use of sparkler guns or bubble  
43 curtains, would be used as conditions dictate.

- 1       • All vessels associated with the construction of the proposed CHPE Project would operate at “no  
2 wake/idle” speeds at all times while in the construction area and while in water depths where the  
3 draft of the vessel provides less than a 4-foot (1.2-meter) clearance from the bottom. All vessels  
4 would preferentially follow deepwater routes (e.g., marked channels) whenever possible.  
5

1

***THIS PAGE INTENTIONALLY LEFT BLANK***

## 7. References

- AECOM 2011 AECOM. 2011. Aquatic Sampling Program. Available online: <<http://www.newnybridge.com/documents/feis/vol2/f-1-aquatic-ecological-studies.pdf>>. Accessed 16 June 2014.
- Able and Fahay 1998 Able, K.W. and M.P. Fahay. 1998. "The first year in the life of estuarine fishes of the Middle Atlantic Bight." Rutgers University Press. New Brunswick, NJ.
- American Eel Development Team 2000 American Eel Development Team. 2000. *Interstate Fisheries Management Plan for American eel* (*Anguilla rostrata*). Fisheries Management Report No. 36 for the Atlantic State Marine Fisheries Commission. April 2000.
- Bailey and Cotts 2012 Bailey, W.H. and B. Cotts. 2012. Memorandum from William H. Bailey, Ph.D. and Benjamin Cotts, Ph.D., Exponent, Inc., to Sean Murphy, HDR Engineering, Regarding Induced Electric Field. 7 October 2012.
- Bain et al. 2006 Bain, M.B., M.S. Meixler, and G.E. Eckerlin. 2006. Biological Status of Sanctuary Waters of the Hudson River Park in New York. Final Project Report for the Hudson River Park Trust. Cornell University. As cited in: NMFS, 2014, Biological Opinion of the Tappan Zee Bridge Replacement, NER-2013-10768, 2 April 2014.
- Basov 1999 Basov, B.M. 1999. "Behavior of Sterlet Sturgeon (*Acipenser ruthenus*) and Russian Sturgeon (*A. gueldenstaedtii*) in Low-Frequency Electric Fields." *Journal of Ichthyology*. 39:782-787.
- Bell et al. 2006 Bell, R., S. Carbotte, F. Nitsche, W. Ryan. 2006. Hudson River Estuary Sediment Type Map (NYSDEC). Available online: <<http://gis.ny.gov/gisdata/metadata/nysdec.hudson.sed.type.html>>. Accessed 20 June 2014.
- Berry et al. 2003 Berry, W., N. Rubinstein, B. Melzian, and B. Hill. 2003. "The Biological Effects of Suspended and Bedded Sediment (SABS) in Aquatic Systems: A Review." Internal U.S. Environmental Protection Agency Report. 20 August 2003. Available online: <<http://www.epa.gov/waterscience/criteria/sediment/pdf/appendix1.pdf>>. Accessed September 2009.
- Berry et al. 2011 Berry, W.J., N.I. Rubenstein, E.K. Hinchey, G. Klein-MacPhee, and D.G. Clarke. 2011. Assessment of dredging-induced sedimentation effects on winter flounder (*Pseudopleuronectes americanus*) hatching success: Results of laboratory investigations. Proceedings of the Western Dredging Association Technical Conference and Texas A&M Dredging Seminar. Nashville, TN, June 5-8, 2011.
- Bevelhimer et al. 2013 Bevelhimer, M.S., G. F. Cada, A. M. Fortner, P. E. Schweizer, and K. Riemer. 2013. "Behavioral Responses of Representative Freshwater Fish Species to Electromagnetic Fields." *Transactions of the American Fisheries Society*, 142:3, 802-813. Available online: <<http://dx.doi.org/10.1080/00028487.2013.778901>>. Accessed 24 September 2013.

- Blumberg and Pritchard 1997 Blumberg, A.F. and D.W. Pritchard. 1997. "Estimates of the transport through the East River, New York. *Journal of Geophysical Research*, 102(C3): 5685-5703." Available online: <[http://www.stevens.edu/ses/ceoe/fileadmin/ceoe/pdf/alan\\_publications/AFB059.pdf](http://www.stevens.edu/ses/ceoe/fileadmin/ceoe/pdf/alan_publications/AFB059.pdf)>. Accessed 5 November 2013.
- Bochert and Zettler 2004 Bochert, R. and M.L. Zettler. 2004. Long-term Exposure of Several Marine Benthic Animals to Static Magnetic Fields. *Bioelectromagnetics*. 25:498-502.
- BPA 2010 U.S. Department of Energy Bonneville Power Administration (BPA). 2010. Big Eddy-Knight Transmission Project Draft Environmental Impact Statement. December 2010.
- Cada et al. 2011 Cada, G.F., M.S. Bevelhimer, K.P. Riemer, and J.W. Turner. 2011. *Effects on Freshwater Organisms of Magnetic Fields associated with Hydrokinetic Turbines*. ORNL/TM-2011/244. Oak Ridge National Laboratory, Tennessee.
- Cada et al. 2012 Cada, G.F., M.S. Bevelhimer, A.M. Fortner, and P.E. Schweizer. 2012. *Laboratory Studies of the Effects of Static and Variable Magnetic Fields on Freshwater Fish*. ORNL/TM-2012/119. Oak Ridge National Laboratory, Tennessee.
- Carter et al. 2008 Carter, A., E. Hague, and L. Floyd. 2008. Benthic Infauna Recovery Following Channel Dredging in the Vicinity of Bogue Inlet, North Carolina. In *Proceedings of the 2008 National Conference on Beach Preservation Technology*. February 2008.
- CHPEI 2010a Champlain Hudson Power Express, Inc. (CHPEI). 2010. Champlain Hudson Power Express Project Supplement to the Article VII Application. July 2010.
- CHPEI 2010b CHPEI. 2010. *Champlain Hudson Power Express Project Article VII Application*. 30 March 2010.
- CHPEI 2012a CHPEI. 2012. Champlain Hudson Power Express Project Joint Proposal Exhibit 86: Updated Alternatives Analysis. 5 November 2010.
- CHPEI 2012b CHPEI. 2012. Champlain Hudson Power Express Project Joint Proposal Appendix F: Best Management Practices. 10 February 2012.
- CHPEI 2012c CHPEI. 2012. Champlain Hudson Power Express Project Joint Proposal. 24 February 2012.
- CHPEI 2012d CHPEI. 2012. Champlain Hudson Power Express Project Joint Proposal Exhibit 10: Description of Proposed Transmission Lines. 24 February 2012.
- CHPEI 2012e CHPEI. 2012. Champlain Hudson Power Express Project Joint Proposal Exhibit 121: Environmental Impact Analysis. July 2012.
- CHPEI 2012f CHPEI. 2012. Champlain Hudson Power Express Project Joint Proposal Exhibit 24: Requests for Additional Information. 2012.
- CHPEI 2012g CHPEI. 2012. Champlain Hudson Power Express Project Joint Proposal Exhibit 89: ESS Technical Review Report. 21 January 2011.

- CHPEI 2012h CHPEI. 2012. “Champlain Hudson Power Express Project Details: Economics.” Available online: <<http://chpexpress.com/economics.php>>. Accessed 26 April 2012.
- CHPEI 2012i CHPEI. 2012. Champlain Hudson Power Express Project Joint Proposal Exhibit 116: Revised Electric and Magnetic Fields Report. July 2011.
- CHPEI 2012j CHPEI. 2012. Champlain Hudson Power Express Project Joint Proposal Exhibit 92: CHPE Response letter to NYSDOS. 18 February 2011.
- CHPEI 2012k CHPEI. 2012. Champlain Hudson Power Express Project Joint Proposal Exhibit 39: Revised Electric and Magnetic Fields Report. 13 July 2010.
- CHPEI 2012l CHPEI. 2012. Champlain Hudson Power Express Project Joint Proposal Exhibit 31: Marine Route Survey Report. July 2010.
- CHPEI 2012m CHPEI. 2012. Champlain Hudson Power Express Project Joint Proposal Exhibit 85: Hudson, Harlem and East River Water Quality Modeling. 2010.
- CHPEI 2014a CHPEI. 2014. Letter from William Helmer, CHPEI, to Christopher Boelke, NMFS. 4 June 2014.
- CHPEI 2014b CHPEI. 2014. Letter from William Helmer, CHPEI, to Mark Murray-Brown, NMFS. 4 June 2014.
- Clark et al. 1999 Clark, E., B. W. Webb, and M. Ladle. 1999. “Microthermal gradients and ecological implications in Dorset rivers.” *Hydrological Processes*. 13: 423-438. As cited in McDonough and Dzombak 2006.
- Clarke and Wilber 2000 Clarke, D.G., and D.H. Wilber. 2000. *Assessment of Potential Impacts of Dredging Operations due to Sediment Resuspension*. DOER Technical Notes Collection (ERDC TN-DOER-E9). U.S. Army Engineer Research and Development Center, Vicksburg, Mississippi.
- CMACS 2003 Centre for Marine and Coastal Studies (CMACS). 2003. *A Baseline Assessment of Electromagnetic Fields Generated by Offshore Windfarm Cables*. Collaborative Offshore Wind Research into the Environment (COWRIE) Report EMF-01-2002 66. July 2003.
- Combs 1979 Combs, D. L. 1979. Striped bass spawning in the Arkansas River tributary of Keystone Reservoir, Oklahoma. *Proceedings of the Southeast Association of Fish and Wildlife Agencies* 33: 371-383.
- Cross-Sound Cable Company 2012 Cross-Sound Cable Company, LLC. 2012. “Cable Information.” Available online: <<http://www.crosssoundcable.com/CableInfonew.html>>. Accessed 6 September 2012.
- DOE 2013 U.S. Department of Energy (DOE). 2013. *Draft Champlain Hudson Power Express Transmission Line Project Environmental Impact Statement*. September 2013.



- EPRI 2013 Electric Power Research Institute (EPRI). 2013. EPRI Workshop on EMF and Aquatic Life. Available online: <[http://mhk.pnnl.gov/wiki/images/d/df/EPRI\\_2013.pdf](http://mhk.pnnl.gov/wiki/images/d/df/EPRI_2013.pdf)>. Accessed 24 September 2013.
- ESS Group 2011 ESS Group. 2011. Concrete Mattress Macroinvertebrate and Video Census Monitoring Report. Long Island Replacement Cable (LIRC) Project. Prepared for Northeast Utilities Services Company as agent for the CT Light & Power Company, Berlin, Connecticut. Prepared by ESS Group, Inc., Wellesley, Massachusetts. 2011.
- Exponent 2014 Exponent Engineering (Exponent). 2014. Memorandum Regarding Champlain Hudson Direct Current Cable Thermal Analysis. Prepared for TDI. 29 April 2014.
- Findlay et al. 2006 Findlay, S., D. Strayer, M. Bain, and W. C. Nieder. 2006. *Final Report to the New York State Department of Environmental Conservation*.
- Fisheries and Oceans Canada 2013 Fisheries and Oceans Canada. 2013. "Underwater World: American Eel." Available online: <<http://www.dfo-mpo.gc.ca/science/publications/uww-msm/articles/eel-anguille-eng.htm>>. Accessed 29 June 2013.
- Formicki and Perkowski 1998 Formicki, K. and T. Perkowski. 1998. The Effect of Magnetic Field on the Gas Exchange in Rainbow Trout *Oncorhynchus mykiss* embryos (Salmonidae). *The Italian Journal of Zoology*, 65:475-477.
- Formicki and Winnicki 1998 Formicki, K. and A. Winnicki. 1998. Reactions of Fish Embryos and Larvae to Constant Magnetic Fields. *The Italian Journal of Zoology*, 65:479-482.
- Germano and Cary 2005 Germano, J.D., and Cary, D. 2005. Rates and effects of sedimentation in the context of dredging and dredged material placement. *DOER Technical Notes Collection*. March 2005.
- Geyer and Chant 2006 Geyer, W.R. and R. Chant. 2006. "The Physical Oceanography Processes in the Hudson River Estuary." In *The Hudson River Estuary*, J.S. Levinton and J.R. Waldman, Eds. Cambridge University Press, New York, New York. Available online: <[http://www.esf.edu/efb/limburg/watershedecology/readings/hr\\_book\\_ch\\_3.pdf](http://www.esf.edu/efb/limburg/watershedecology/readings/hr_book_ch_3.pdf)>. Accessed 4 November 2013.
- Gill and Bartlett 2010 Gill, A.B. and M. Bartlett. 2010. Literature Review on the Potential Effects of Electromagnetic Fields and Subsea noise from Marine Renewable Energy Developments on Atlantic Salmon, Sea Trout and European Eel. *Scottish Natural Heritage Commissioned Report No.401*.
- Gill et al. 2012 Gill, A.B., M. Bartlett and F. Thomsen. 2012. Potential Interactions Between Diadromous Fishes of U.K. Conservation Importance and the Electromagnetic Fields and Subsea Noise from Marine Renewable Energy Developments. *Journal of Fish Biology*, 81: 664-695.
- Govoni et al. 2008 Govoni, J.J., West, M.A., Settle, L.R., Lynch, R.T., and Greene, M.D. 2008. Effects of underwater explosions on larval fish: Implications for a coastal engineering project. *Journal of Coastal Research*, 24:228-233.

- Grove 1982 Grove, C.A. 1982. Population biology of the winter flounder, *Pseudopleuronectes americanus*, in a New England estuary. M.S. thesis, University of Rhode Island, Kingston, 95 pp.
- Hirsh et al. 1978 Hirsch, N.D., L.H. DiSalvo, and R. Peddicord. 1978. "Effects of dredging and disposal on aquatic organisms." Technical Report DS-78-5. U.S. Army Engineer Waterways Experiment Station, Vicksburg, MS. NTIS No. AD A058 989.
- Historic Hudson River 2004 Historic Hudson River. 2004. "Natural History of the Hudson River." Available online: <<http://www.hhr.highlands.com/nathist.htm>>. Accessed 7 November 2013.
- HTP 2008 Hudson Transmission Partners LLC (HTP). 2008. *The Hudson Project, Exhibit 4: Environmental Impacts*. 2008.
- JASCO 2006 JASCO Research Limited. 2006. *Vancouver Island Transmission Reinforcement Project: Atmospheric and Underwater Acoustics Assessment Report*. Prepared for British Columbia Transmission Corporation. 2006.
- Kingbird 2014 Kingbird International Trading Group (Kingbird). 2014. Grapnel Hook Photograph. Available online: <<http://www.kingbirdmachinery.com>>. Accessed 12 June 2014.
- Keevin and Hempen 1997 Keevin, T.M. G.L. Hempen. 1997. *The Environmental Effects of Underwater Explosions with Methods to Mitigate Impacts*. August 1997.
- Jones and Stokes 2009 Jones and Stokes. 2009. *Technical Guidance for Assessment and Mitigation of the Hydroacoustic Effects of Pile Driving on Fish*. February 2009.
- LaSalle et al. 1991 LaSalle, M.W., D.G. Clarke, J. Homziak, J.D. Lunz, and T.J. Fredette. 1991. "A framework for assessing the need for seasonal restrictions on dredging and disposal operations." Department of the Army, Environmental laboratory, Waterways Experiment Station, Corps of Engineers, Vicksburg, Mississippi.
- Levinton and Waldman 2012 Levinton, J.S. and J.R. Waldman. 2012. "The Hudson River Estuary." Available online: <<http://life.bio.sunysb.edu/marinebio/hrfhrbook/chapters1xz.html>>. Accessed 3 October 2012.
- LGL and JASCO 2005 LGL Limited and JASCO Research Limited. 2005. An Assessment of the Effects of Underwater Noise from the Proposed Neptune LNG Project. Prepared for Ecology and the Environment, Inc. LGL Report No. TA4200-3. Available online: <[http://www.nmfs.noaa.gov/pr/pdfs/permits/neptune\\_assessment.pdf](http://www.nmfs.noaa.gov/pr/pdfs/permits/neptune_assessment.pdf)>. Accessed 16 June 2014.
- Lenk and Saenger 1998 Lenk, M. and N. Saenger. 1998. Exchange processes in the river bed and their influence on temperature variations. *International Association of Theoretical and Applied Limnology*, Dublin, E. Schweizerbart'sche Verlagsbuchhandlung. As cited in McDonough and Dzombak 2006.
- Lobell 1939 Lobell, M.J. 1939. *A Biological Survey of the Salt Waters of Long Island. Report on Certain Fishes: Winter Flounder (Pseudopleuronectes americanus)*. New York Conservation Department 28th Annual Report Supplement Part I, pp 63-96.

- Martin et al. 2012      Martin, B., A. MacGillivray, J. MacDonnell, J. Vallarta, T. Deveau, G. Warner, and D. Zeddies. 2012. "Underwater Acoustic Monitoring of the Tappan Zee Bridge Pile Installation Demonstration Project: Comprehensive Report." JASCO Document 00355, Version 1.1. Technical report prepared for AECOM by JASCO Applied Sciences. Available online: <<http://www.newnybridge.com/documents/environment/pidp-report.pdf>>. Accessed 6 April 2014.
- McDonough and Dzombak 2006      McDonough, K.M. and Dzombak, D.A. 2006. Analysis of Processes and Environmental Factors Governing Polychlorinated Biphenyl Transport from the Sediment to the Water Column Under Low Flow Conditions in the Upper Hudson River. Available online: <<http://www.ce.cmu.edu/~packard/pubs/mcdonough-dzombak-cee-tr-6-21-06.pdf>>. Accessed 17 June 2014.
- Merck and Wasserthal 2009      Merck, T., and Wasserthal, R. 2009. *Assessment of the Environmental Impacts of Cables*. Published by the OSPAR Commission.
- MMS 2009      U.S. Department of the Interior, Minerals Management Service (MMS). 2009. *Cape Wind Energy Project Final EIS*. January 2009.
- MTA 2004      Metropolitan Transportation Authority (MTA). 2004. *New York City Second Avenue Subway Final EIS*. May 2004.
- Nepf and Geyer 1996      Nepf, H.M. and W.R. Geyer. 1996. "Intratidal variation in stratification and mixing in the Hudson estuary." *Journal of Geophysical Research*. 101(C5): 12,079-12,086.
- Newell et al. 1998      Newell, R.C., L.J. Seiderer, and D.R. Hitchcock. 1998. The Impact of Dredging Works in in Coastal Waters: A Review of the Sensitivity to Disturbance and Subsequent Recovery of Biological Resources on the Sea Bed. *Oceanography and Marine Biology: an Annual Review*. 36: 127-128.
- Newell et al. 2004      Newell, R.C., L.J. Seiderer, N.M. Simpson, and J.E. Robinson. 2004. "Impacts of Marine Aggregate Dredging on Benthic Macrofauna off the South Coast of the United Kingdom." *Journal of Coastal Research*. 20(1): 115-125.
- NMFS 2004      National Marine Fisheries Service (NMFS). 2004. "Essential Fish Habitat Consultation Guidance, Version 1.1." April 2004. Available online: <[http://www.habitat.noaa.gov/pdf/efhconsultationguidancev1\\_1.pdf](http://www.habitat.noaa.gov/pdf/efhconsultationguidancev1_1.pdf)>. Accessed 8 July 2013.
- NMFS 2013      NMFS. 2013. "Summary of Essential Fish Habitat (EFH) and General Habitat Parameters for Federally Managed Species." Available online: <<http://www.nero.noaa.gov/hcd/efhtables.pdf>>. Accessed 4 November 2013.
- NMFS 2014      NMFS. 2014. Biological Opinion of the Tappan Zee Bridge Replacement, NER-2013-10768. 2 April 2014.
- NOAA 1997      National Oceanic and Atmospheric Administration (NOAA). 1997. *NOAA's Estuarine Eutrophication Survey. Volume 2: Mid-Atlantic Region*. NOAA National Ocean Service, Office of Ocean Resources Conservation and Assessment.

- NOAA 1998a NOAA. 1998. Summary of Essential Fish Habitat Designations: Hudson River/Raritan/Sandy Hook Bays, New York/New Jersey. Available online: <<http://www.nero.noaa.gov/hcd/ny3.html>>. Accessed 28 April 2014.
- NOAA 1998b NOAA. 1998. “Guide to Essential Fish Habitat Designations in the Northeastern United States.” Available online: <<http://www.nero.noaa.gov/hcd/webintro.html>>. Accessed 20 July 2012.
- NOAA 1998c NOAA. “Guide to Essential Fish Habitat Descriptions.” Available online: <<http://www.nero.noaa.gov/hcd/list.htm>>. Accessed 20 July 2012.
- NOAA 1999a NOAA. 1999. “Essential Fish Habitat Source Document: Atlantic Butterfish, *Peprilus triacanthus*, Life History and Habitat Characteristics.” Available online: <<http://www.nefsc.noaa.gov/nefsc/publications/tm/tm145/tm145.pdf>>. Accessed 4 November 2013.
- NOAA 1999b NOAA. 1999. “Essential Fish Habitat Source Document: Red Hake, *Urophycis chuss*, Life History and Habitat Characteristics.” Available online: <<http://www.nefsc.noaa.gov/nefsc/publications/tm/tm133/tm133.pdf>>. Accessed 4 November 2013.
- NOAA 1999c NOAA. 1999. “Essential Fish Habitat Source Document: Summer Flounder *Paralichthys dentatus*, Life History and Habitat Characteristics.” Available online: <<http://www.nefsc.noaa.gov/publications/tm/tm151/tm151.pdf>>. Accessed November 4, 2013.
- NOAA 1999d NOAA. 1999. “Essential Fish Habitat Source Document: Winter flounder, *Pleuronectes americanus*, Life History and Habitat Characteristics.” Available online <<http://www.nefsc.noaa.gov/publications/tm/tm138/tm138.pdf>>. Accessed 6 November 2013.
- NOAA 1999e NOAA. 1999. “Essential Fish Habitat Source Document: Atlantic Herring, *Clupea harengus*, Life History and Habitat Characteristics.” Available online: <<http://www.nefsc.noaa.gov/nefsc/publications/tm/tm126/tm126.pdf>>. Accessed 6 March 2014.
- NOAA 1999f NOAA. 1999. “Essential Fish Habitat Source Document: Windowpane, *Scophthalmus aquosus*, Life History and Habitat Characteristics.” Available online: <<http://www.nefsc.noaa.gov/nefsc/publications/tm/tm137/tm137.pdf>>. Accessed 6 March 2014.
- NOAA 1999g NOAA. 1999. “Essential Fish Habitat Source Document: Scup, *Stenotomus chrysops*, Life History and Habitat Characteristics.” Available online: <<http://www.nefsc.noaa.gov/nefsc/publications/tm/tm149/tm149.pdf>>. Accessed 6 March 2014.
- NOAA 1999h NOAA. 1999. “Essential Fish Habitat Source Document: Winter flounder, *Pleuronectes americanus*, Life History and Habitat Characteristics.” Available online: <<http://www.nefsc.noaa.gov/publications/tm/tm138/tm138.pdf>>. Accessed 25 April 2014.

- NOAA 2003a NOAA. 2003. “Essential Fish Habitat Source Document: Clearnose Skate, *Raja eglanteria*, Life History and Habitat Characteristics.” Available online: <<http://www.nefsc.noaa.gov/nefsc/publications/tm/tm174/tm174.pdf>>. Accessed 4 November 2013.
- NOAA 2003b NOAA. 2003. “Essential Fish Habitat Source Document: Little Skate, *Leucoraja erinacea*, Life History and Habitat Characteristics.” Available online: <<http://www.nefsc.noaa.gov/nefsc/publications/tm/tm175/tm175.pdf>>. Accessed 4 November 2013.
- NOAA 2003c NOAA. 2003. “Essential Fish Habitat Source Document: Winter Skate, *Raja ocellata*, Life History and Habitat Characteristics.” Available online: <<http://www.nefsc.noaa.gov/nefsc/publications/tm/tm179/tm179.pdf>>. Accessed 4 November 2013.
- NOAA 2006a NOAA. 2006. Essential Fish Habitat Source Document: Bluefish, *Pomatomus saltatrix*, Life History and Habitat Characteristics. Available online: <<http://www.nefsc.noaa.gov/publications/tm/tm198/tm198.pdf>>. Accessed 4 November 2013.
- NOAA 2006b NOAA. 2006. “Small Diesel Spills (500-5000 gallons).” Available online: <[http://archive.orr.noaa.gov/book\\_shelf/974\\_diesel.pdf](http://archive.orr.noaa.gov/book_shelf/974_diesel.pdf)>. Accessed 4 October 2012.
- NOAA 2007 NOAA. 2007. “Essential Fish Habitat Source Document: Black Sea Bass, *Centropristis striata*, Life History and Habitat Characteristics, Second Edition.” Available online: <<http://www.nefsc.noaa.gov/nefsc/publications/tm/tm200/tm200.pdf>>. Accessed 5 November 2013.
- NOAA 2009 NOAA. 2009. *Final Amendment 1 to the Consolidated Atlantic Highly Migratory Species Fishery Management Plan Essential Fish Habitat*. June 2009.
- NOAA 2013 NOAA. 2013. “Estuarine Living Marine Resources (ELMR) Database.” Available online: <[http://www8.nos.noaa.gov/biogeo\\_public/elmr.aspx](http://www8.nos.noaa.gov/biogeo_public/elmr.aspx)>. Accessed 15 November 2013.
- NOAA 2014 NOAA. 2014. “Essential Fish Habitat Designations for New England Skate Complex.” Available online: <<http://www.nero.noaa.gov/hcd/skateefhmaps.htm>>. Accessed 25 April 2014.
- Normandeau et al. 2011 Normandeau Associates, Inc., Exponent, Inc., T. Tricas, and A. Gill. 2011. *Effects of EMFs from undersea power cables on elasmobranchs and other marine species*. OCS Study BOEMRE 2011-09. May 2011.
- NYSDEC 1986 New York State Department of Environmental Conservation (NYSDEC). 1986. *The inland fishes of New York State*. Call Number: ENV 214-4 INLFN 86-11977. October 1986.
- NYSDEC 2012 NYSDEC. 2012. “Hudson River Fisheries Unit.” Available online: <<http://www.dec.ny.gov/animals/9962.html>>. Accessed 4 October 2012.

- NYSDEC 2013 NYSDEC. 2013. “Hudson River Submerged Aquatic Vegetation.” Available online: <<http://www.seagrant.sunysb.edu/hriver/pdfs/HV-SAVFactSheet.pdf>>. Accessed 25 January 2013.
- NYSDEC 2014a NYSDEC. 2014. “Benthic Mapper”. Available online: <<http://www.dec.ny.gov/imsmaps/benthic/viewer.htm>>. Accessed 16 June 2014.
- NYSDEC 2014b NYSDEC. 2014. “Submerged Aquatic Vegetation Habitat.” Available online: <<http://www.dec.ny.gov/lands/87648.html>>. Accessed 14 March 2014.
- NYSDOS 2014 New York State Department of State (NYSDOS). 2014. “Significant Coastal Fish & Wildlife Habitats.” Available online: <<http://www.dos.ny.gov/opd/programs/consistency/scfwhabitats.html>>. Accessed 22 April 2014.
- NYSDPS 2013 New York State Department of Public Service (NYSDPS). 2013. New York State Public Service Commission 401 Water Quality Certification for the Champlain Hudson Power Express Project. Issued by NYSDPS Office of Energy Efficiency and the Environment. 18 January 2013.
- NYSPSC 2003 New York State Public Service Commission (NYSPSC). 2003. Environmental Management and Construction Standards and Practices for Underground Transmission and Distribution Facilities in New York State. Prepared by Environmental Certification & Operations Section, New York Department of Public Service. 18 February 2003.
- NYSPSC 2013 NYSPSC. 2013. “Champlain Hudson Power Express, Inc., Order Granting Certificate of Environmental Compatibility and Public Need.” Available online: <<http://documents.dps.ny.gov/public/Common/ViewDoc.aspx?DocRefId=%7bA71423C8-B489-4996-9C5A-016C9F334FFC%7d>>. Accessed 13 November 2013.
- Ocean Surveys 2005 Ocean Surveys, Inc. (Ocean Surveys). 2005. Thirty Month Post-Installation Benthic Monitoring Survey for the Cross Sound Cable Project. Prepared for Cross-Sound Cable Company, LLC. As cited in Community and Environmental Defense Services, 2011, Mid-Atlantic Power Pathway and the Chesapeake Bay: A Preliminary Review of the Impact of Placing Portions of an Extra-High Voltage Transmission Line Beneath the Chesapeake Bay and Other Waters, prepared for Dorchester Citizens for Safe Energy, available online: <<http://ceds.org/DCSE/SubmergedCablePreliminaryLiteratureReview.pdf>>, accessed 23 June 2014.
- Popper and Hastings 2009 Popper, A.N., and Hastings, M.C. 2009. “The effects of human-generated sound on fish.” *Integrative Zoology*. 4: 43-52.
- Reine et al. 1998 Reine, K.J., D.D. Dickerson, and D.G. Clarke. 1998. *Environmental Windows Associated With Dredging Operations*. DOER Technical Notes Collection TN DOER-E2. Vicksburg, MS: U.S. Army Engineer Research and Development Center.
- Richardson et al. 1995 Richardson, W.J., C.R. Greene, C.I. Malme, and H.H. Thomson. 1995. *Marine Mammals and Noise*. Academic Press, San Diego.

Riverkeeper 2013 Riverkeeper, Inc. 2013. "Harlem River/Willis Avenue Bridge Water Quality Parameters." Available online: <<http://www.riverkeeper.org/water-quality/locations/nyc-hudson-bergen/harlem-river-willis-ave-bridge/#bsd>>. Accessed 5 November 2014.

Saila 1961 Saila, S.B. 1961. The contribution of estuaries to the offshore winter flounder fishery in Rhode Island. *Proceedings of the Gulf and Caribbean Fisheries Institute*, 14:95-109.

Scenic Hudson and Riverkeeper 2013 Scenic Hudson, Inc. and Riverkeeper, Inc. 2013. "Joint Brief of Scenic Hudson, Inc. and Riverkeeper, Inc. Opposing Exceptions of Entergy Nuclear Power Marketing, LLC and Entergy Nuclear Fitzpatrick, LLC." Available online: <<http://documents.dps.ny.gov/public/Common/ViewDoc.aspx?DocRefId={18BA6FD D-B91F-424D-BF0A-465571149434}>>. 1 February 2013.

SSE 2009 Scottish and Southern Energy (SSE). 2009. *Shetland HVDC Connection Marine Environmental Appraisal Subsea Cable Summary*. 2009.

SUNY 2013 State University of New York (SUNY). 2013. "Hudson River Estuary: The Basics." Available online: <<http://life.bio.sunysb.edu/marinebio/fc.1.estuaries.html>>. Accessed 6 November 2013.

Tricas and McCosker 1984 Tricas, T.C. and J.E. McCosker. 1984. Predatory Behavior of White Shark (*Carcharodon carcharias*) with Notes on Its Biology. Available online: <<http://www.hawaii.edu/fishlab/pubs/Tricas%20&%20McCosker%201984.pdf>>. Accessed 20 June 2014.

TZC 2014 Tappan Zee Constructors, LLC. 2014. Water Quality Monitoring Report, 2013 Dredging and Decanting, New NY Bridge Project. Available online: <<http://www.newnybridge.com/documents/water-quality/2013/2013-monitoring-report-dredging-decanting.pdf>>. Accessed on 16 June 2014.

TDI 2010 Transmission Developers, Inc. (TDI). 2010. Champlain Hudson Power Express HVDC Transmission Project Application for a Presidential Permit. 25 January 2010.

USACE 2013 U.S. Army Corps of Engineers (USACE). 2013. "Public Notice for the Proposed Champlain Hudson Power Express Project Section 404 Permit Application (NAN-2009-01089-EYA)." Available online: <<http://www.nan.usace.army.mil/Missions/Regulatory/RegulatoryPublicNotices/tabid/4166/Article/18814/nan-2009-01089-eya.aspx>>. Accessed 8 October 2013.

USEPA 2011 U.S. Environmental Protection Agency (USEPA). 2011. "Sensitivity of Freshwater Habitats." Available online: <<http://www.epa.gov/oem/content/learning/freshwat.htm>>. Accessed 11 November 2013.

USEPA 2012 USEPA. 2012. "Hudson River Dredging Data Website." Available online: <<http://www.hudsondredgingdata.com/>>. Accessed 7 June 2012.



- USFWS 2002 U.S. Fish and Wildlife Service (USFWS). 2002. "Fisheries of the Gulf of Maine: Winter Flounder Species Description." Available online: <[http://www.gma.org/fogm/P\\_americanus.htm](http://www.gma.org/fogm/P_americanus.htm)>. Accessed 16 October 2013.
- USFWS 2010 USFWS. 2010. Effects of oil on wildlife and habitat. Fact sheet. U.S. Fish and Wildlife Service, Washington, D.C.
- Wilber and Clarke 2001 Wilber, D.H. and D.G. Clarke. 2001. Biological Effects of Suspended Sediments: A Review of Suspended Sediment Impacts on Fish and Shellfish with Relation to Dredging Activities in Estuaries. *North American Journal of Fisheries Management* 21:855-875.
- Wilber et al. 2005 Wilber, D.H., W. Brostoff, D.G. Clarke, and G.L. Ray. 2005. *Sedimentation: Potential biological effects from dredging operations in estuarine and marine environments*. May 2005.
- Winnicki et al. 2004 Winnicki, A., A. Korzelecka-Orkisz, A. Sobocinski, A. Tanski, and K. Formicki. 2004. Effects of the Magnetic Field on Different Forms of Embryonic Locomotor Activity of Northern Pike, *Esox lucius* L. *Acta Ichthyologica et Piscatoria* 34(2):193–203.
- WHO 2012 World Health Organization (WHO). 2012. "What are Electromagnetic Fields?" Available online: <<http://www.who.int/peh-emf/about/WhatisEMF/en/index1.html>>. Accessed 2 August 2012.
- Zhang et al. 2012 Zhang, X., J. Song, C. Fan, H. Guo, X. Wang, and H. Bleckman. 2012. Use of Electrosense in Sturgeon. *Integrative Zoology* 7:74–82.



***THIS PAGE INTENTIONALLY LEFT BLANK***

# **ATTACHMENT 1**

## **RESOURCES ALONG THE PROPOSED CHPE PROJECT ROUTE IN THE HUDSON RIVER**





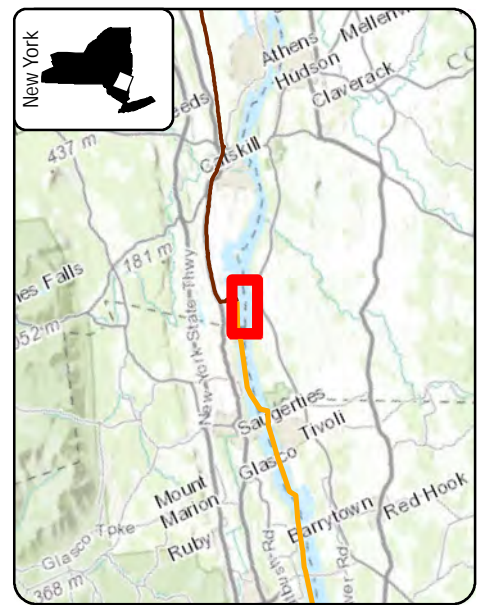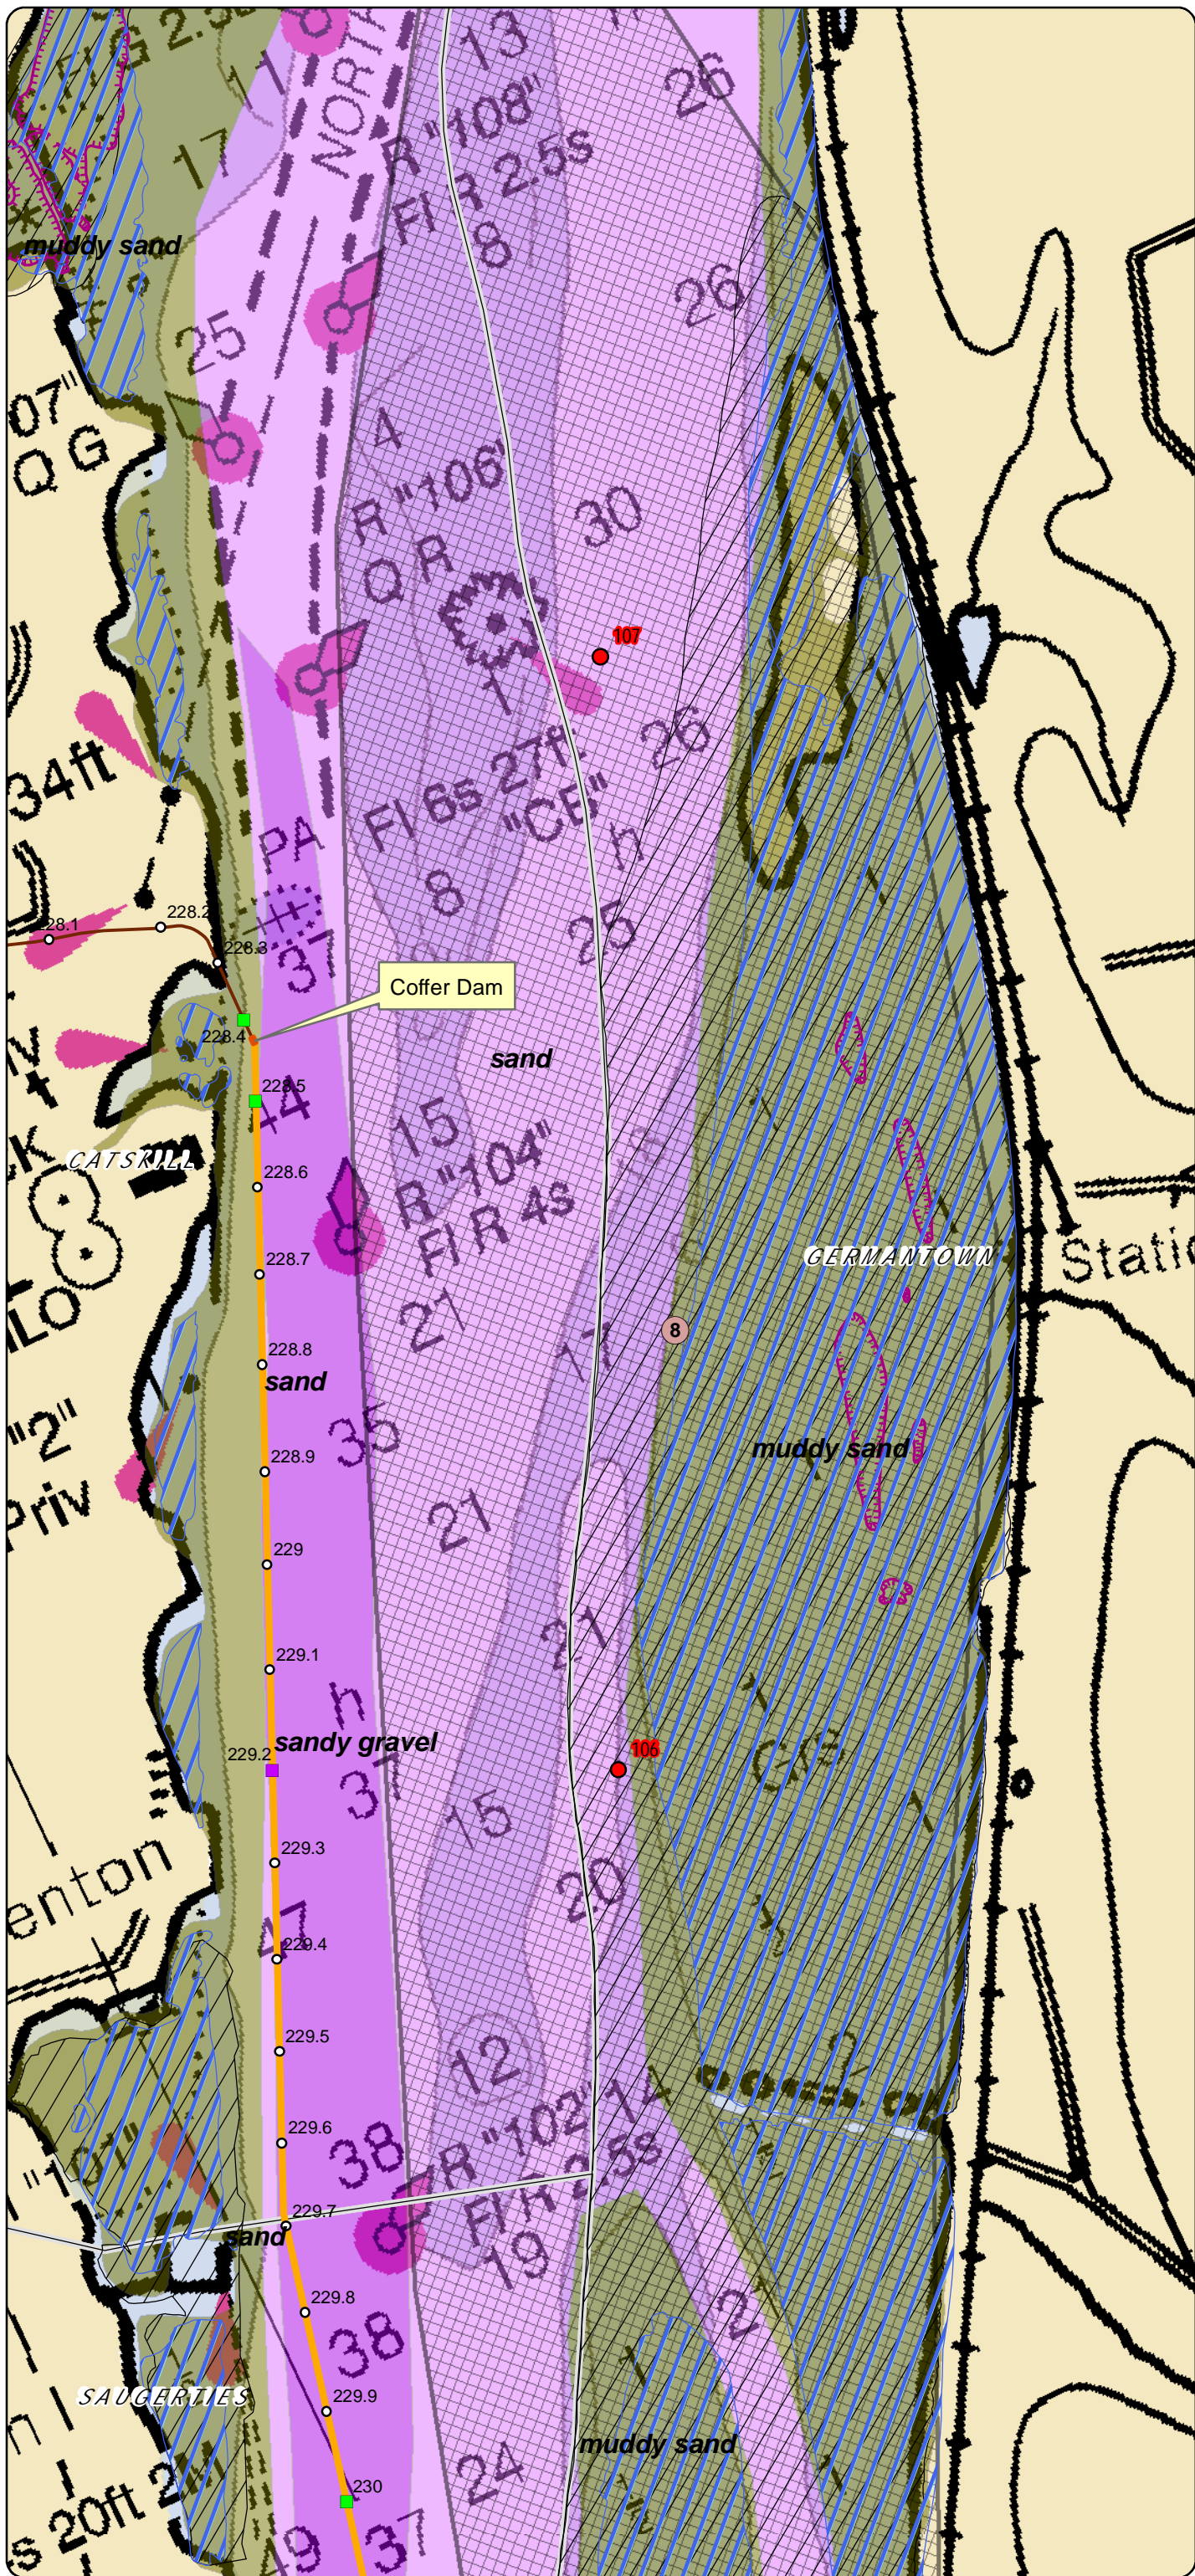

### LEGEND

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC)  Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

#### Sediment Type - NYSDEC Hudson River Estuary Program

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud
- State Boundary
- County Boundary
- Town Boundary

Transmission  
Developers Inc.

Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*

---

## Hudson River Project Route



Sheet 1 of 43

---

Created: 6/18/2014

by: &



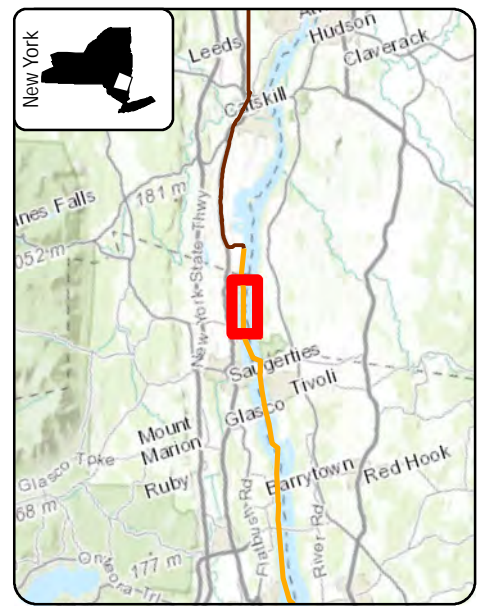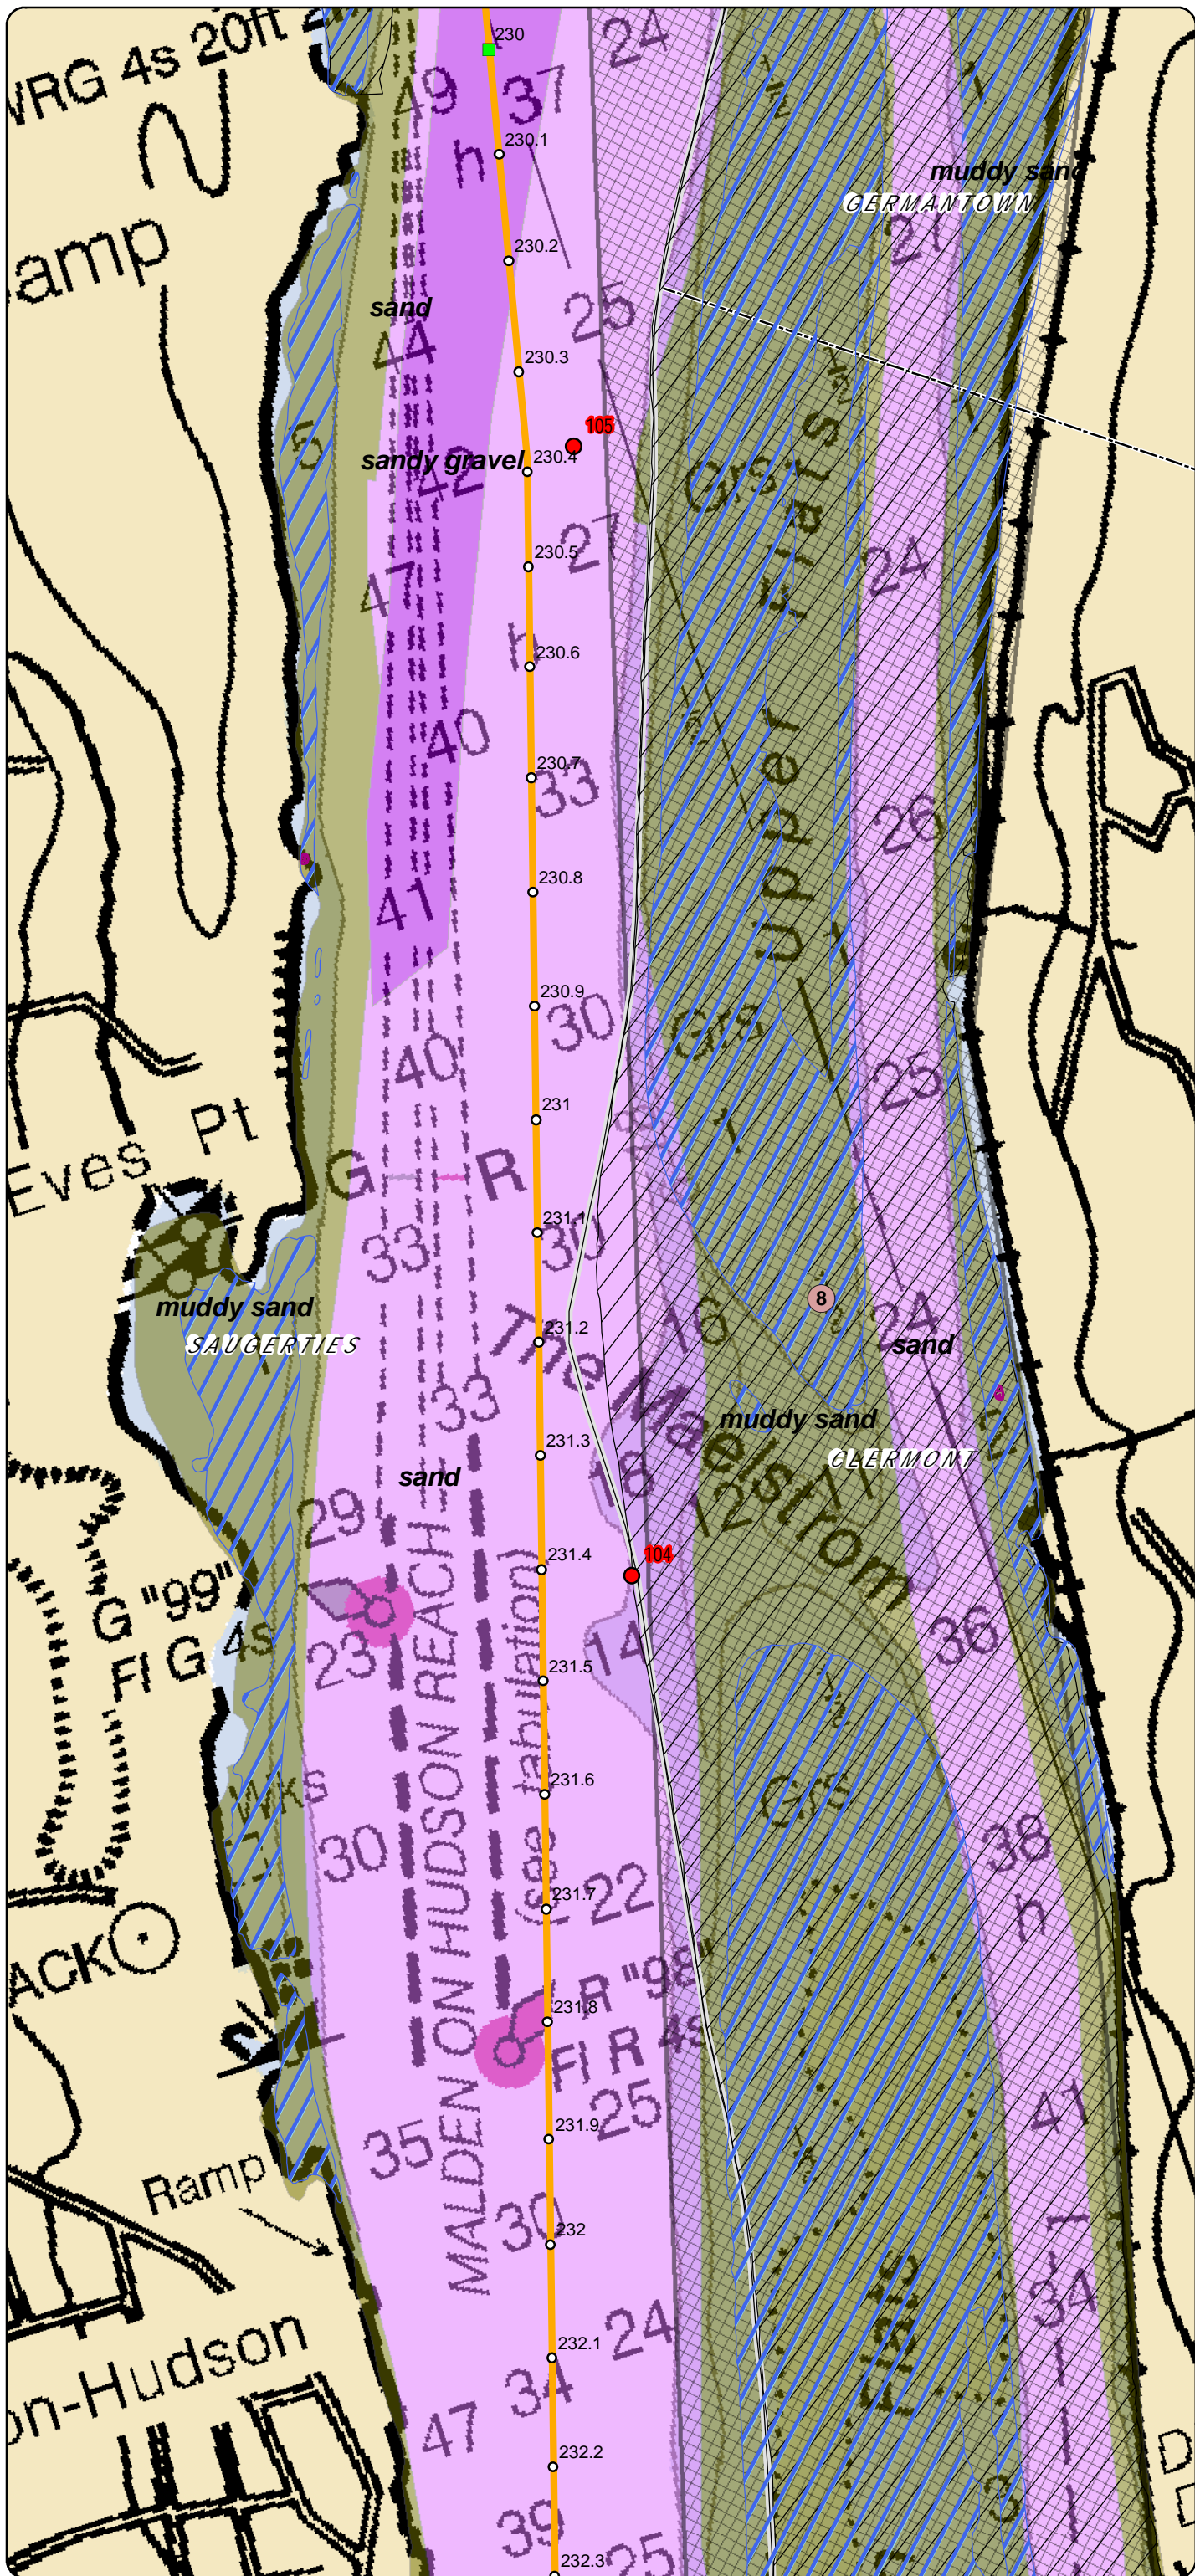

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

0 750  
 Feet

Transmission  
 Developers Inc.  
 Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*  




---

**Hudson River Project Route**  
 Sheet 2 of 43  


---

 Created: 6/18/2014  
 by: &



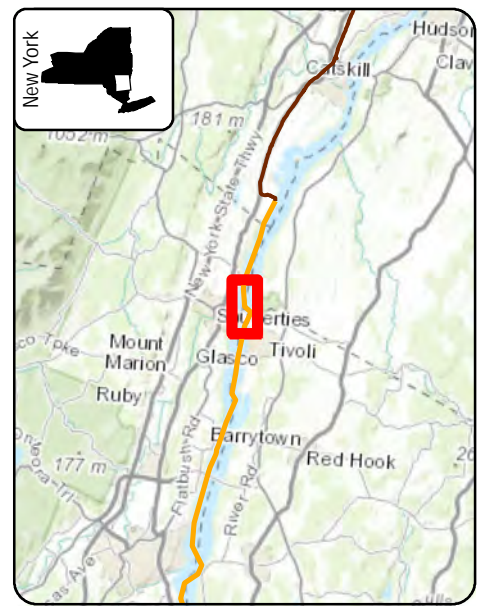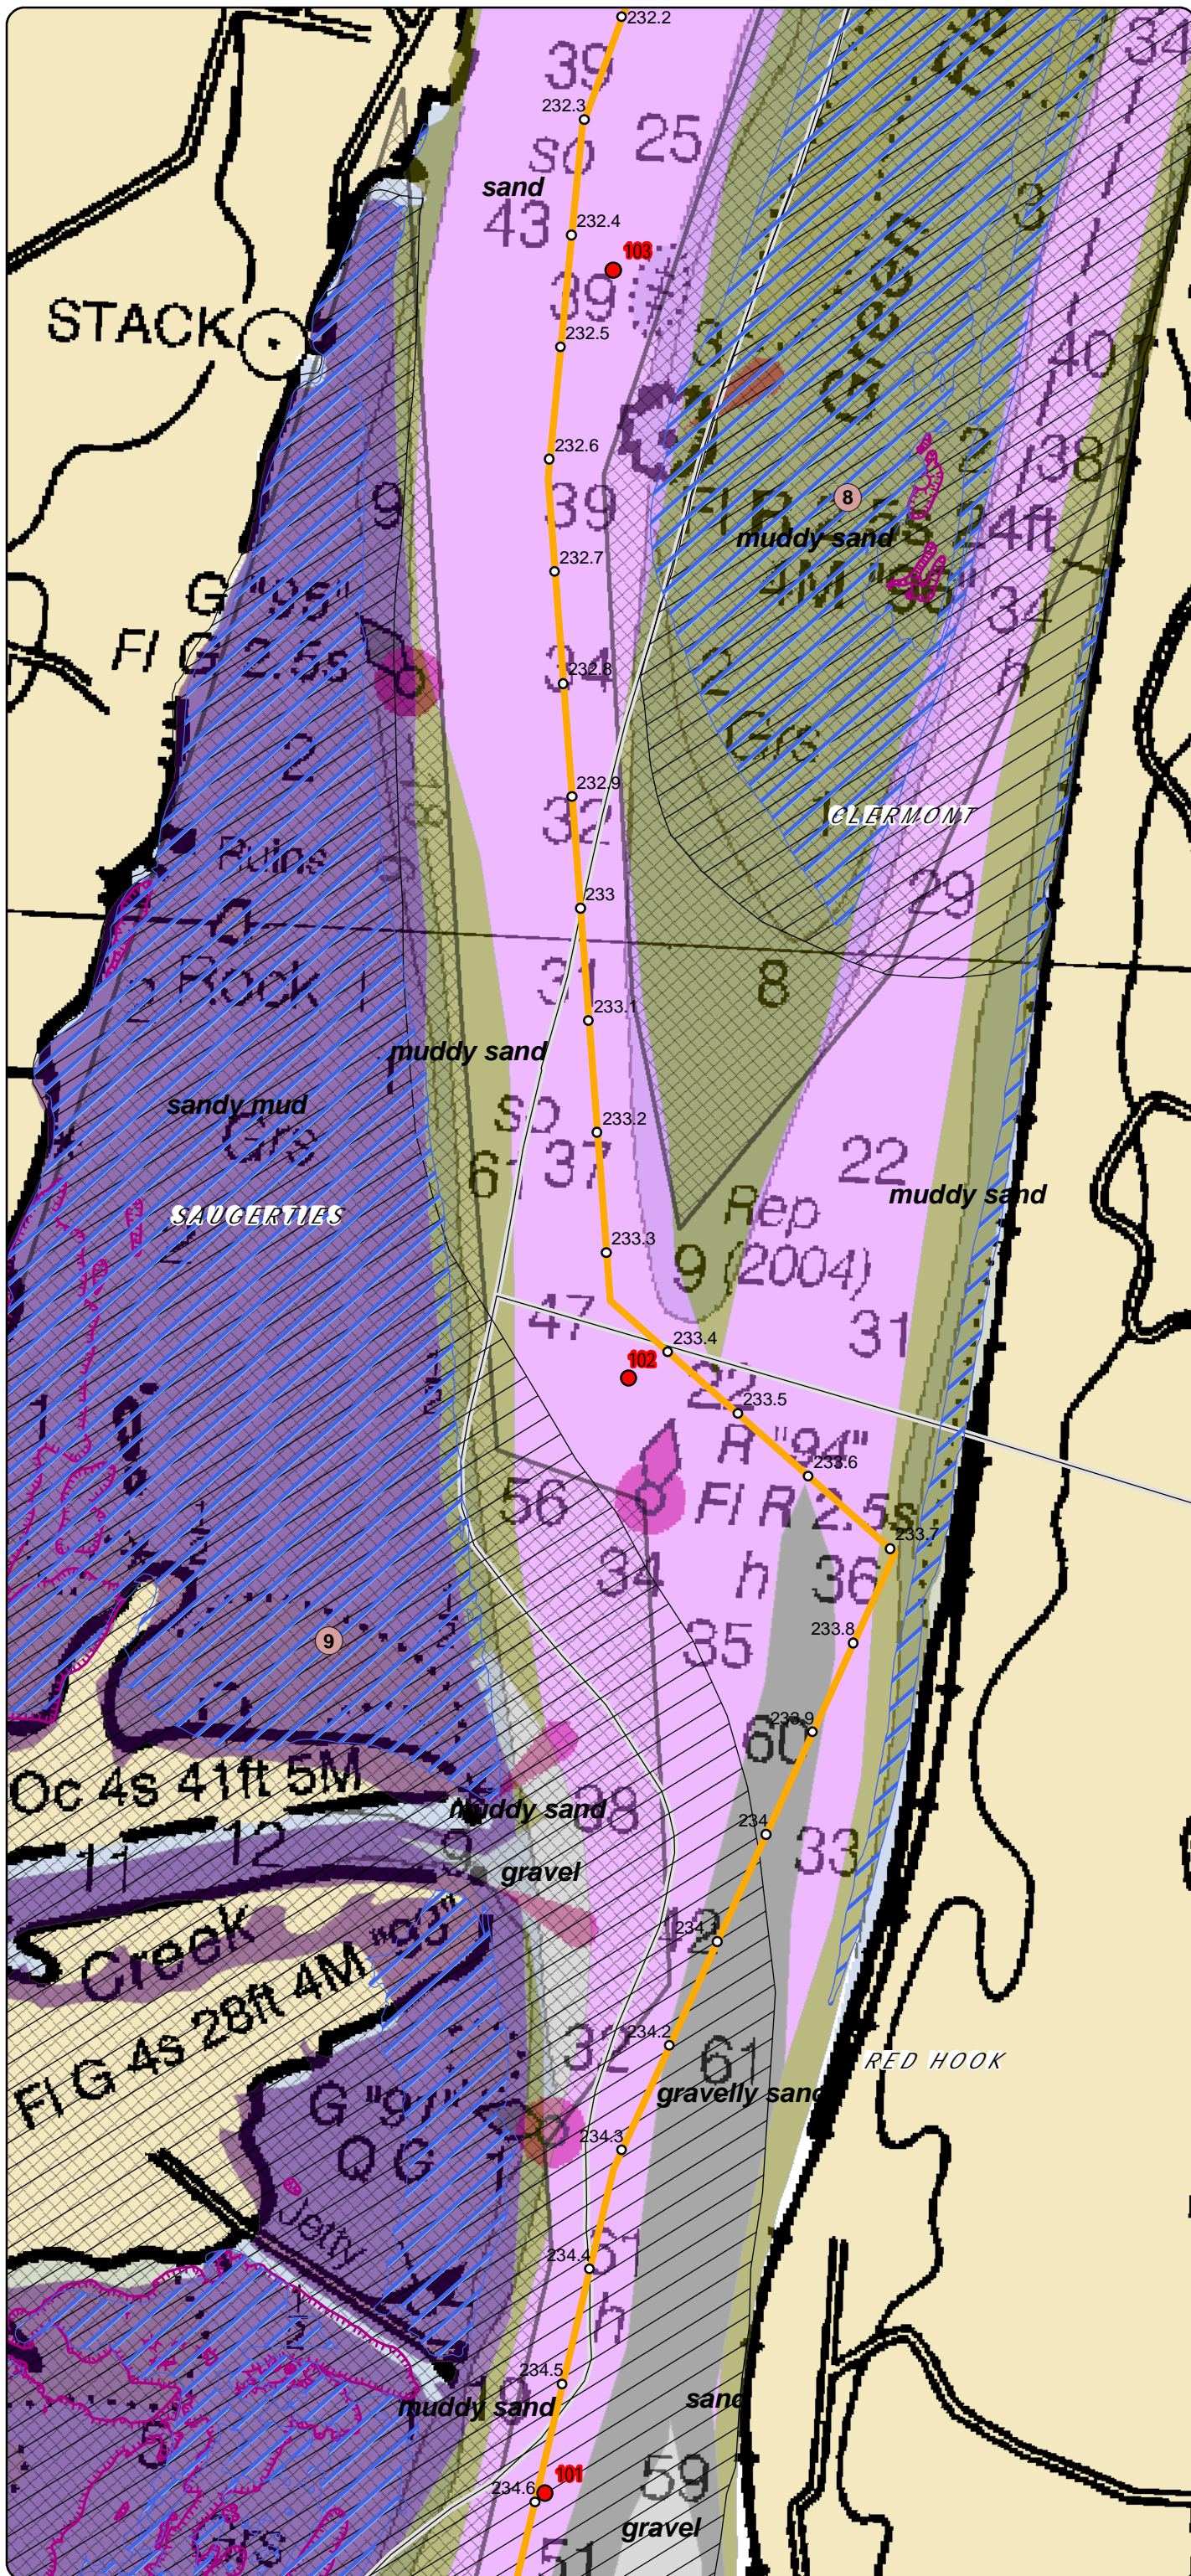

### LEGEND

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC)  Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

#### Sediment Type - NYSDEC Hudson River Estuary Program

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

0 750  
Feet

**Transmission Developers Inc.**

Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*

---



**Hudson River Project Route**  
Sheet 3 of 43

---

Created: 6/18/2014

by: **HDR** **UTA** & **CTRC**



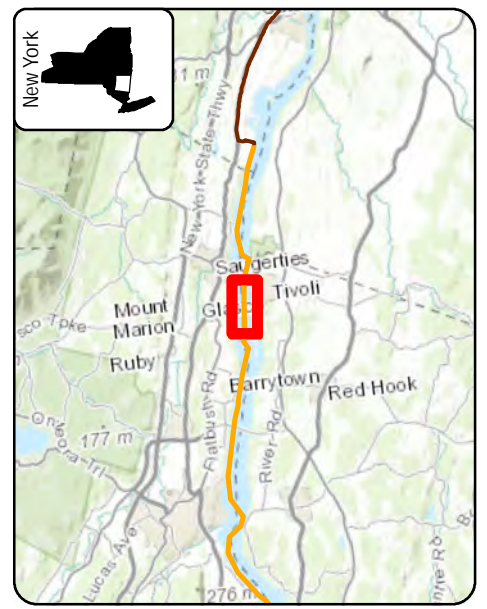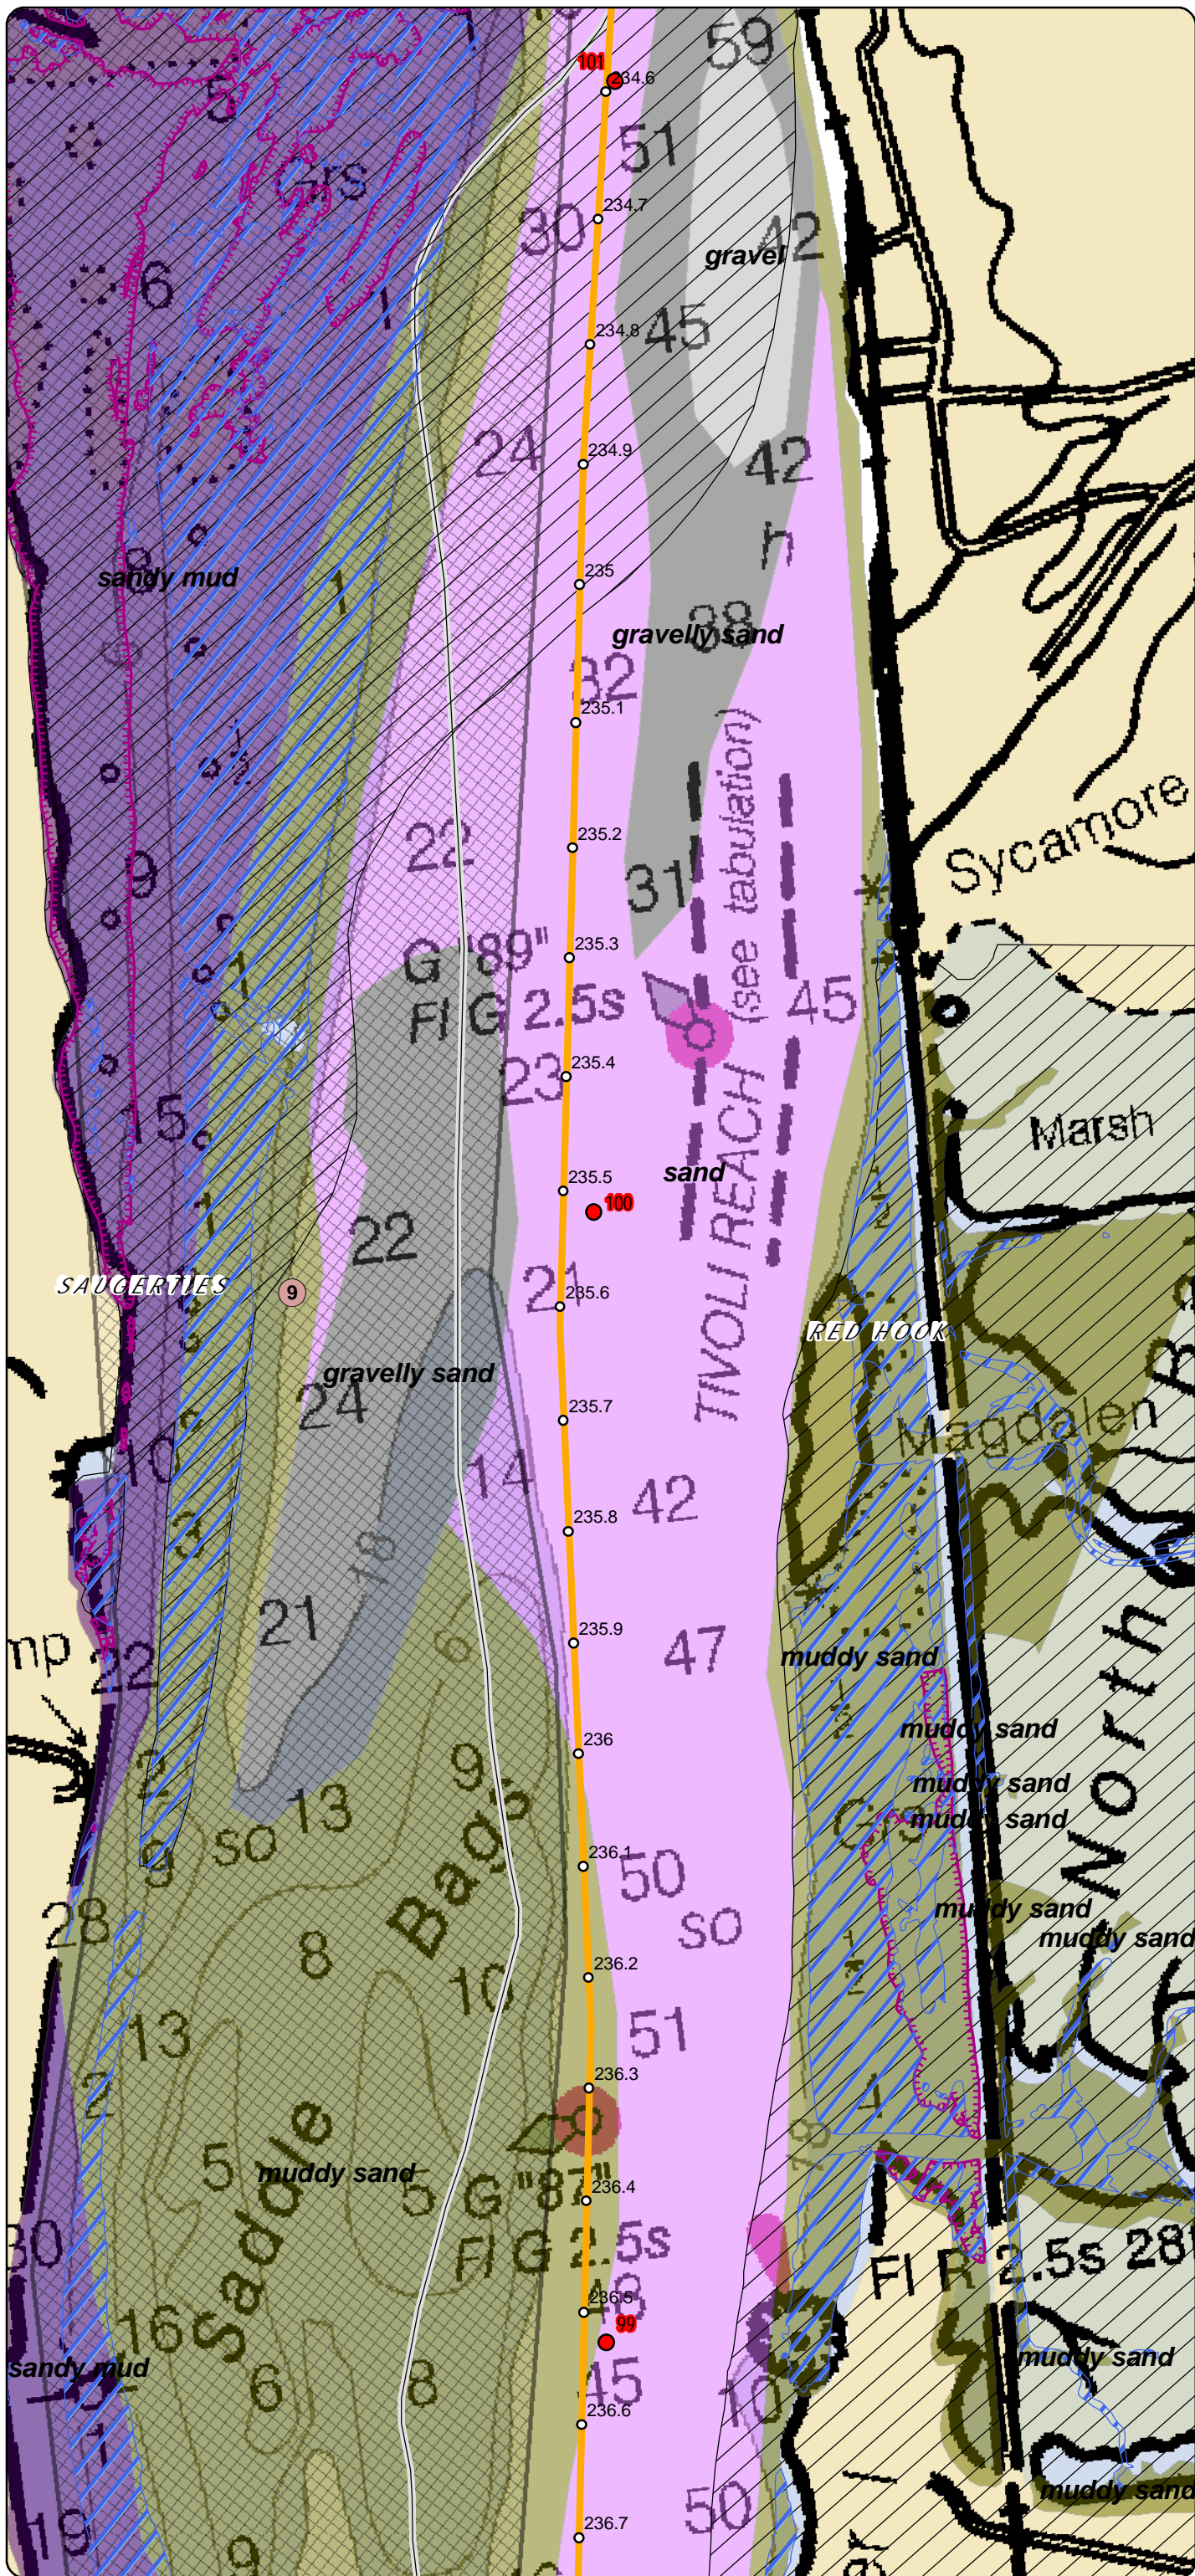

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC)  Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

0 750  
 Feet

**Transmission Developers Inc.**  
 Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*



---

**Hudson River Project Route**  
 Sheet 4 of 43

---

Created: 6/18/2014  
 by: &



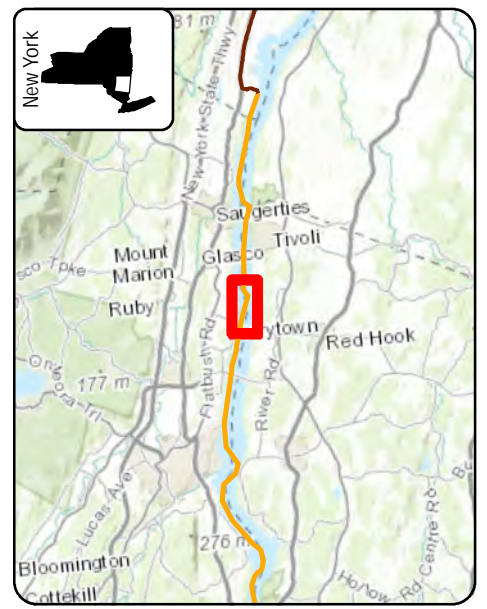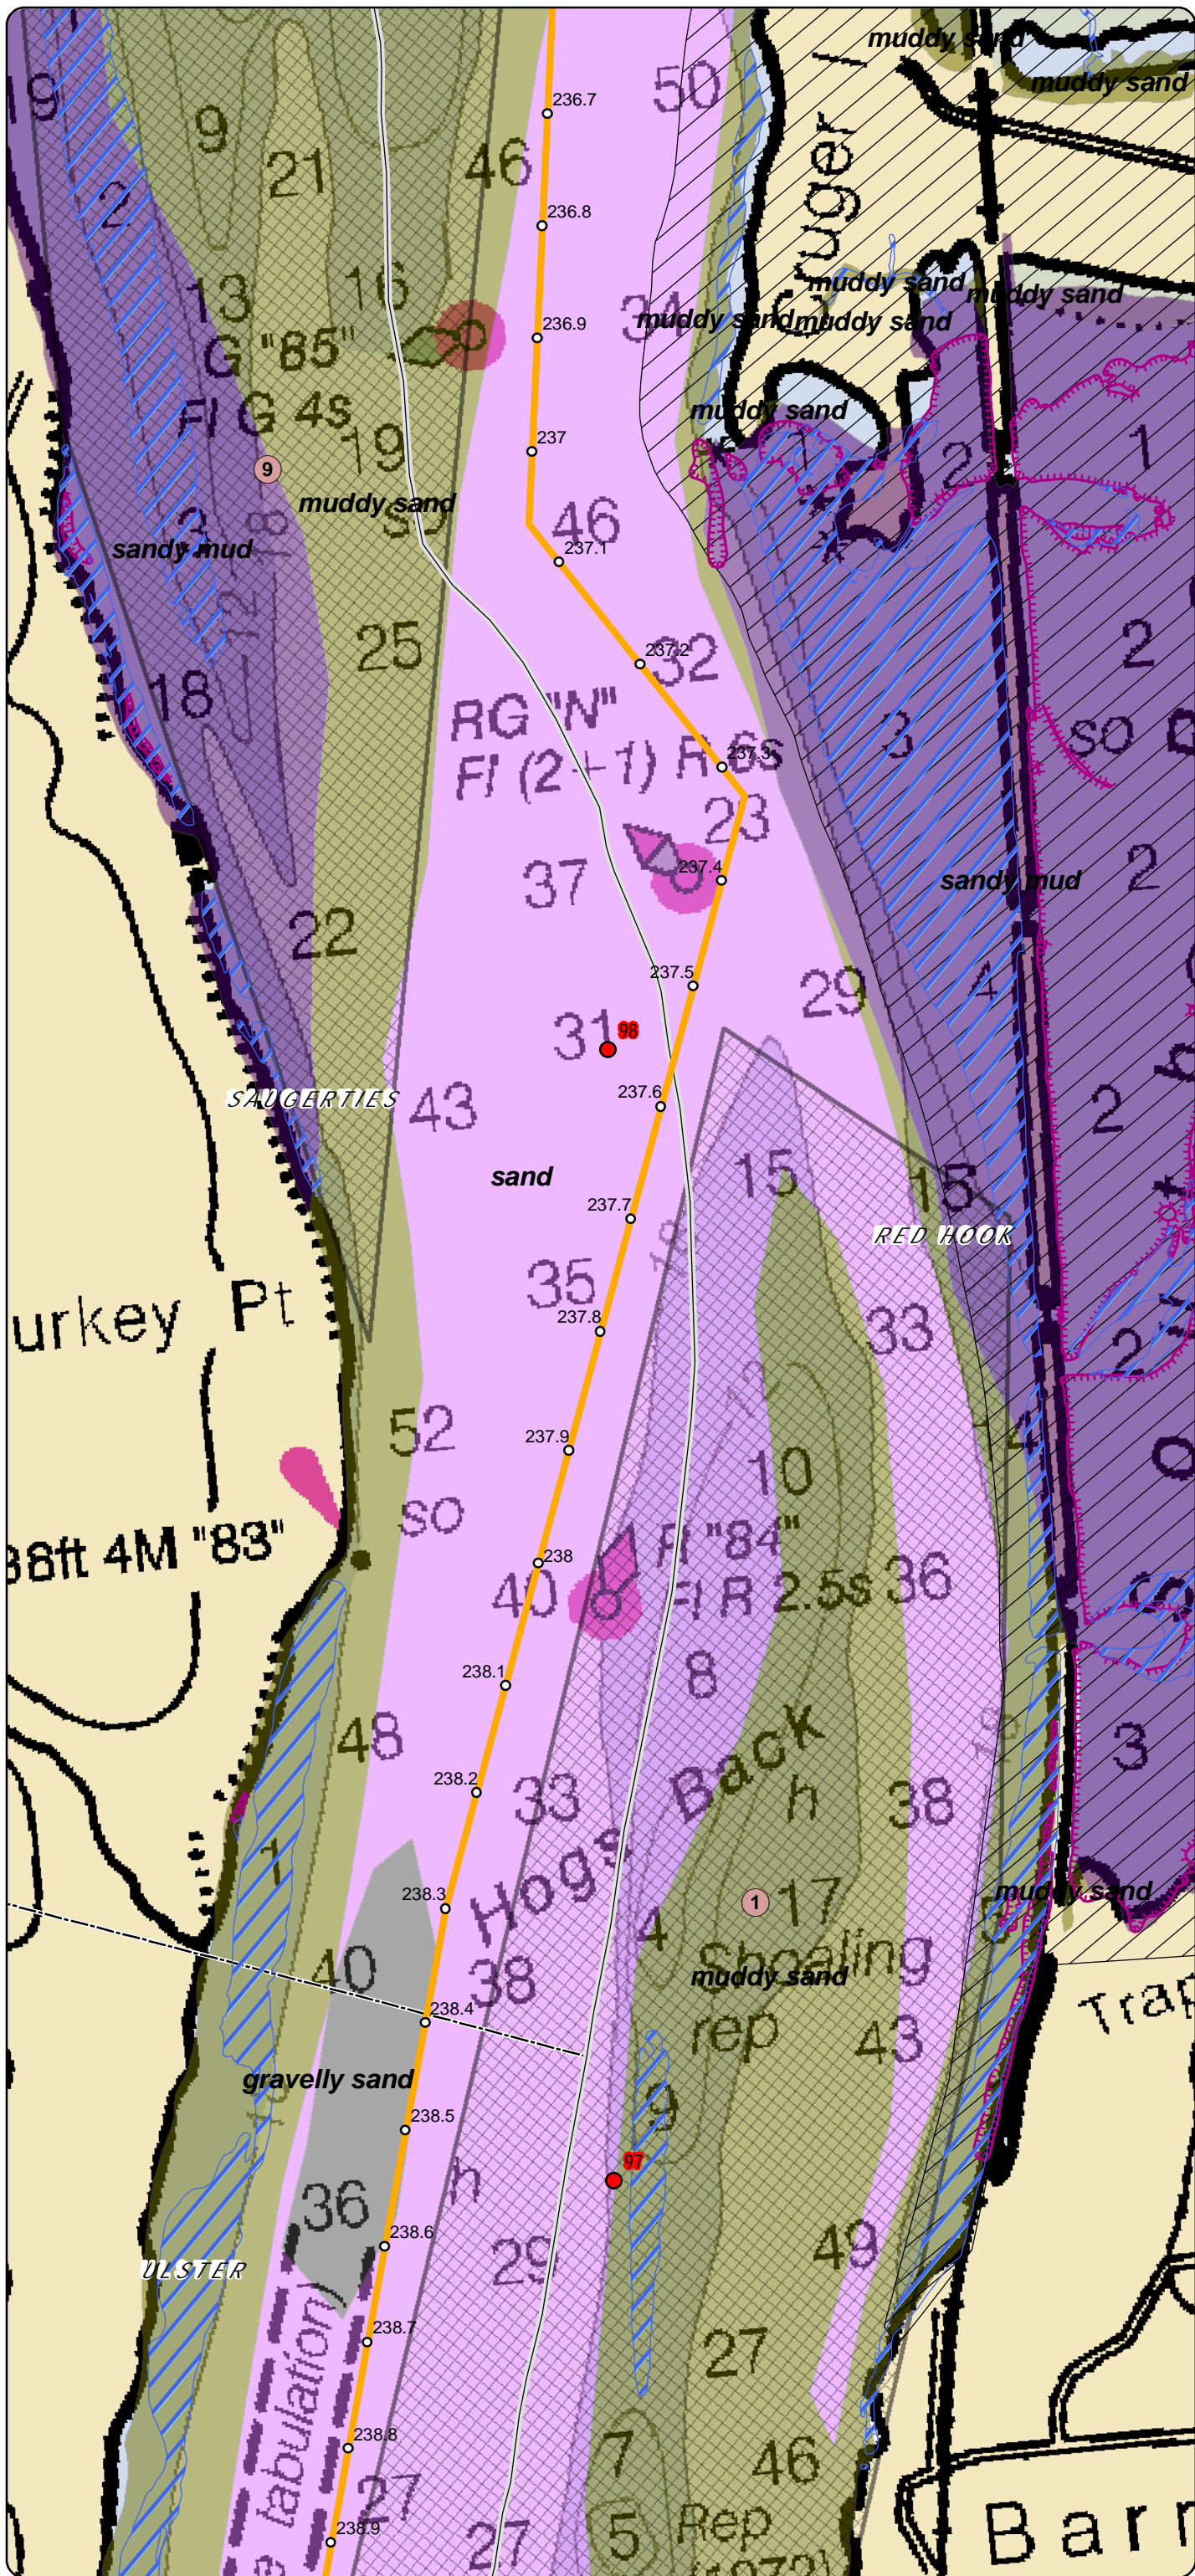

### LEGEND

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

#### Sediment Type - NYSDEC Hudson River Estuary Program

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

0 750  
Feet

Transmission  
Developers Inc.

Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*

---

**Hudson River  
Project Route**



Sheet 5 of 43

---

Created: 6/18/2014

by: &



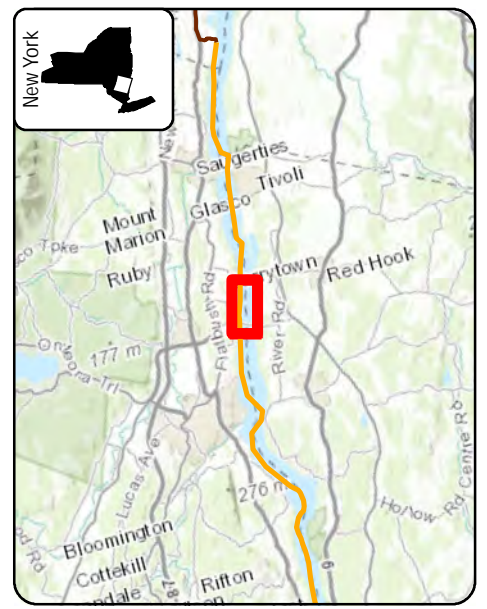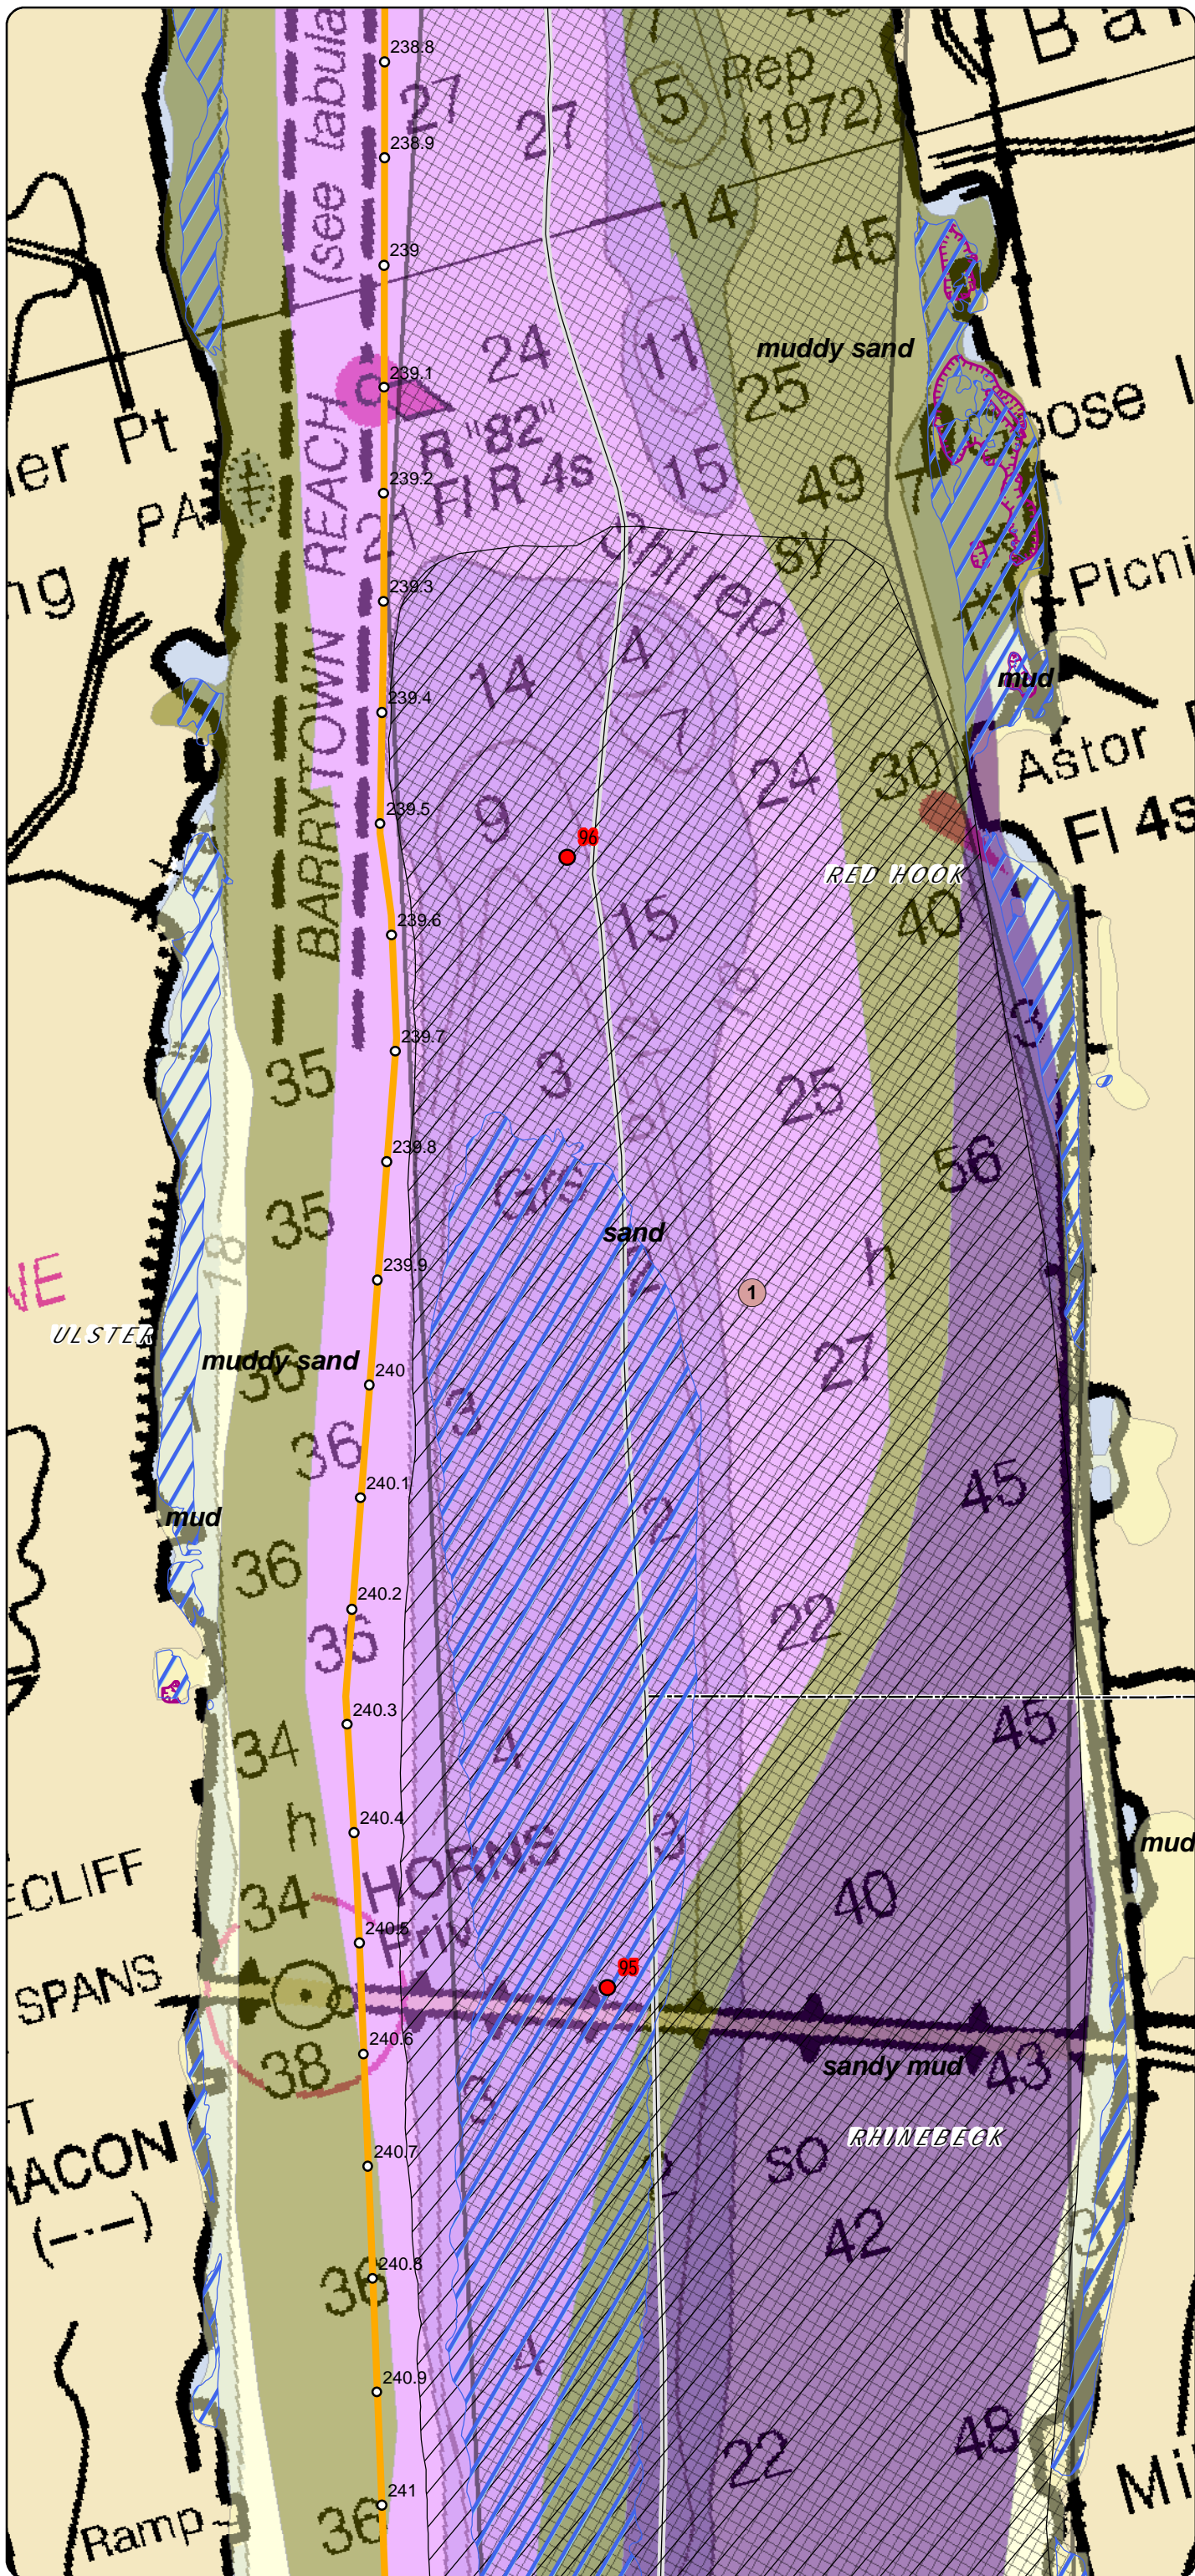

**LEGEND**




- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**



- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

0 750  
Feet

  
 Transmission Developers Inc.  
 Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*  
**Hudson River Project Route**  
 Sheet 6 of 43  
 Created: 6/18/2014  
 by:   & 



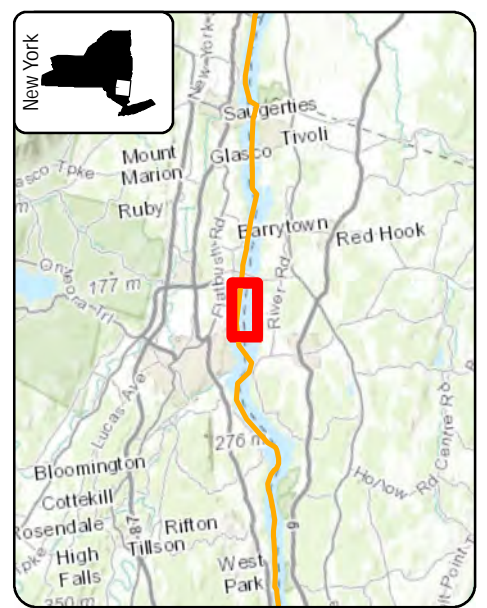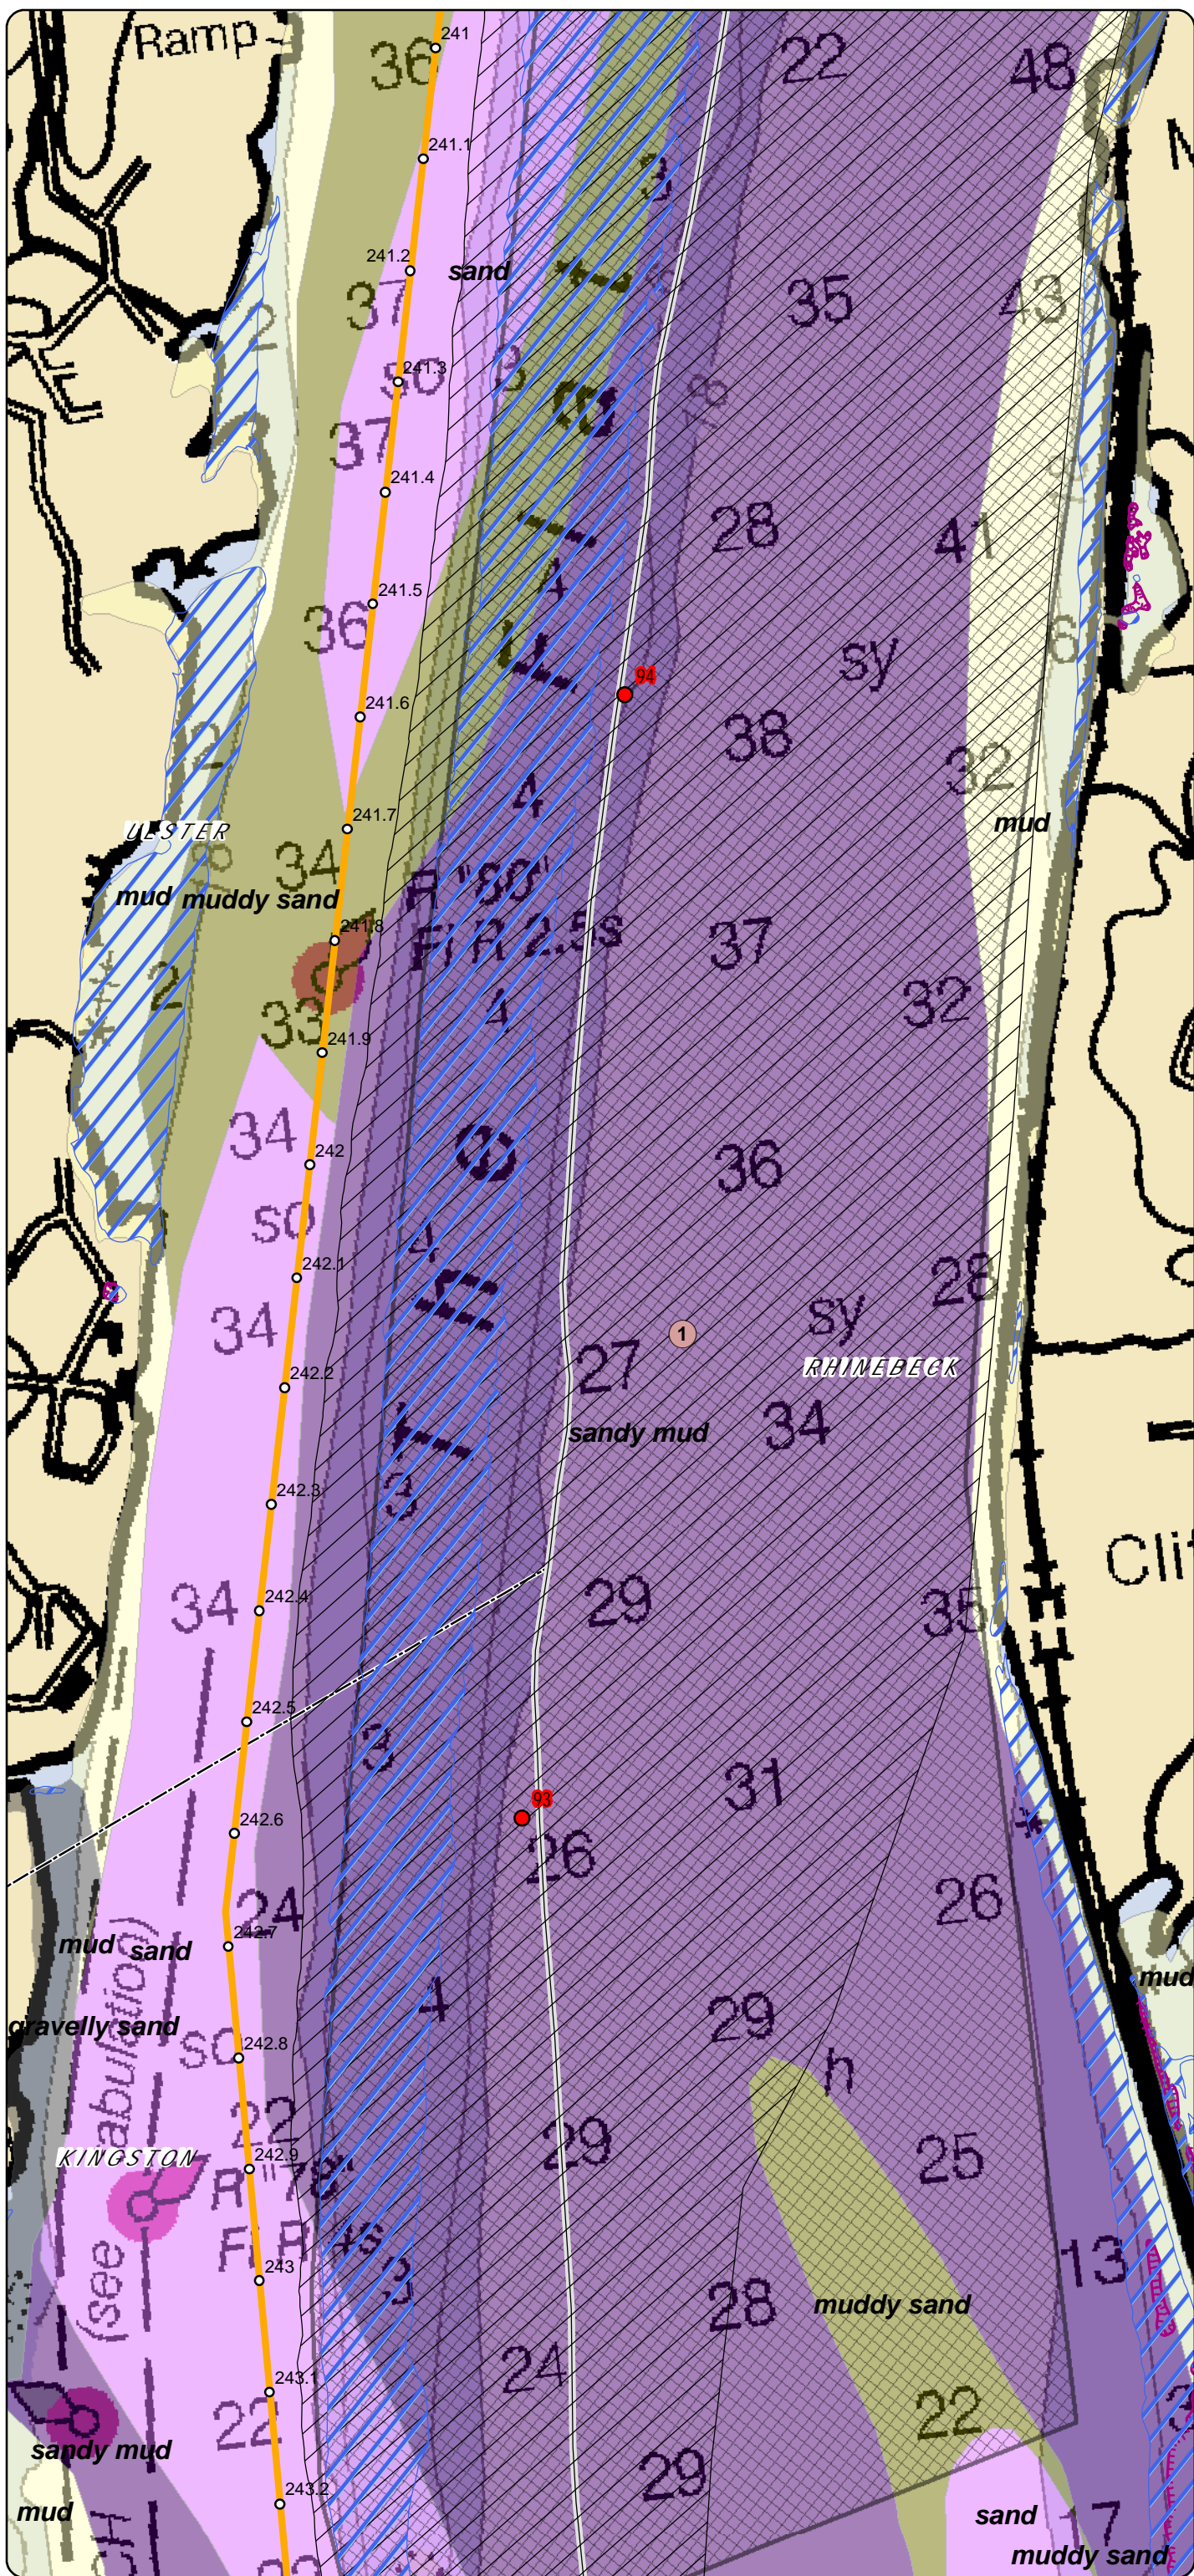

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

0 750  
Feet

**Transmission Developers Inc.**

Champlain Hudson Power Express Project  
Champlain Hudson Power Express Inc.


---

**Hudson River Project Route**  
Sheet 7 of 43

---

Created: 6/18/2014  
by: **HDR** **UTA** & **CTRC**



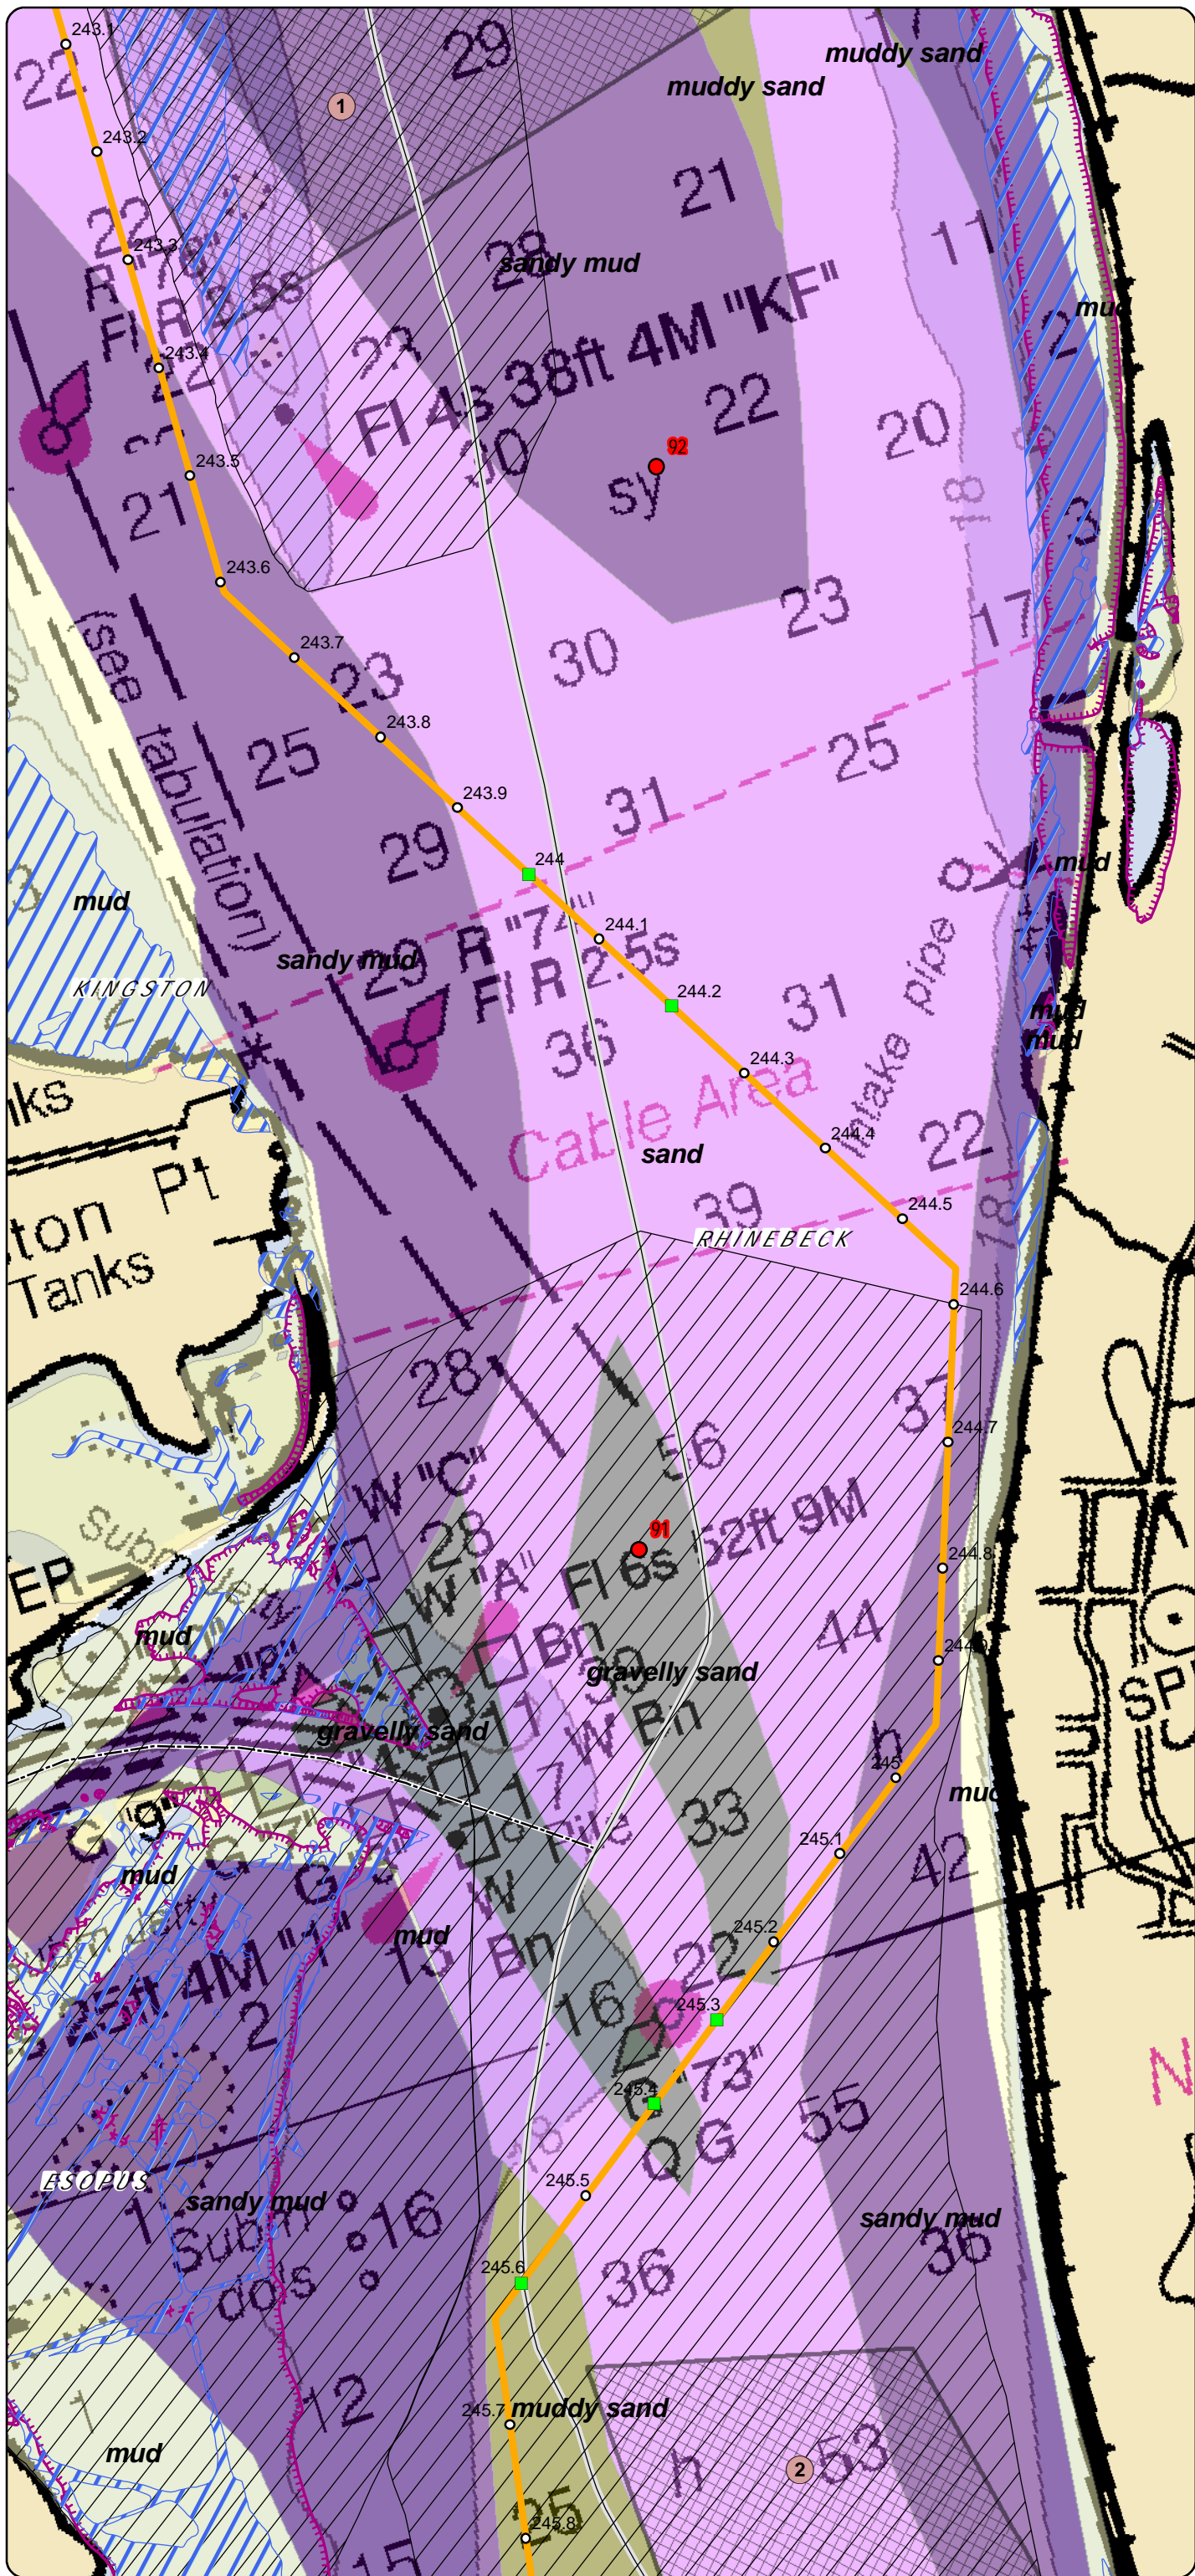

### LEGEND

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC)  Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

### Sediment Type - NYSDEC Hudson River Estuary Program

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud
- State Boundary
- County Boundary
- Town Boundary

0 750  
Feet

**Transmission Developers Inc.**

Champlain Hudson Power Express Project  
Champlain Hudson Power Express Inc.

---



## Hudson River Project Route

Sheet 8 of 43

Created: 6/18/2014

by: **HDR** **PTA** & **CTRC**



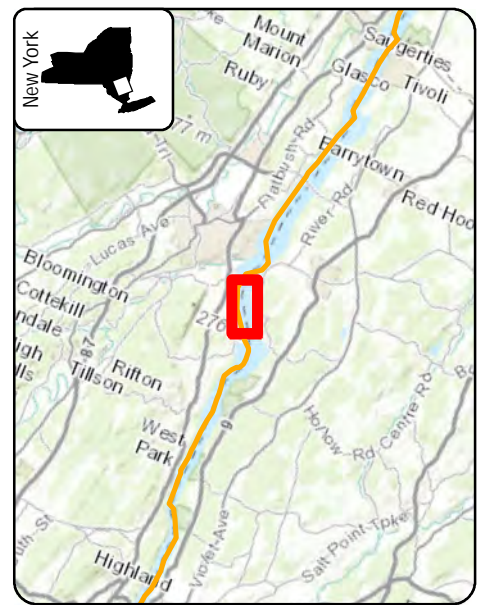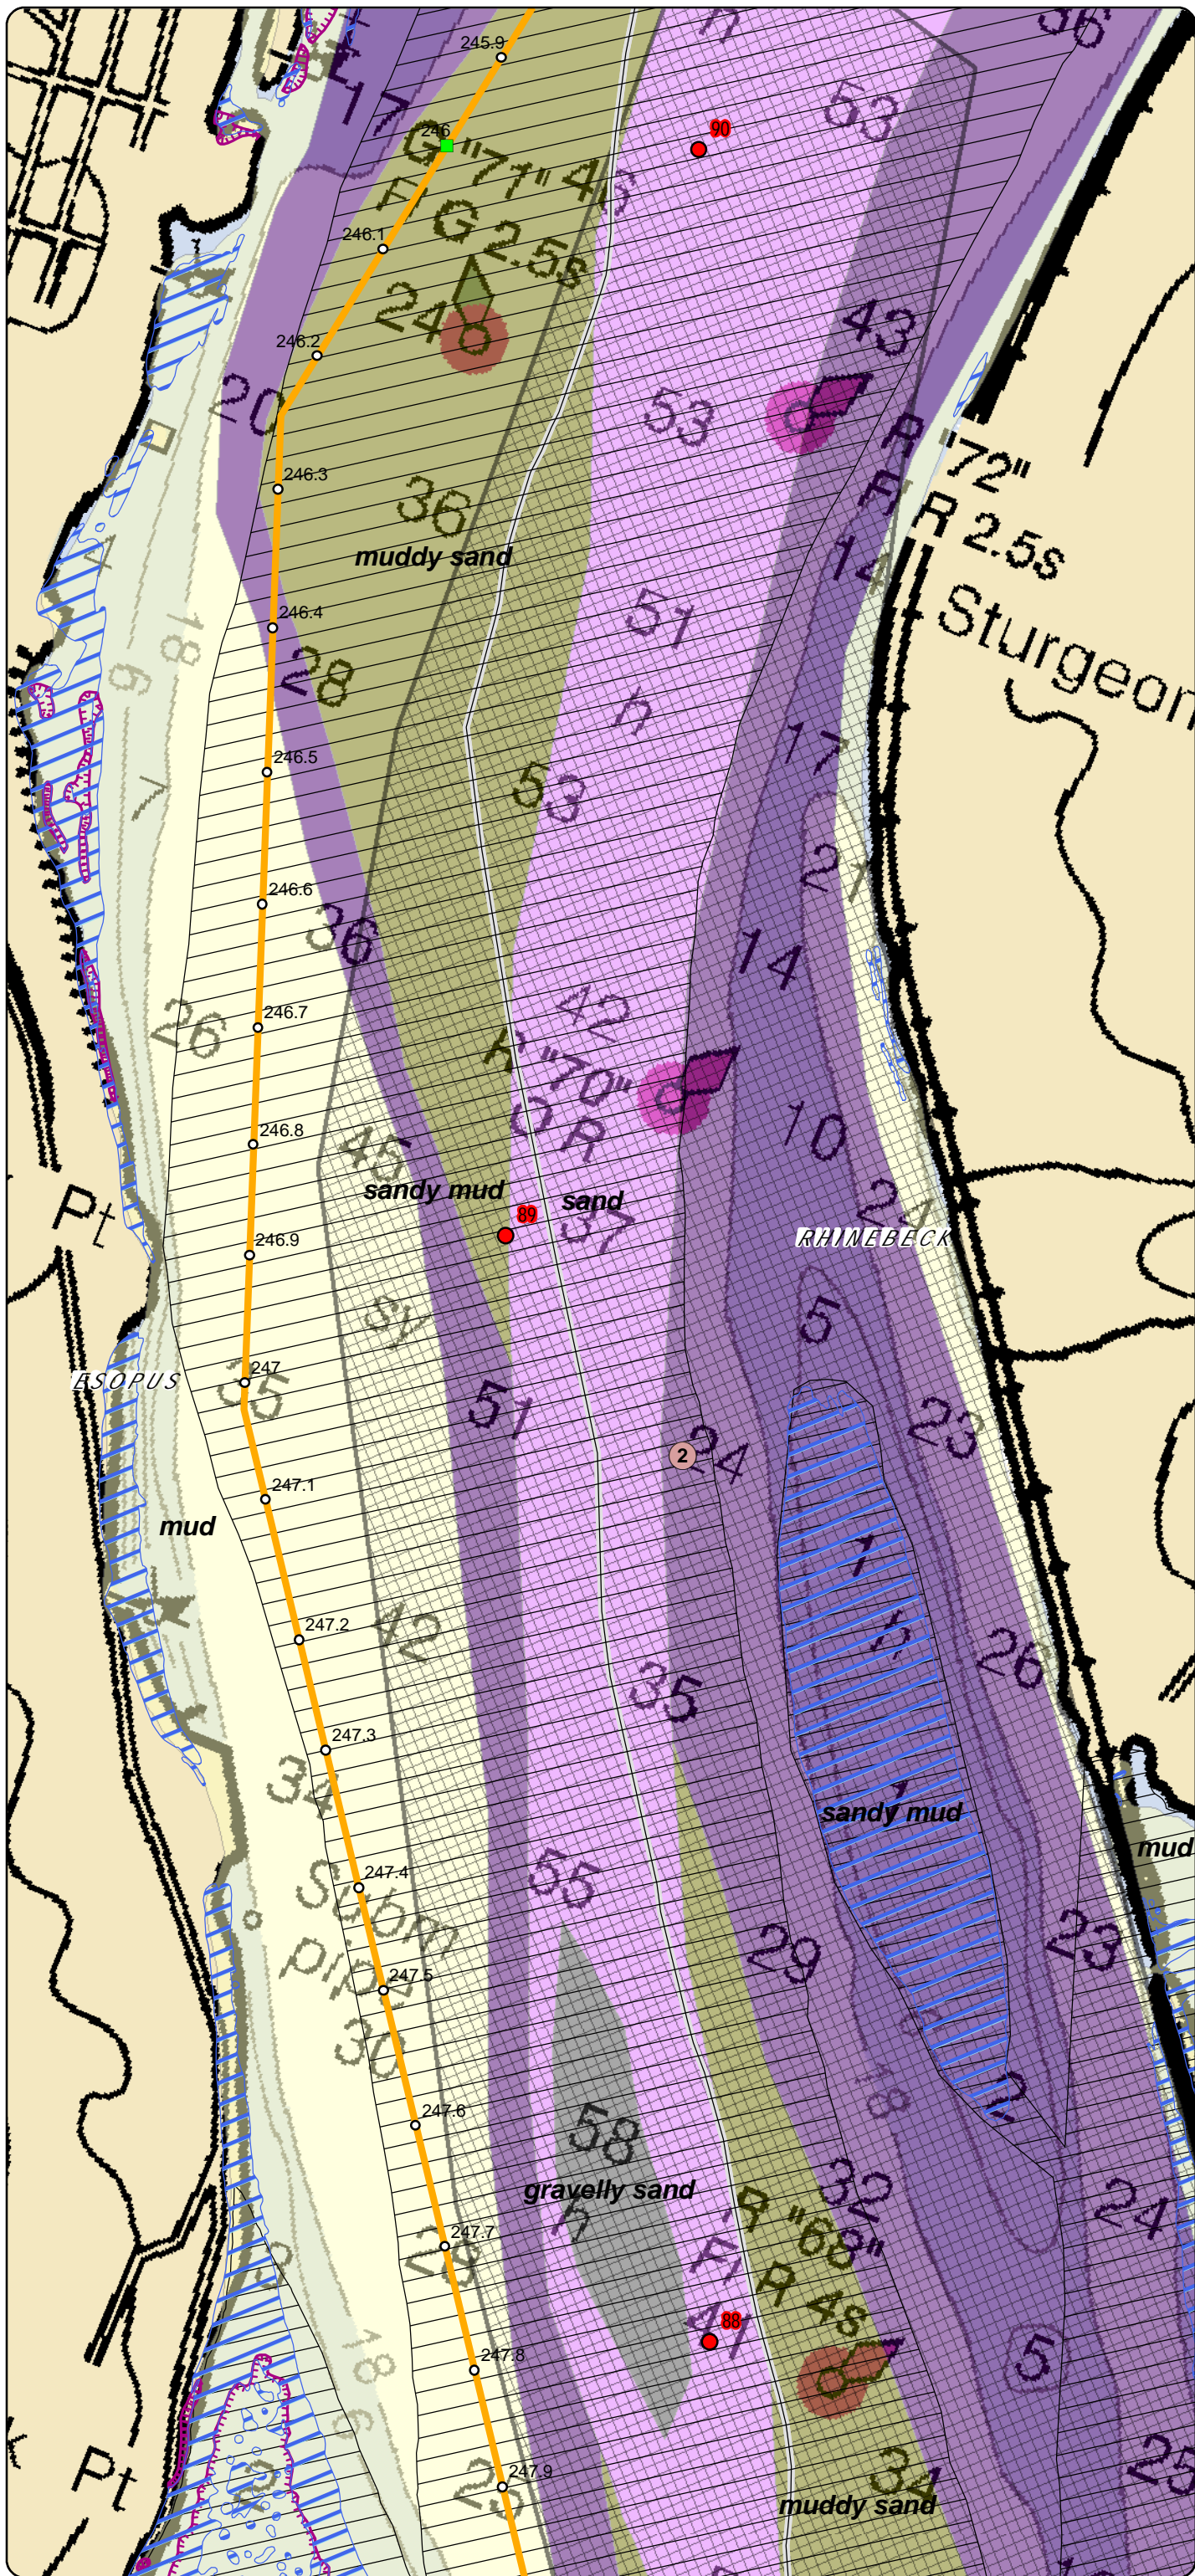

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- 1 CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud
- State Boundary
- County Boundary
- Town Boundary


0 750  
Feet

  
**Transmission Developers Inc.**  
 Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*



---

**Hudson River Project Route**  
 Sheet 9 of 43

---

Created: 6/18/2014  
 by:   & 



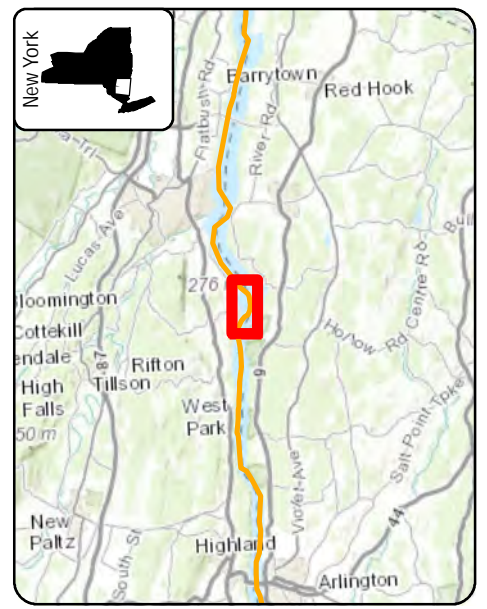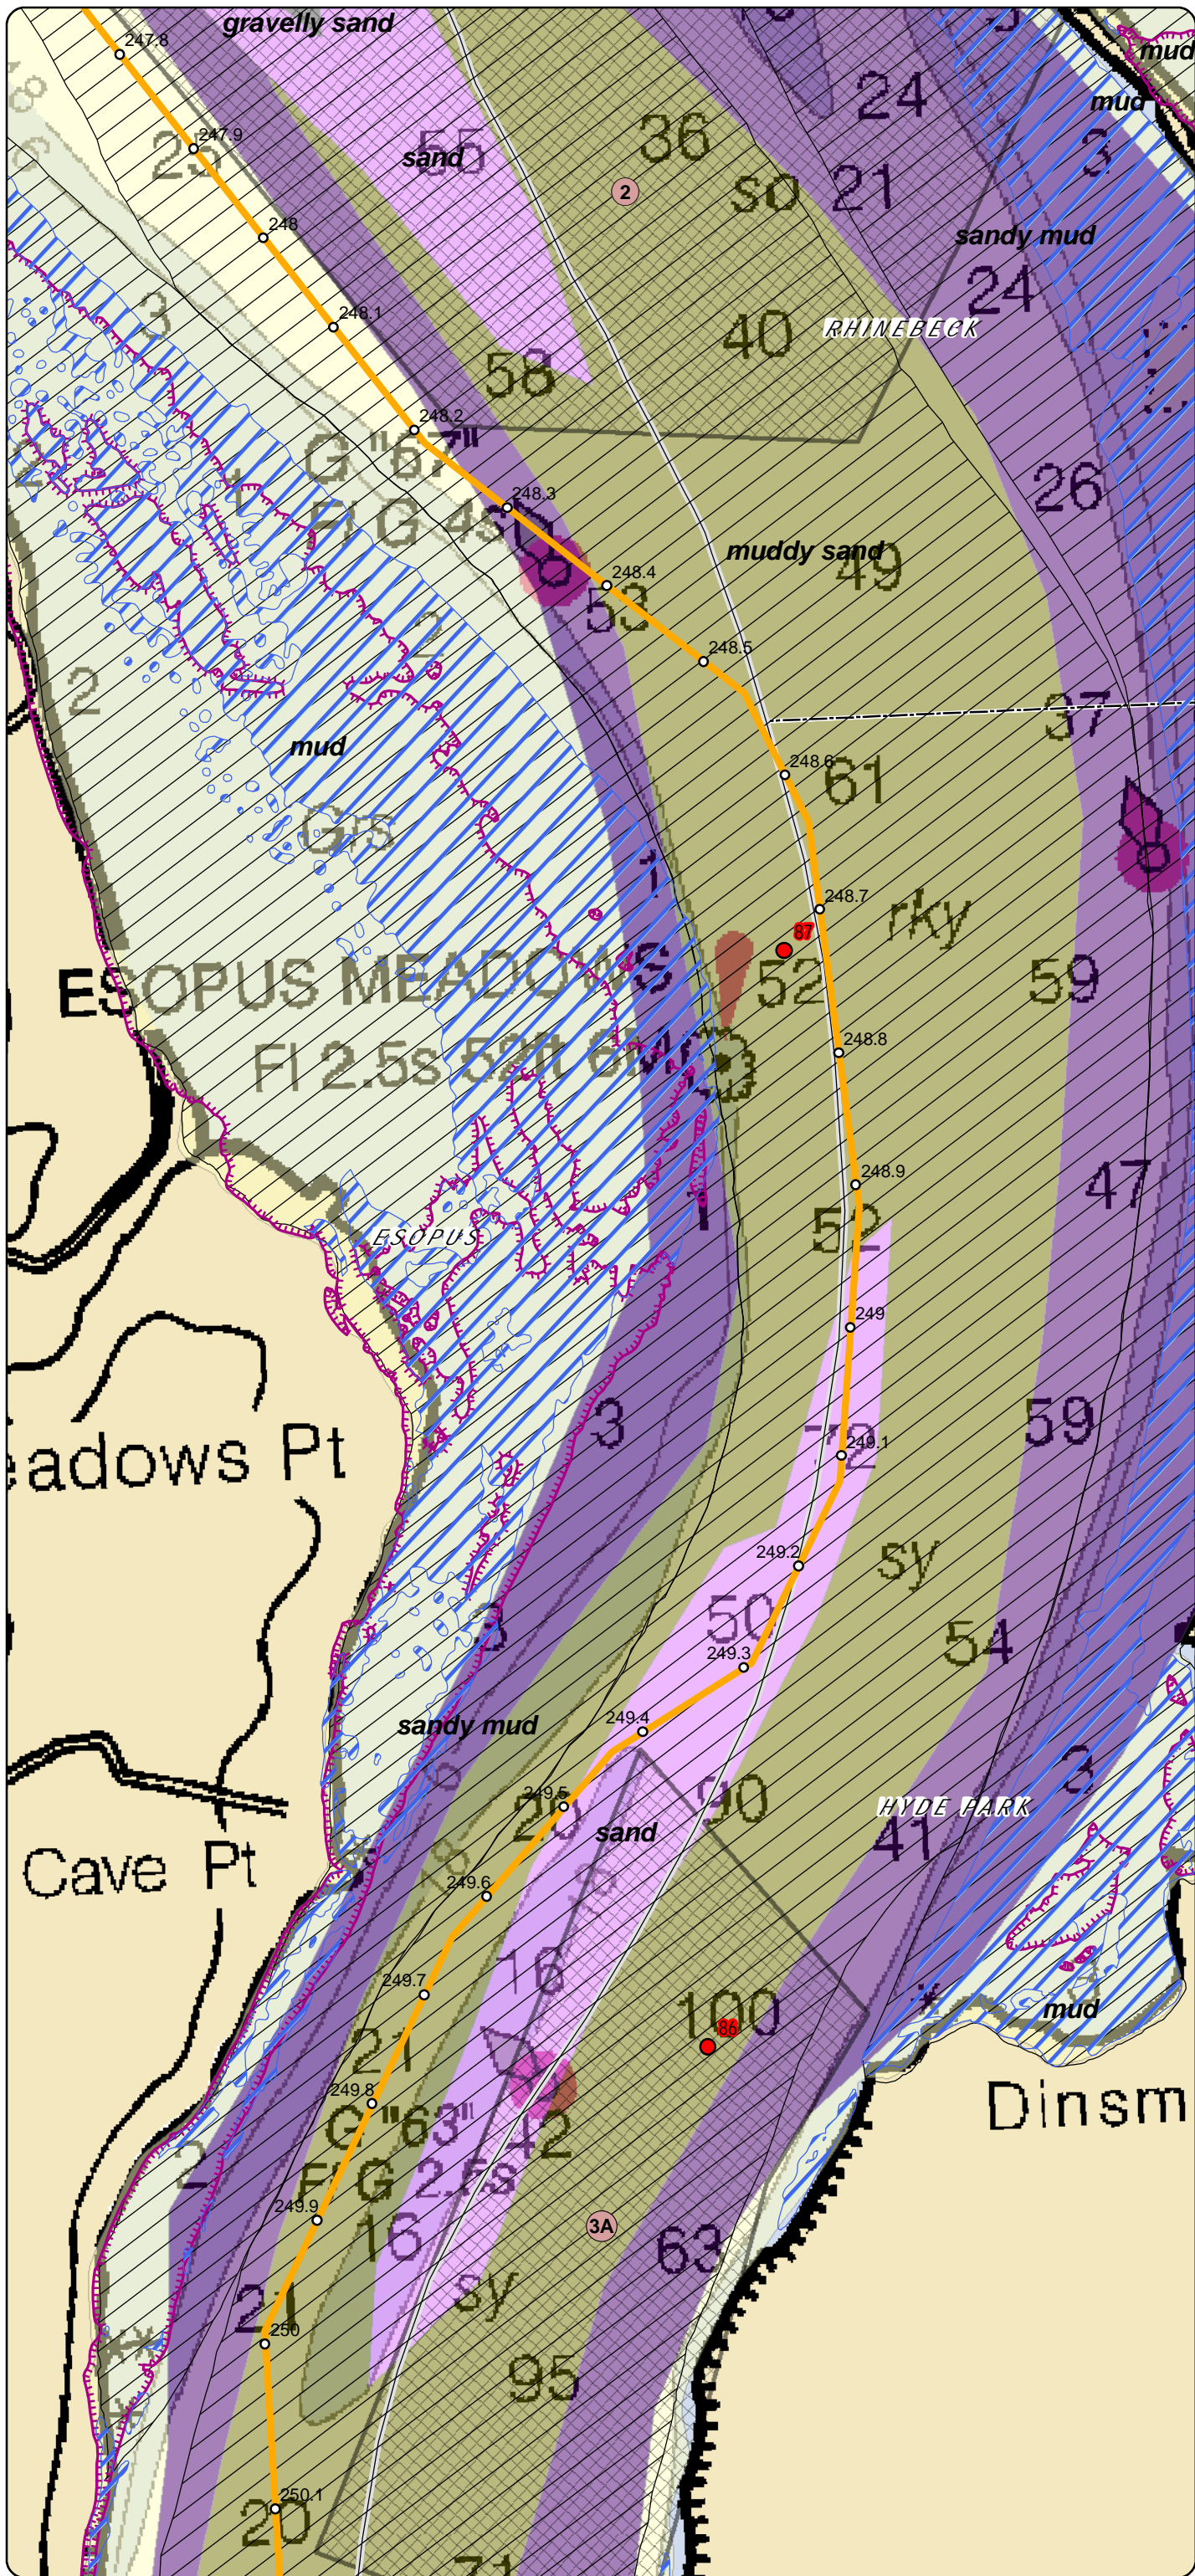

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- 1 CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC)  4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

0 750  
Feet

Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*


---

**Hudson River Project Route**  
 Sheet 10 of 43

---

Created: 6/18/2014  
 by: &



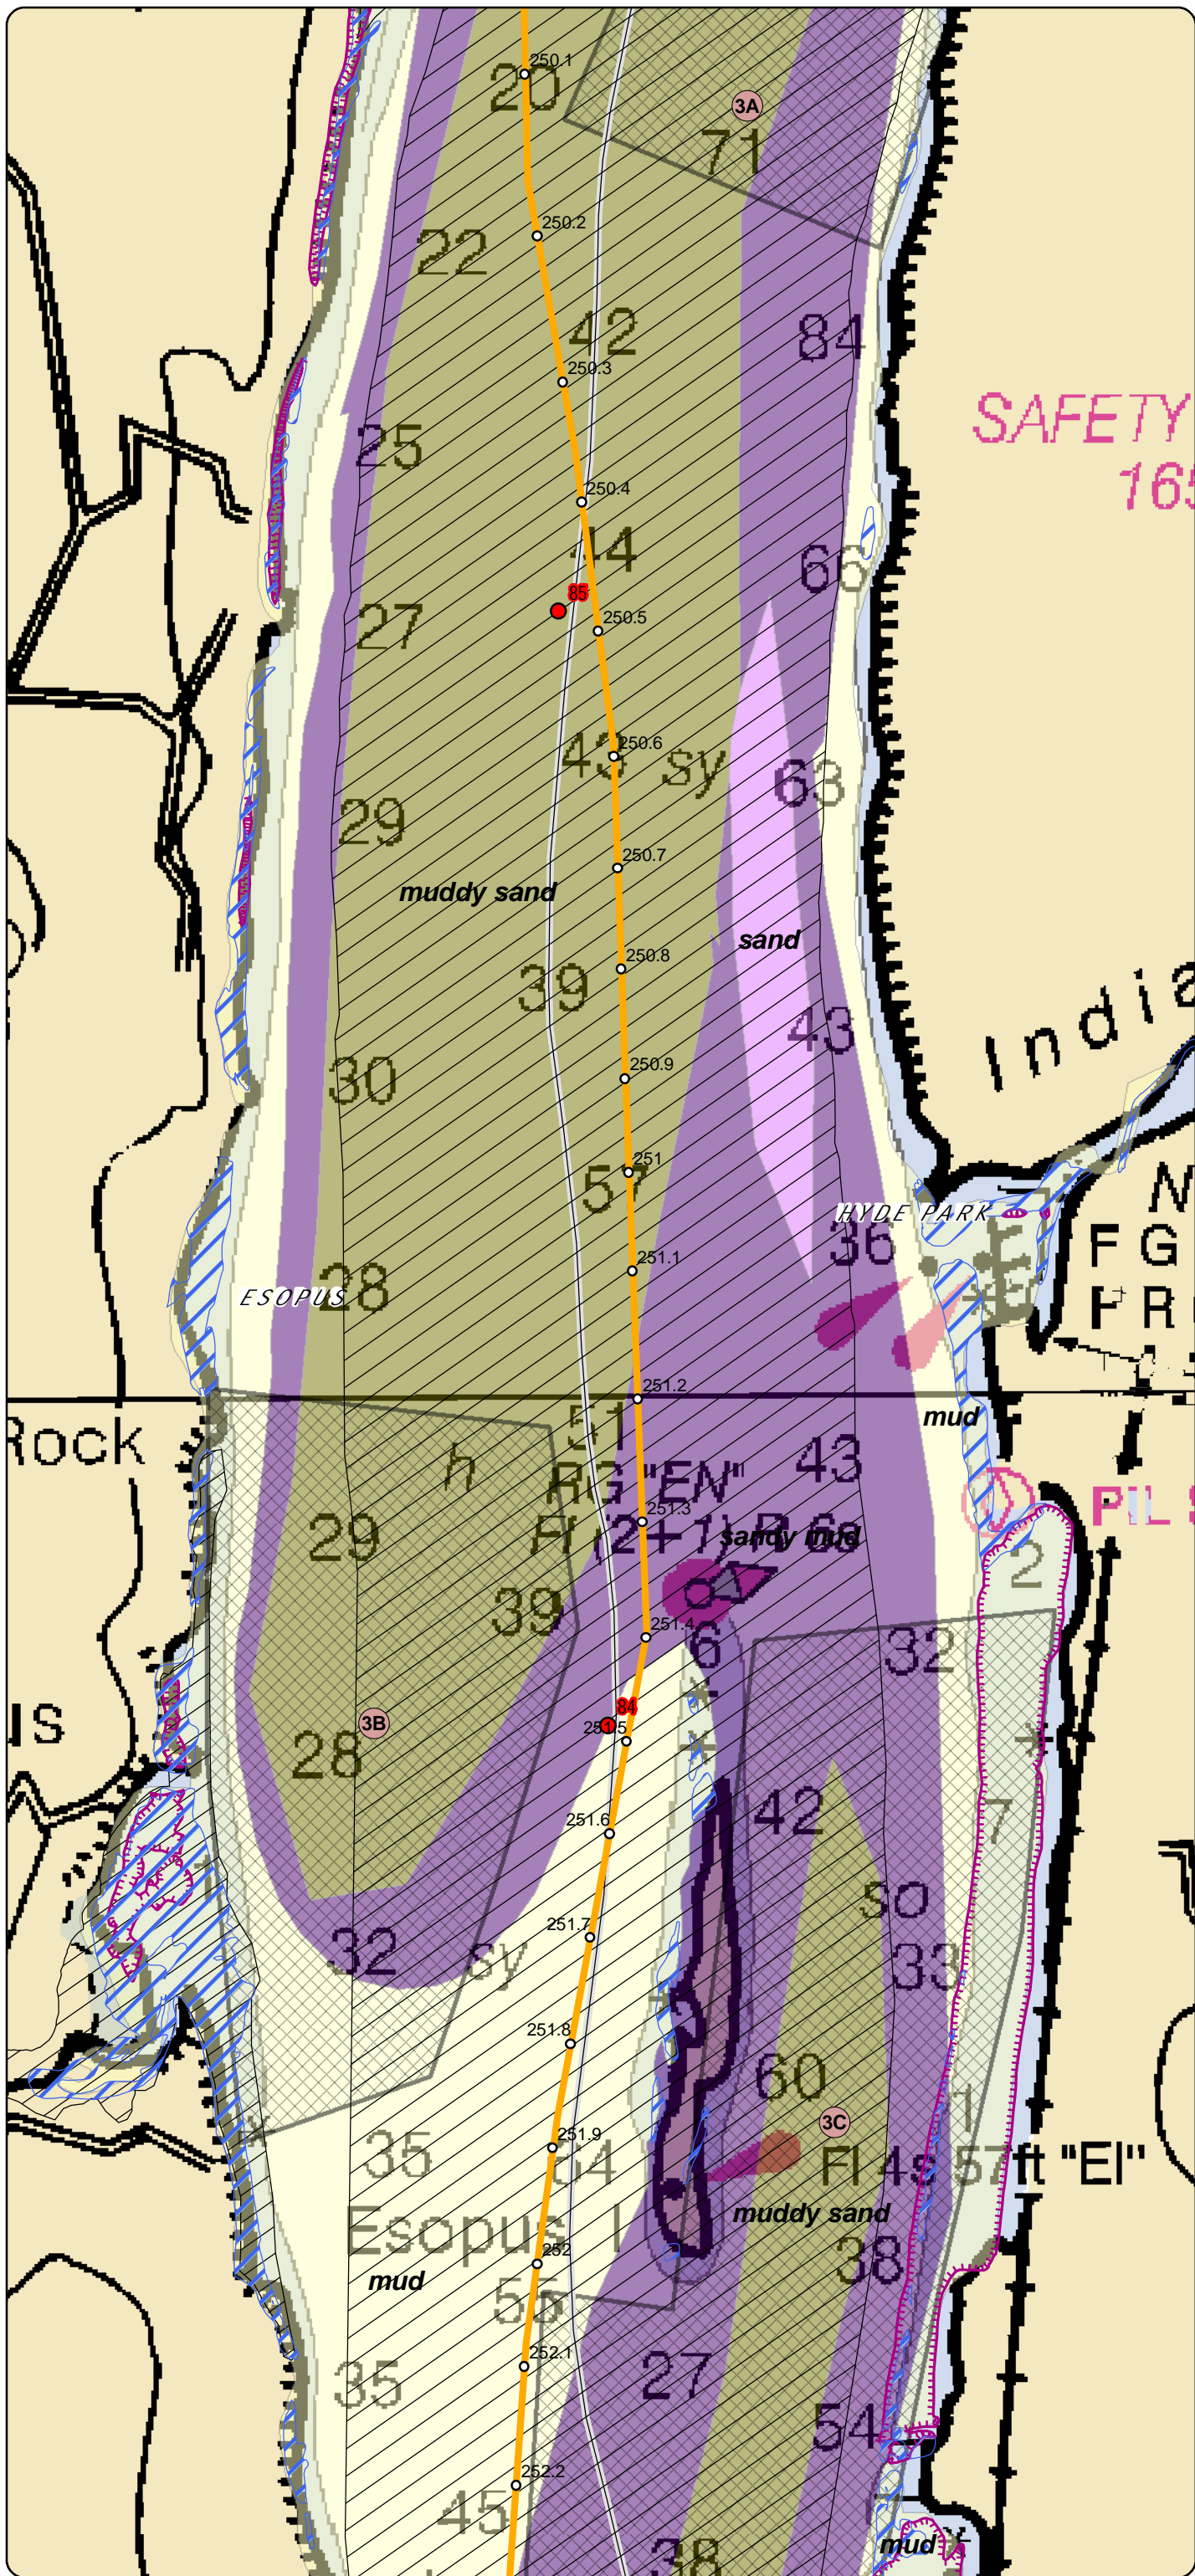

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud
- State Boundary
- County Boundary
- Town Boundary

0  750  
Feet

  
 Transmission Developers Inc.  
 Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*  



---

**Hudson River Project Route**  
 Sheet 11 of 43  


---

 Created: 6/18/2014  
 by:   & 



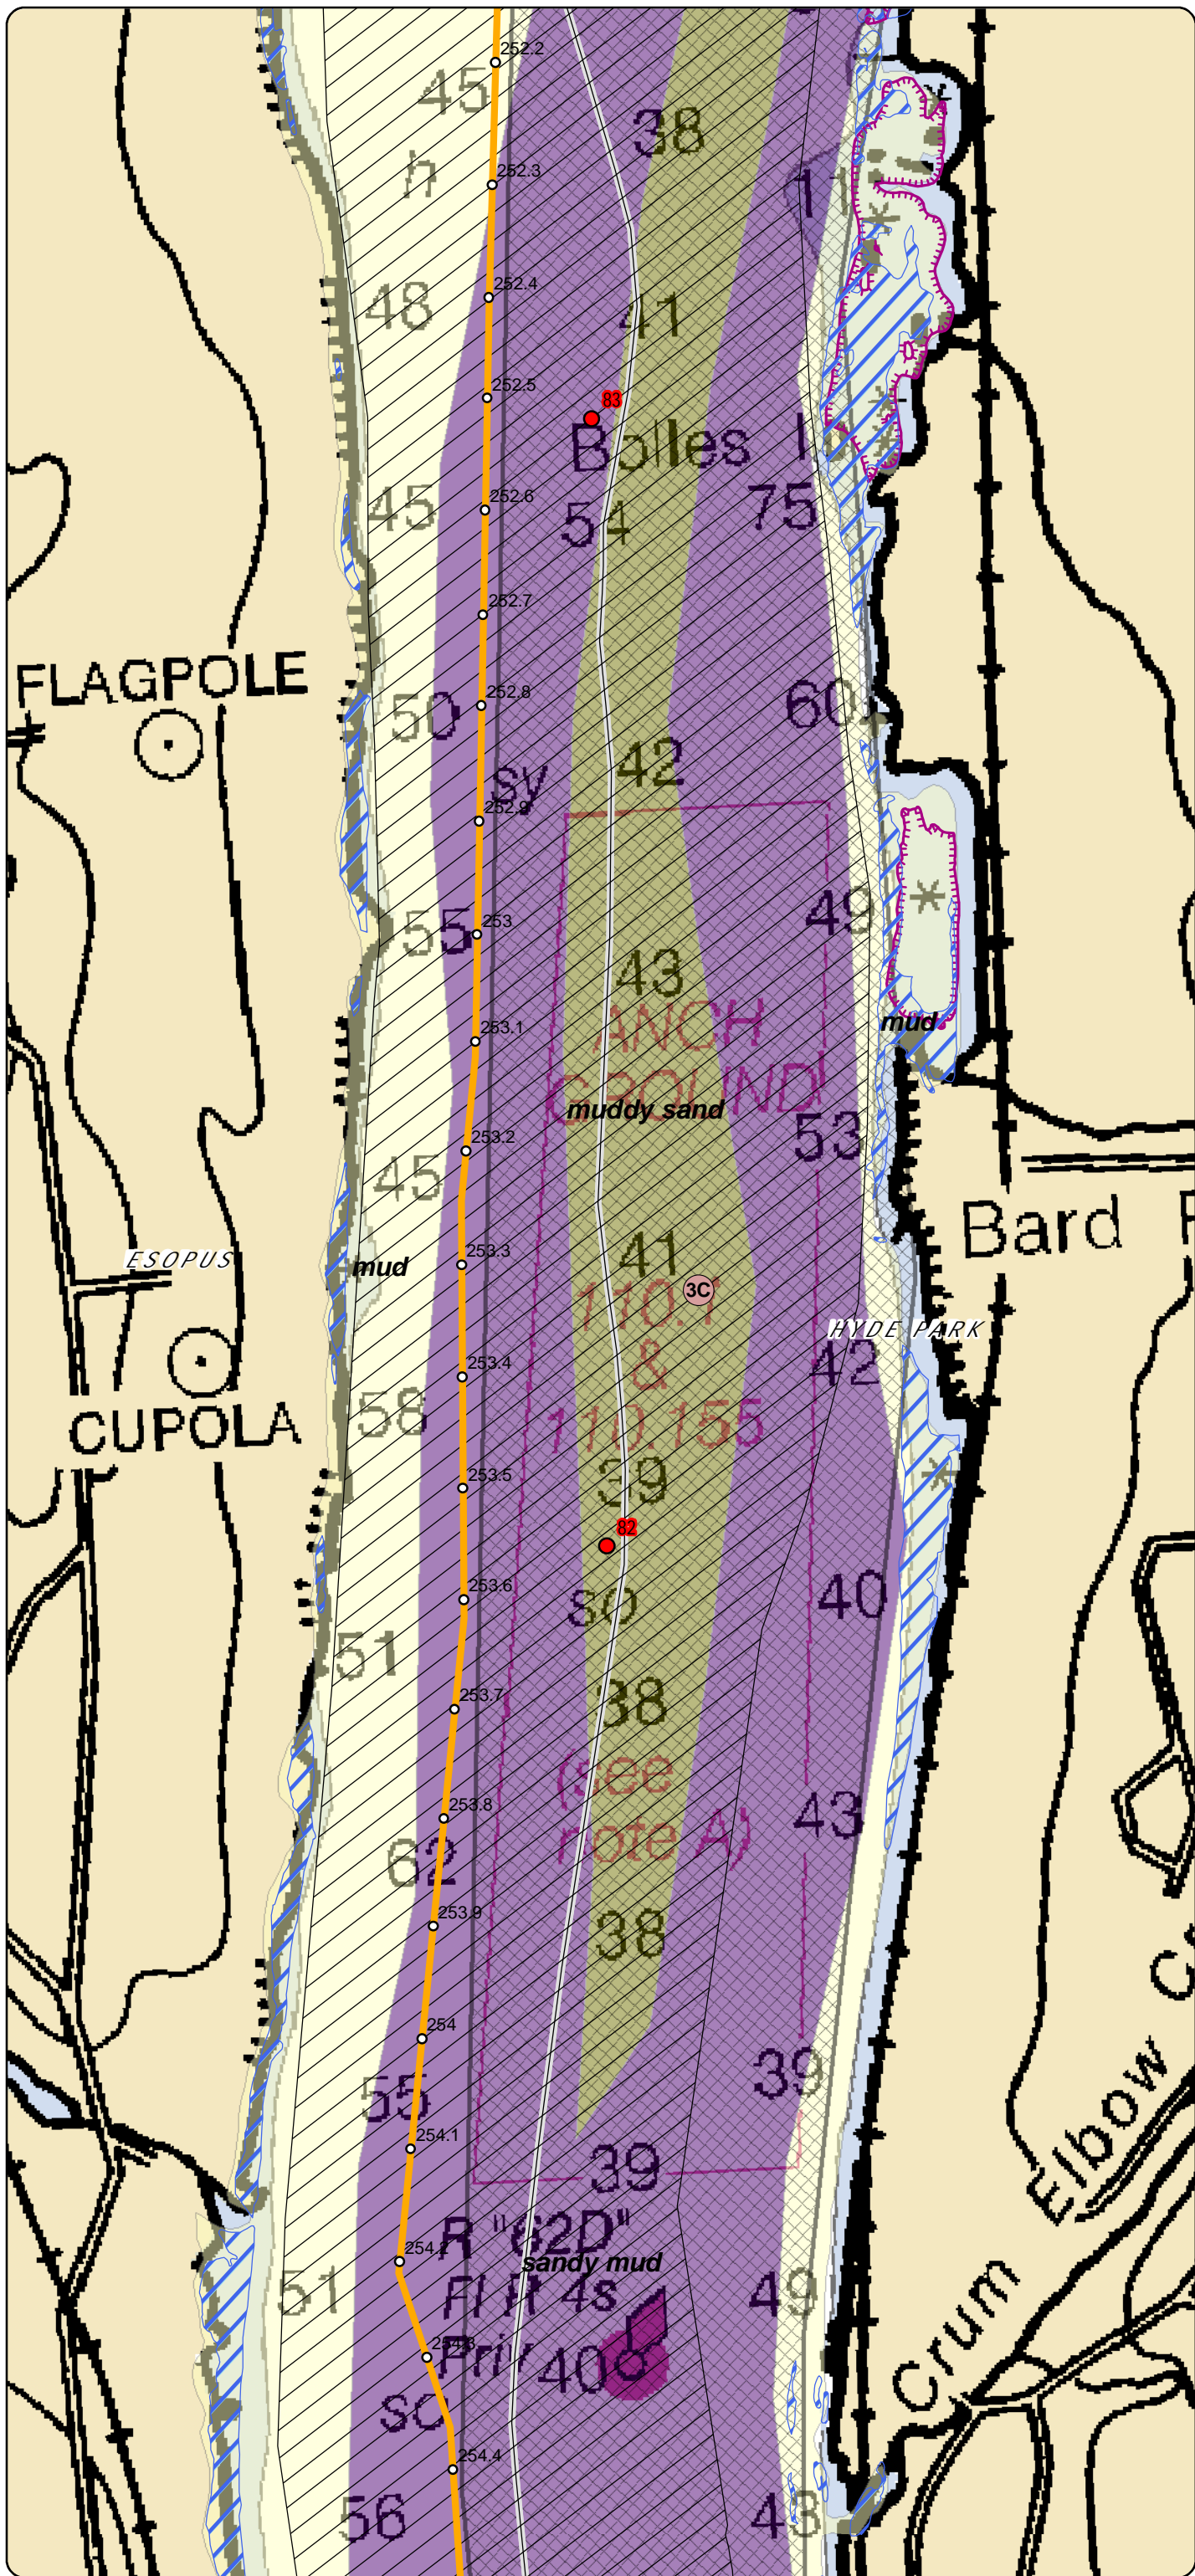

### LEGEND

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

### Sediment Type - NYSDEC Hudson River Estuary Program

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud
- State Boundary
- County Boundary
- Town Boundary

0 750  
Feet

Transmission  
Developers Inc.

Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*

---

**Hudson River  
Project Route**



Sheet 12 of 43

---

Created: 6/18/2014

by: &



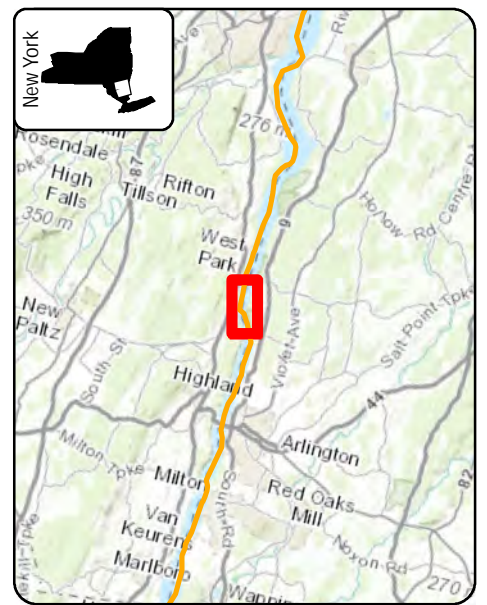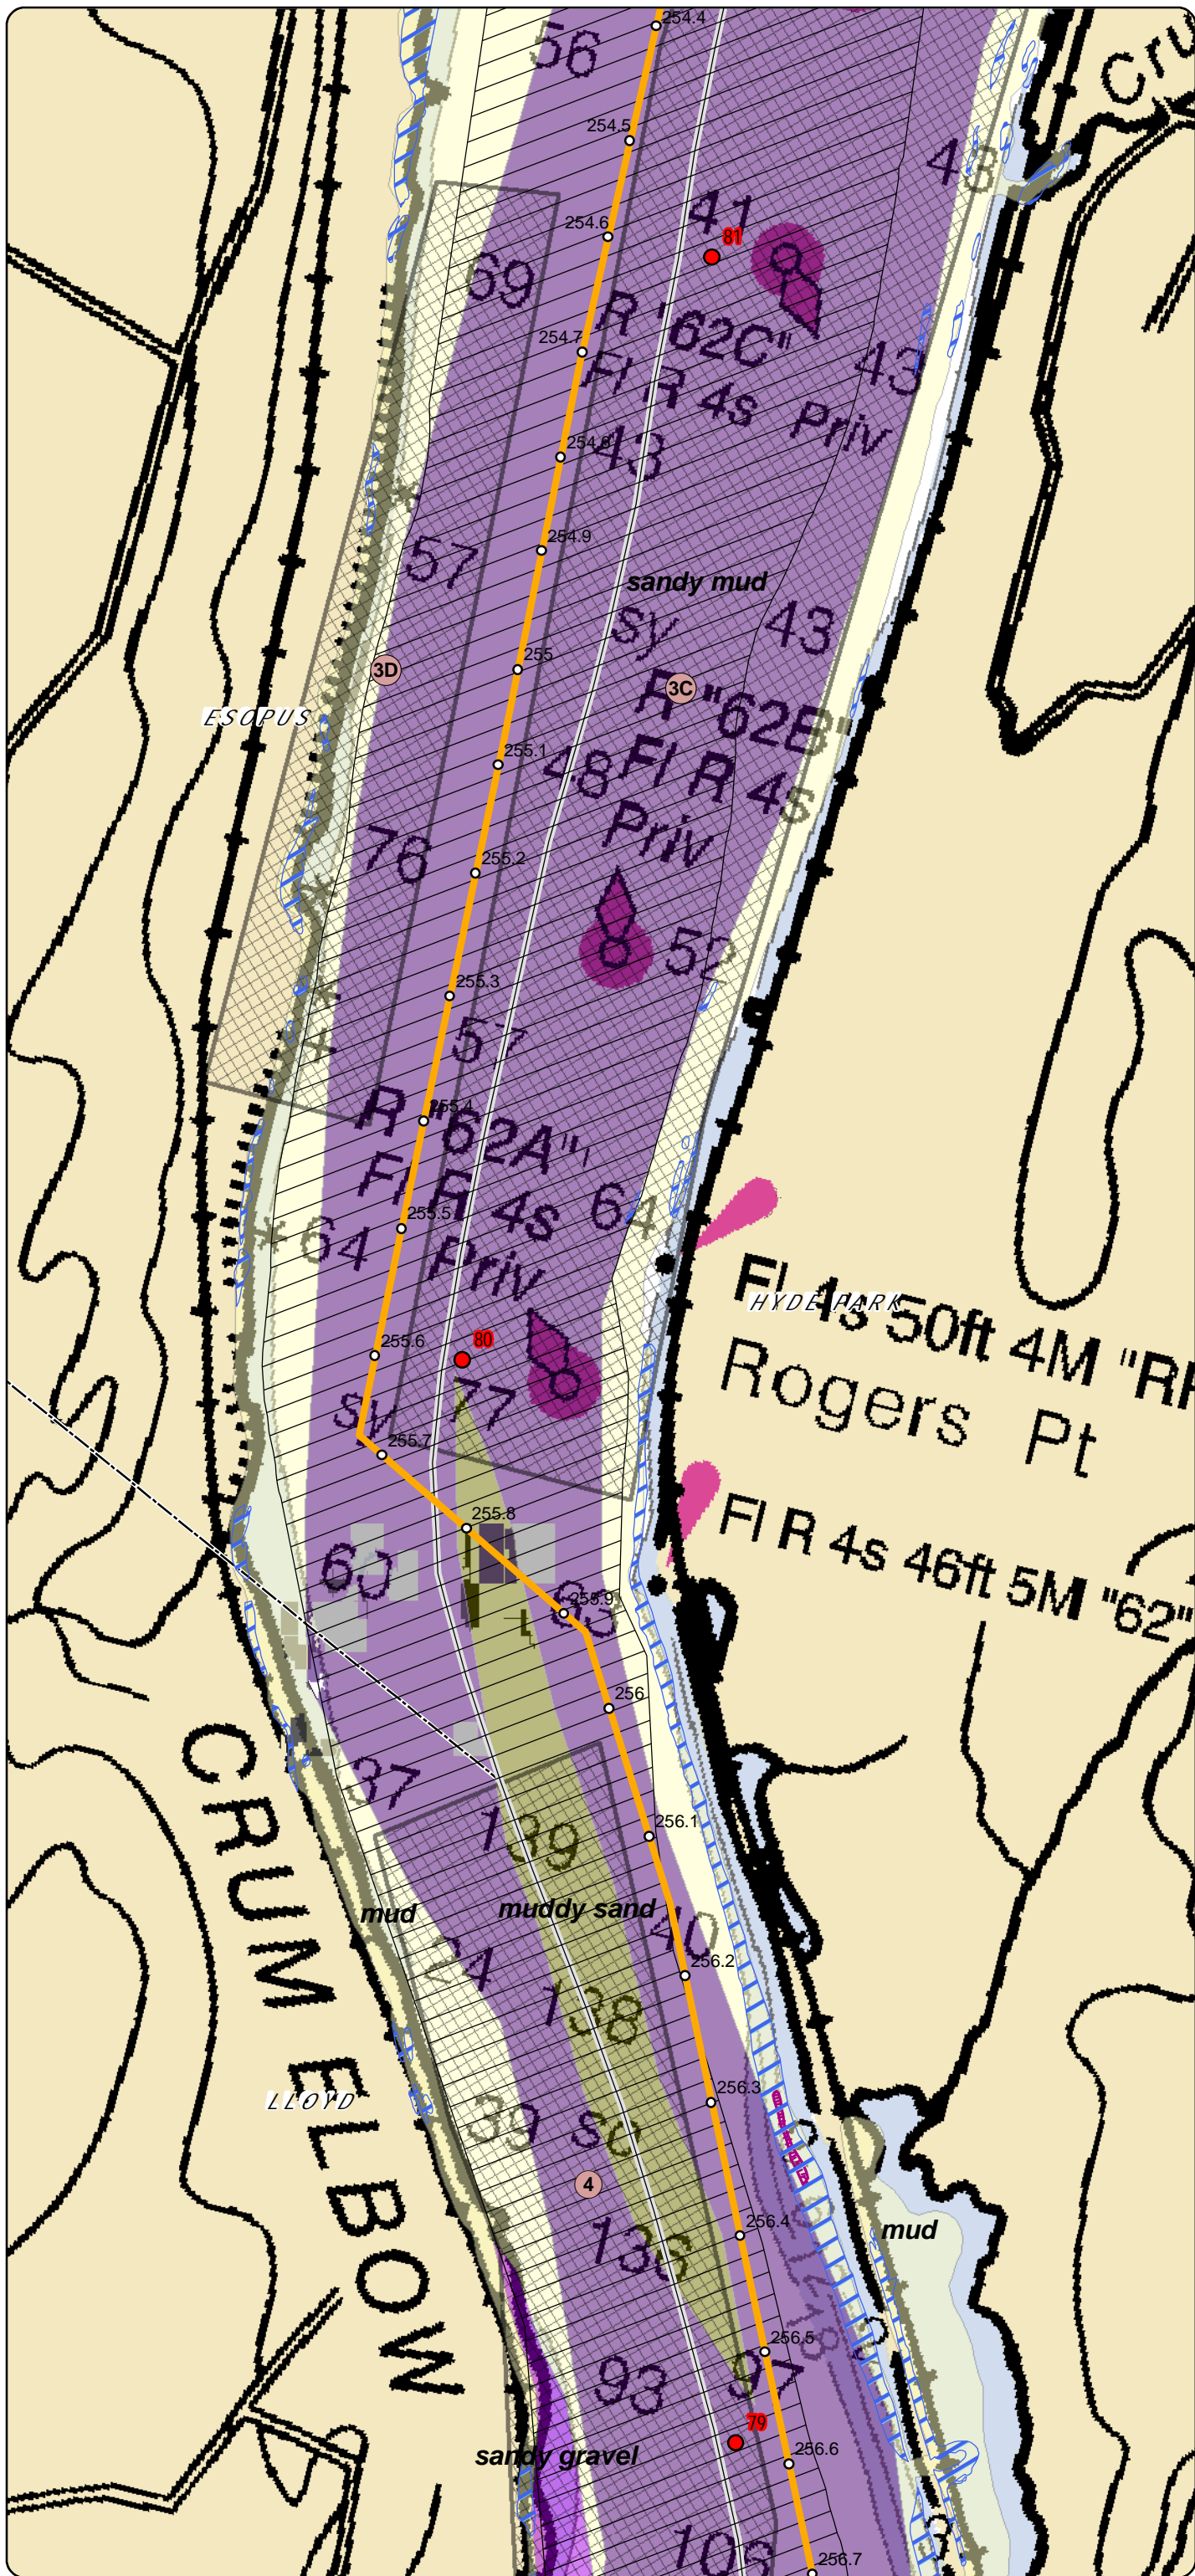

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- 1 CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud
- State Boundary
- County Boundary
- Town Boundary

0 750
  
 Feet

Champlain Hudson Power Express Project
   
*Champlain Hudson Power Express Inc.*
  




---

**Hudson River Project Route**
  
 Sheet 13 of 43
   


---

 Created: 6/18/2014
   
 by: &



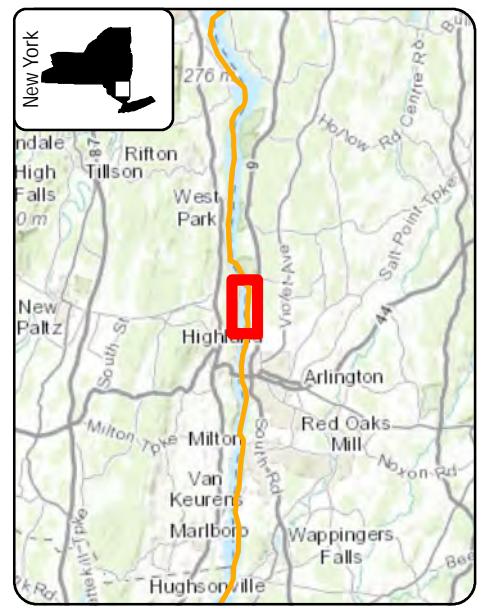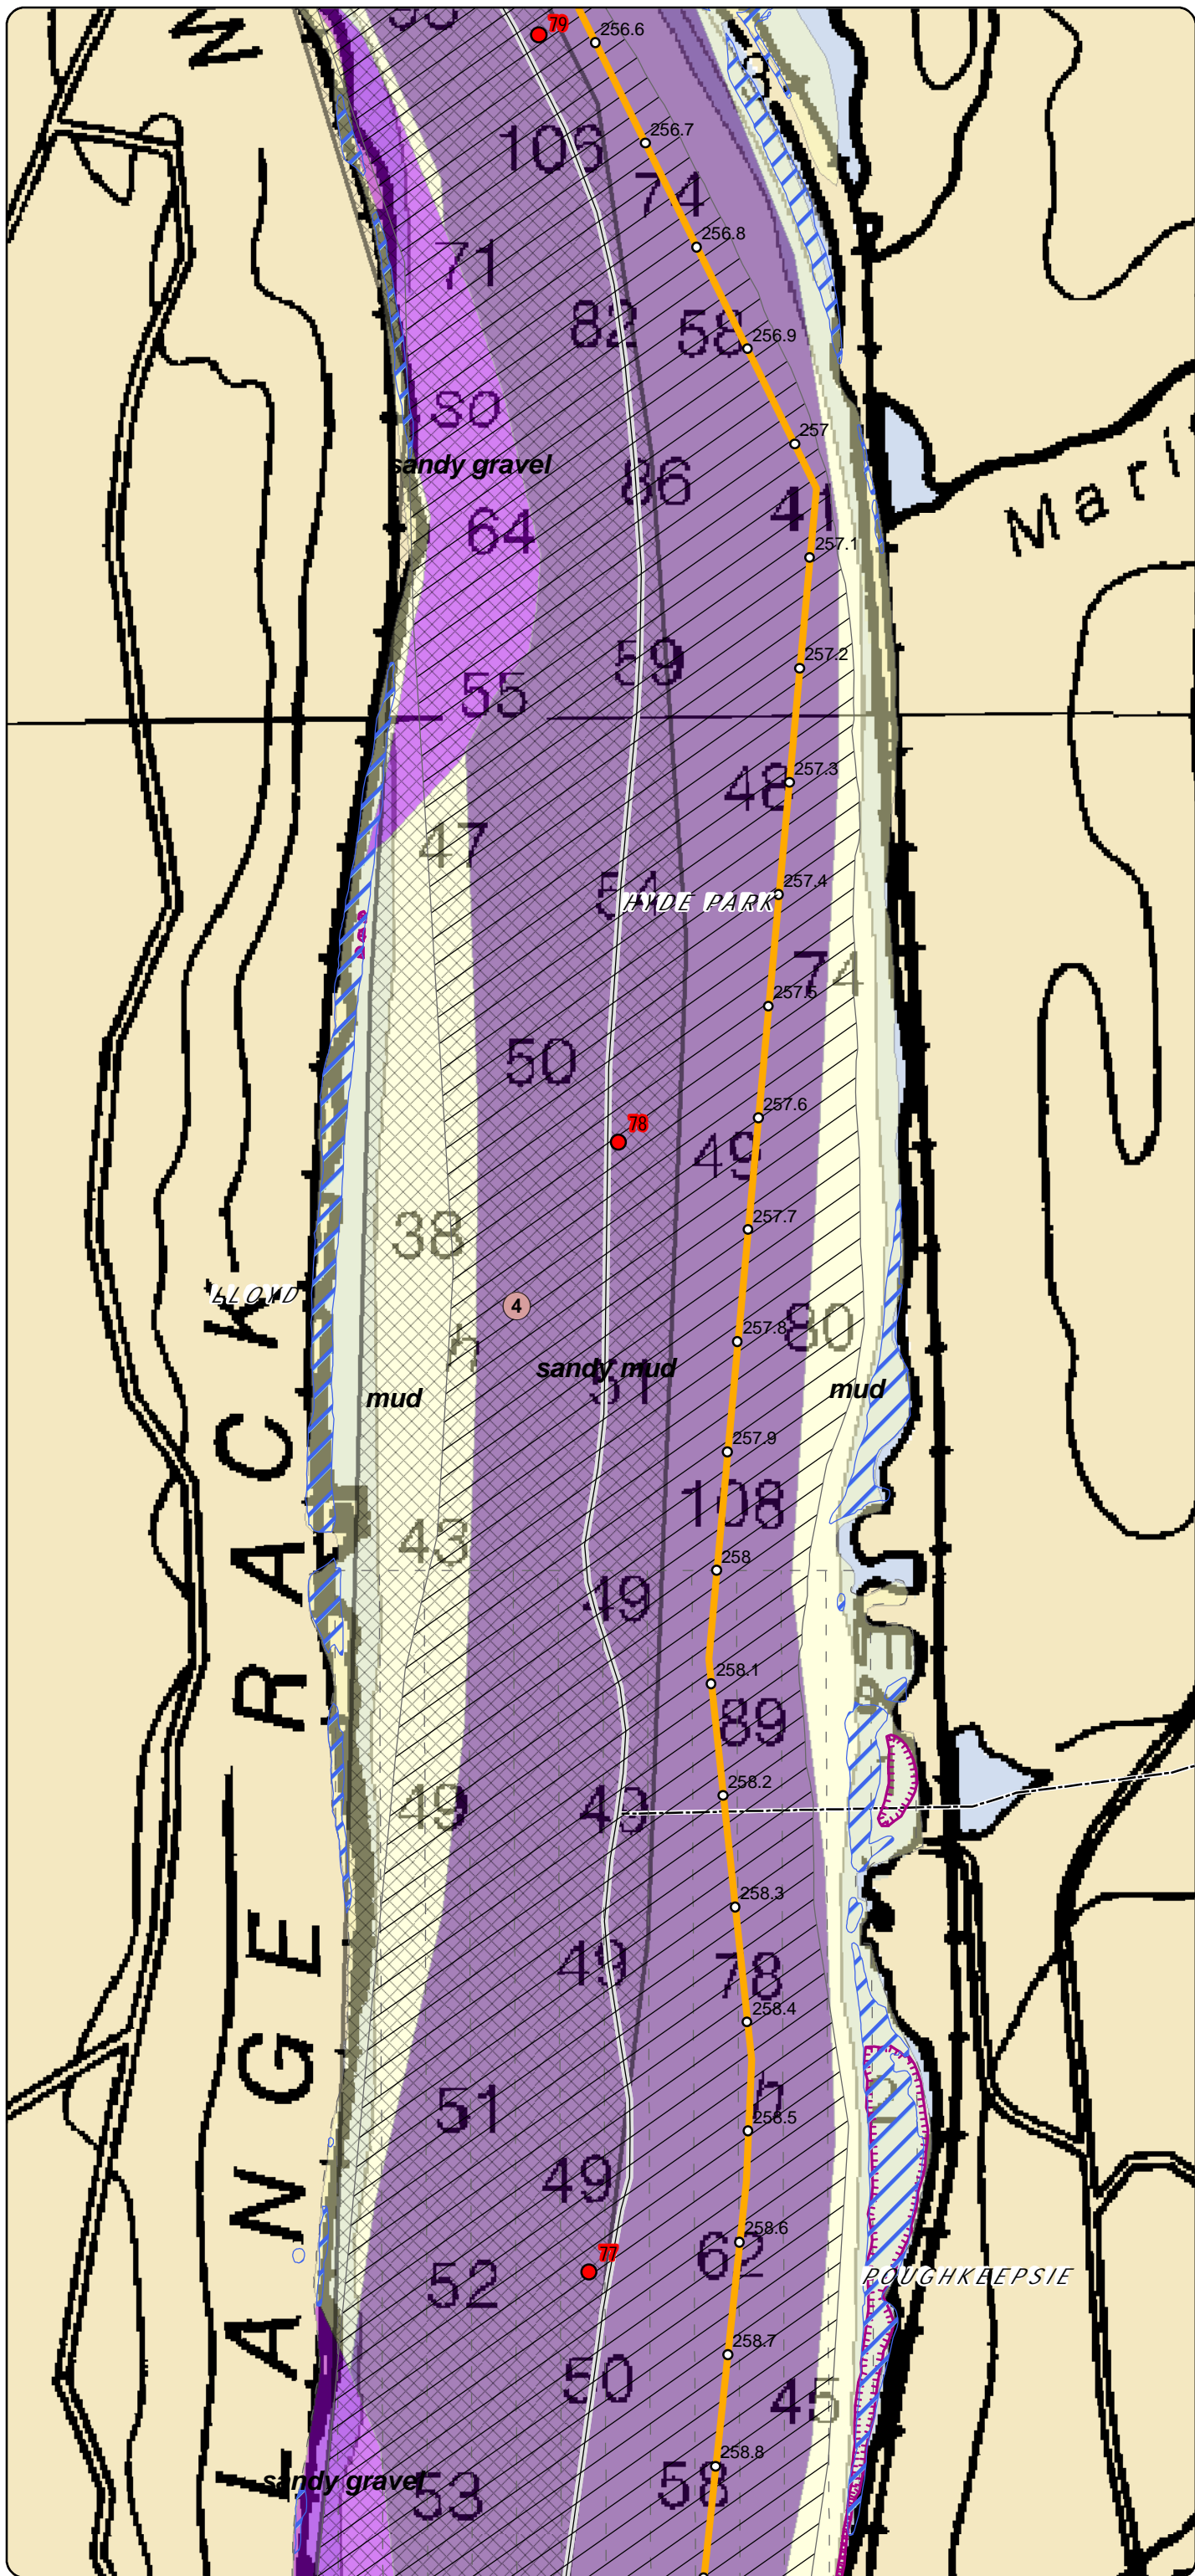

### LEGEND

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

#### Sediment Type - NYSDEC Hudson River Estuary Program

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

0 750  
Feet

**Transmission Developers Inc.**

Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*

---

**Hudson River Project Route**



Sheet 14 of 43

---

Created: 6/18/2014

by: **HDR** **UTA** & **CTRC**



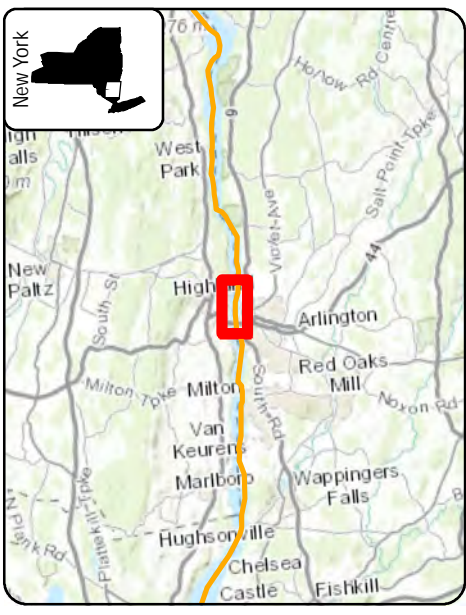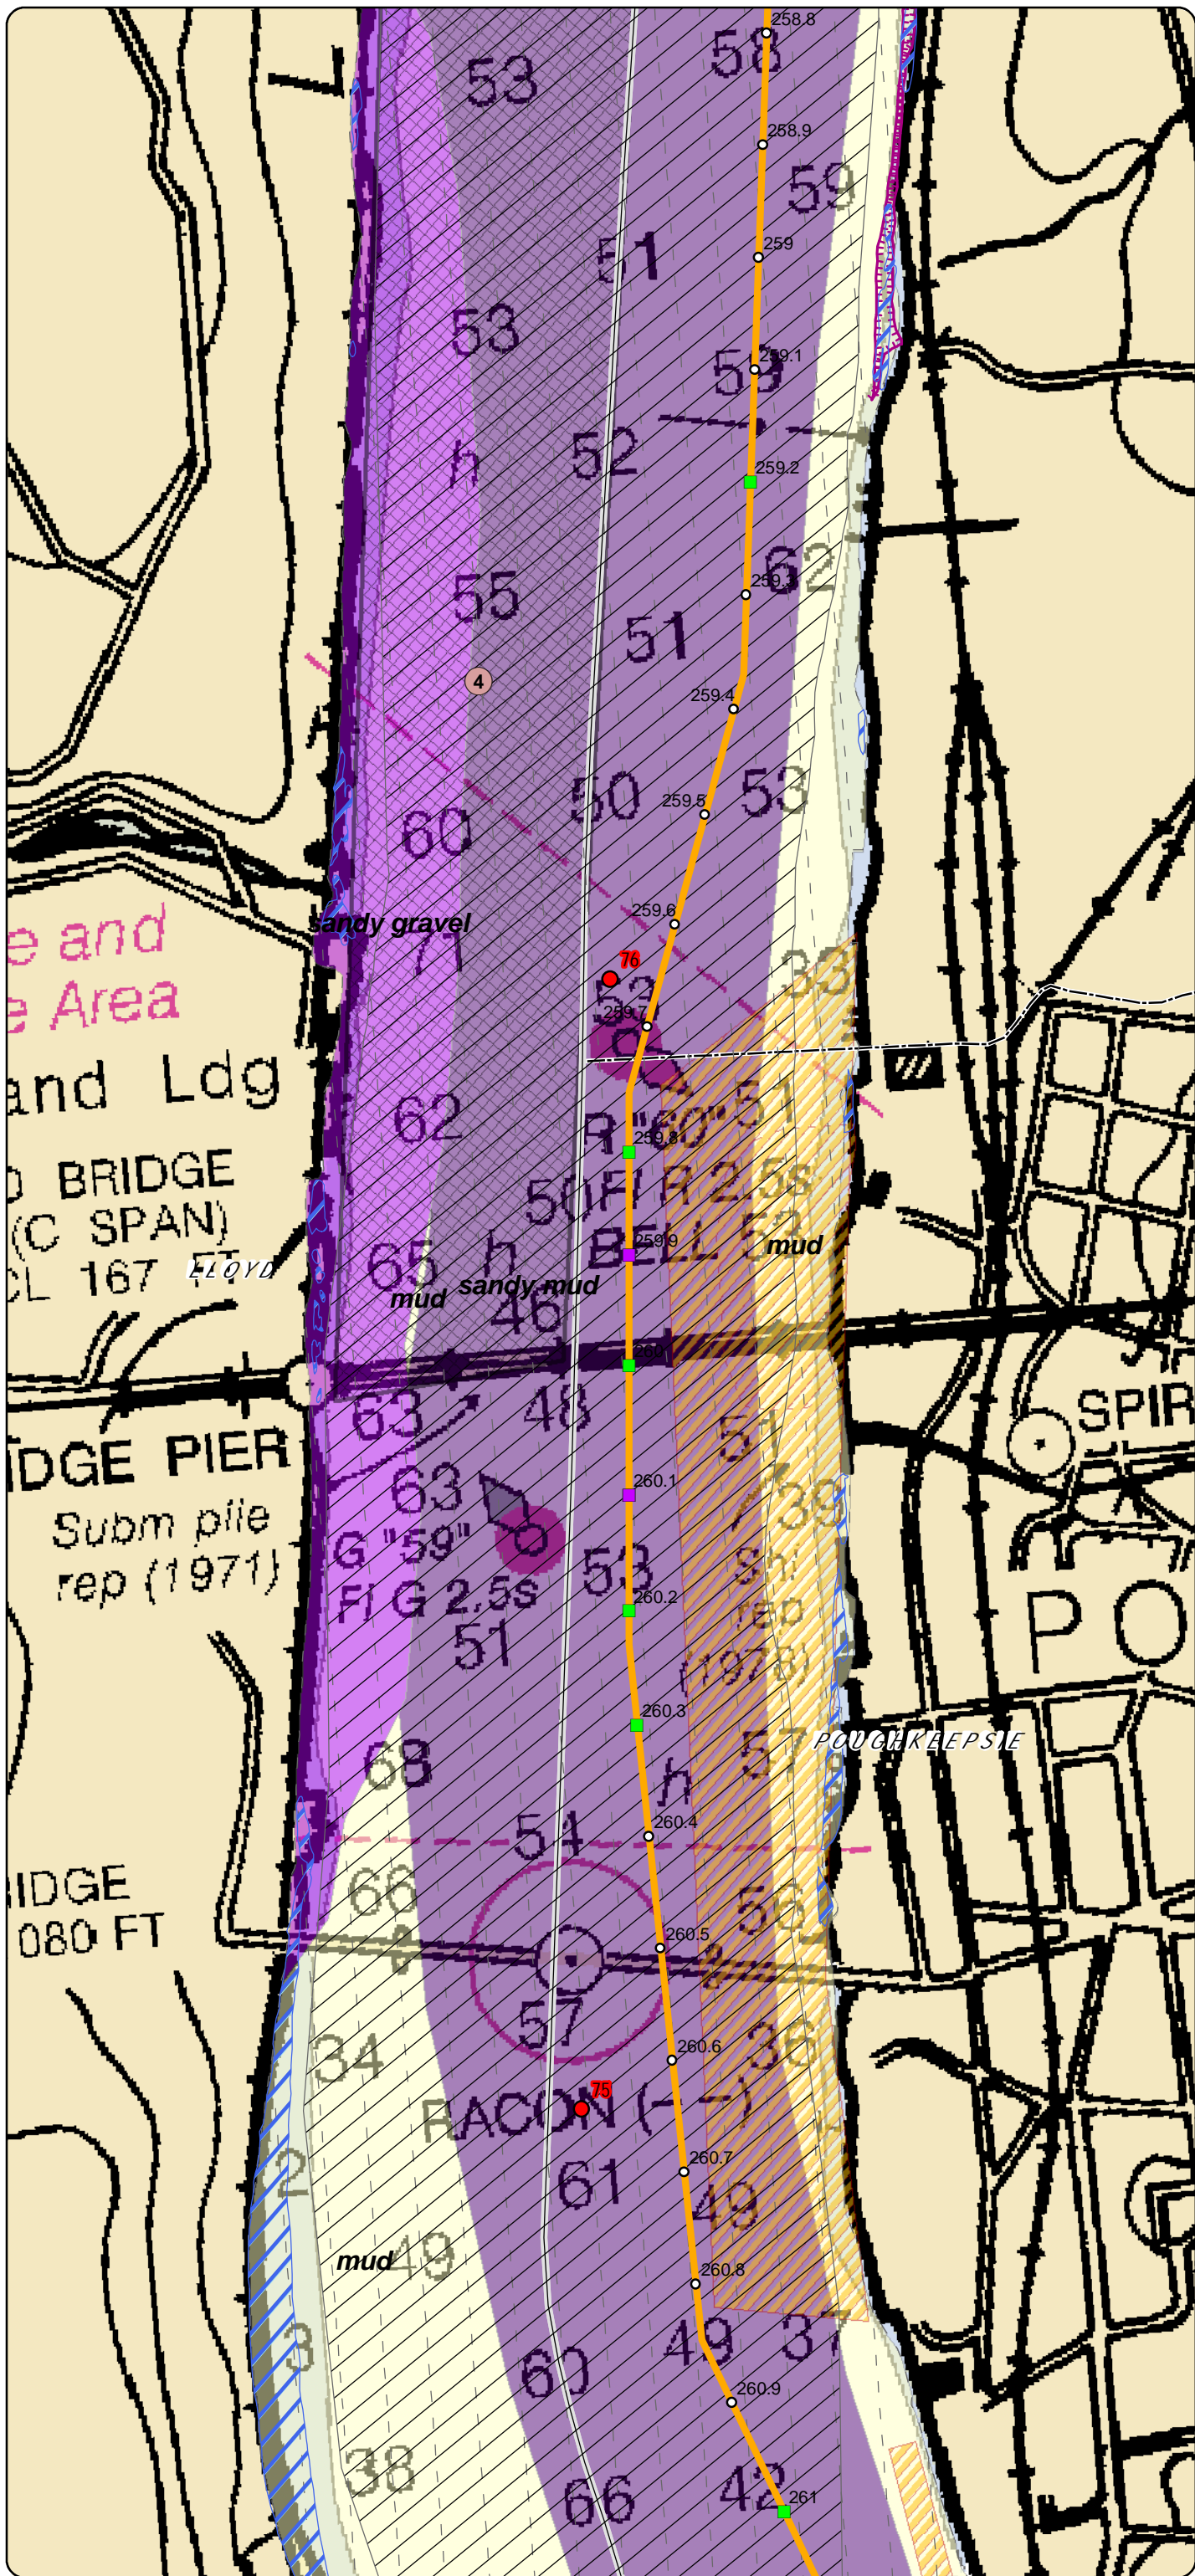

### LEGEND

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC)  Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

#### Sediment Type - NYSDEC Hudson River Estuary Program

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

0 750  
Feet

Transmission  
Developers Inc.

Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*


**Hudson River  
Project Route**

Sheet 15 of 43

Created: 6/18/2014

by: &



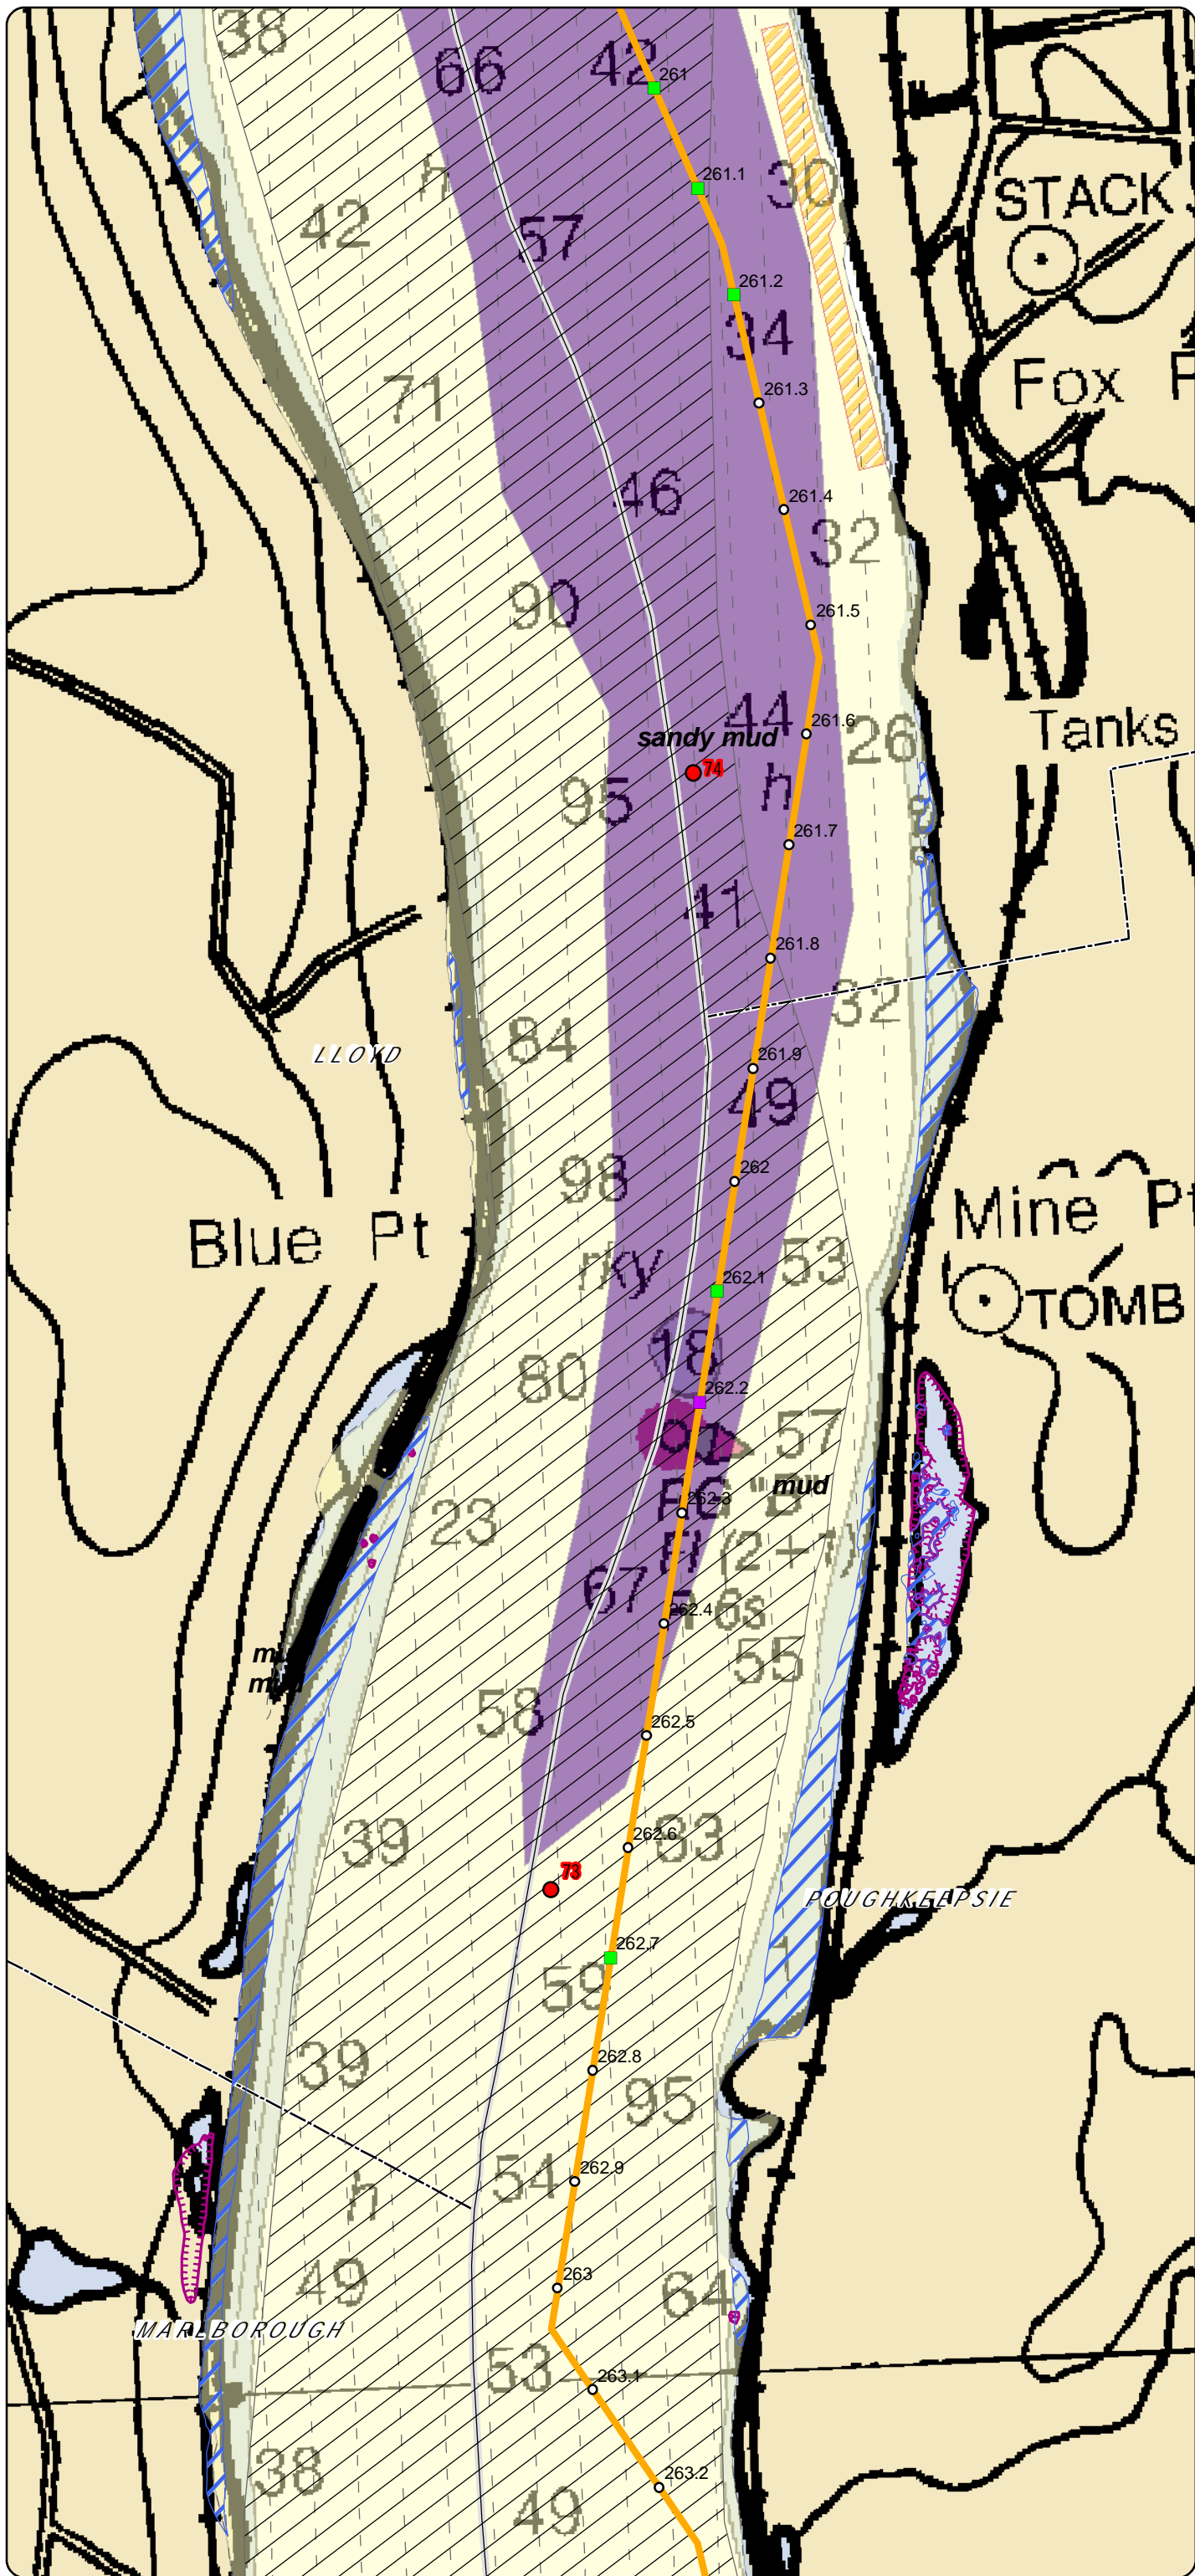

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- 1 CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

0 750  
 Feet

Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*  




---

**Hudson River Project Route**  
 Sheet 16 of 43  


---

 Created: 6/18/2014  
 by: &



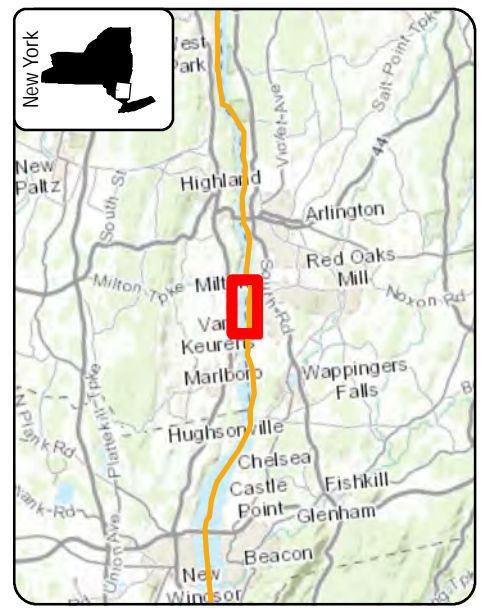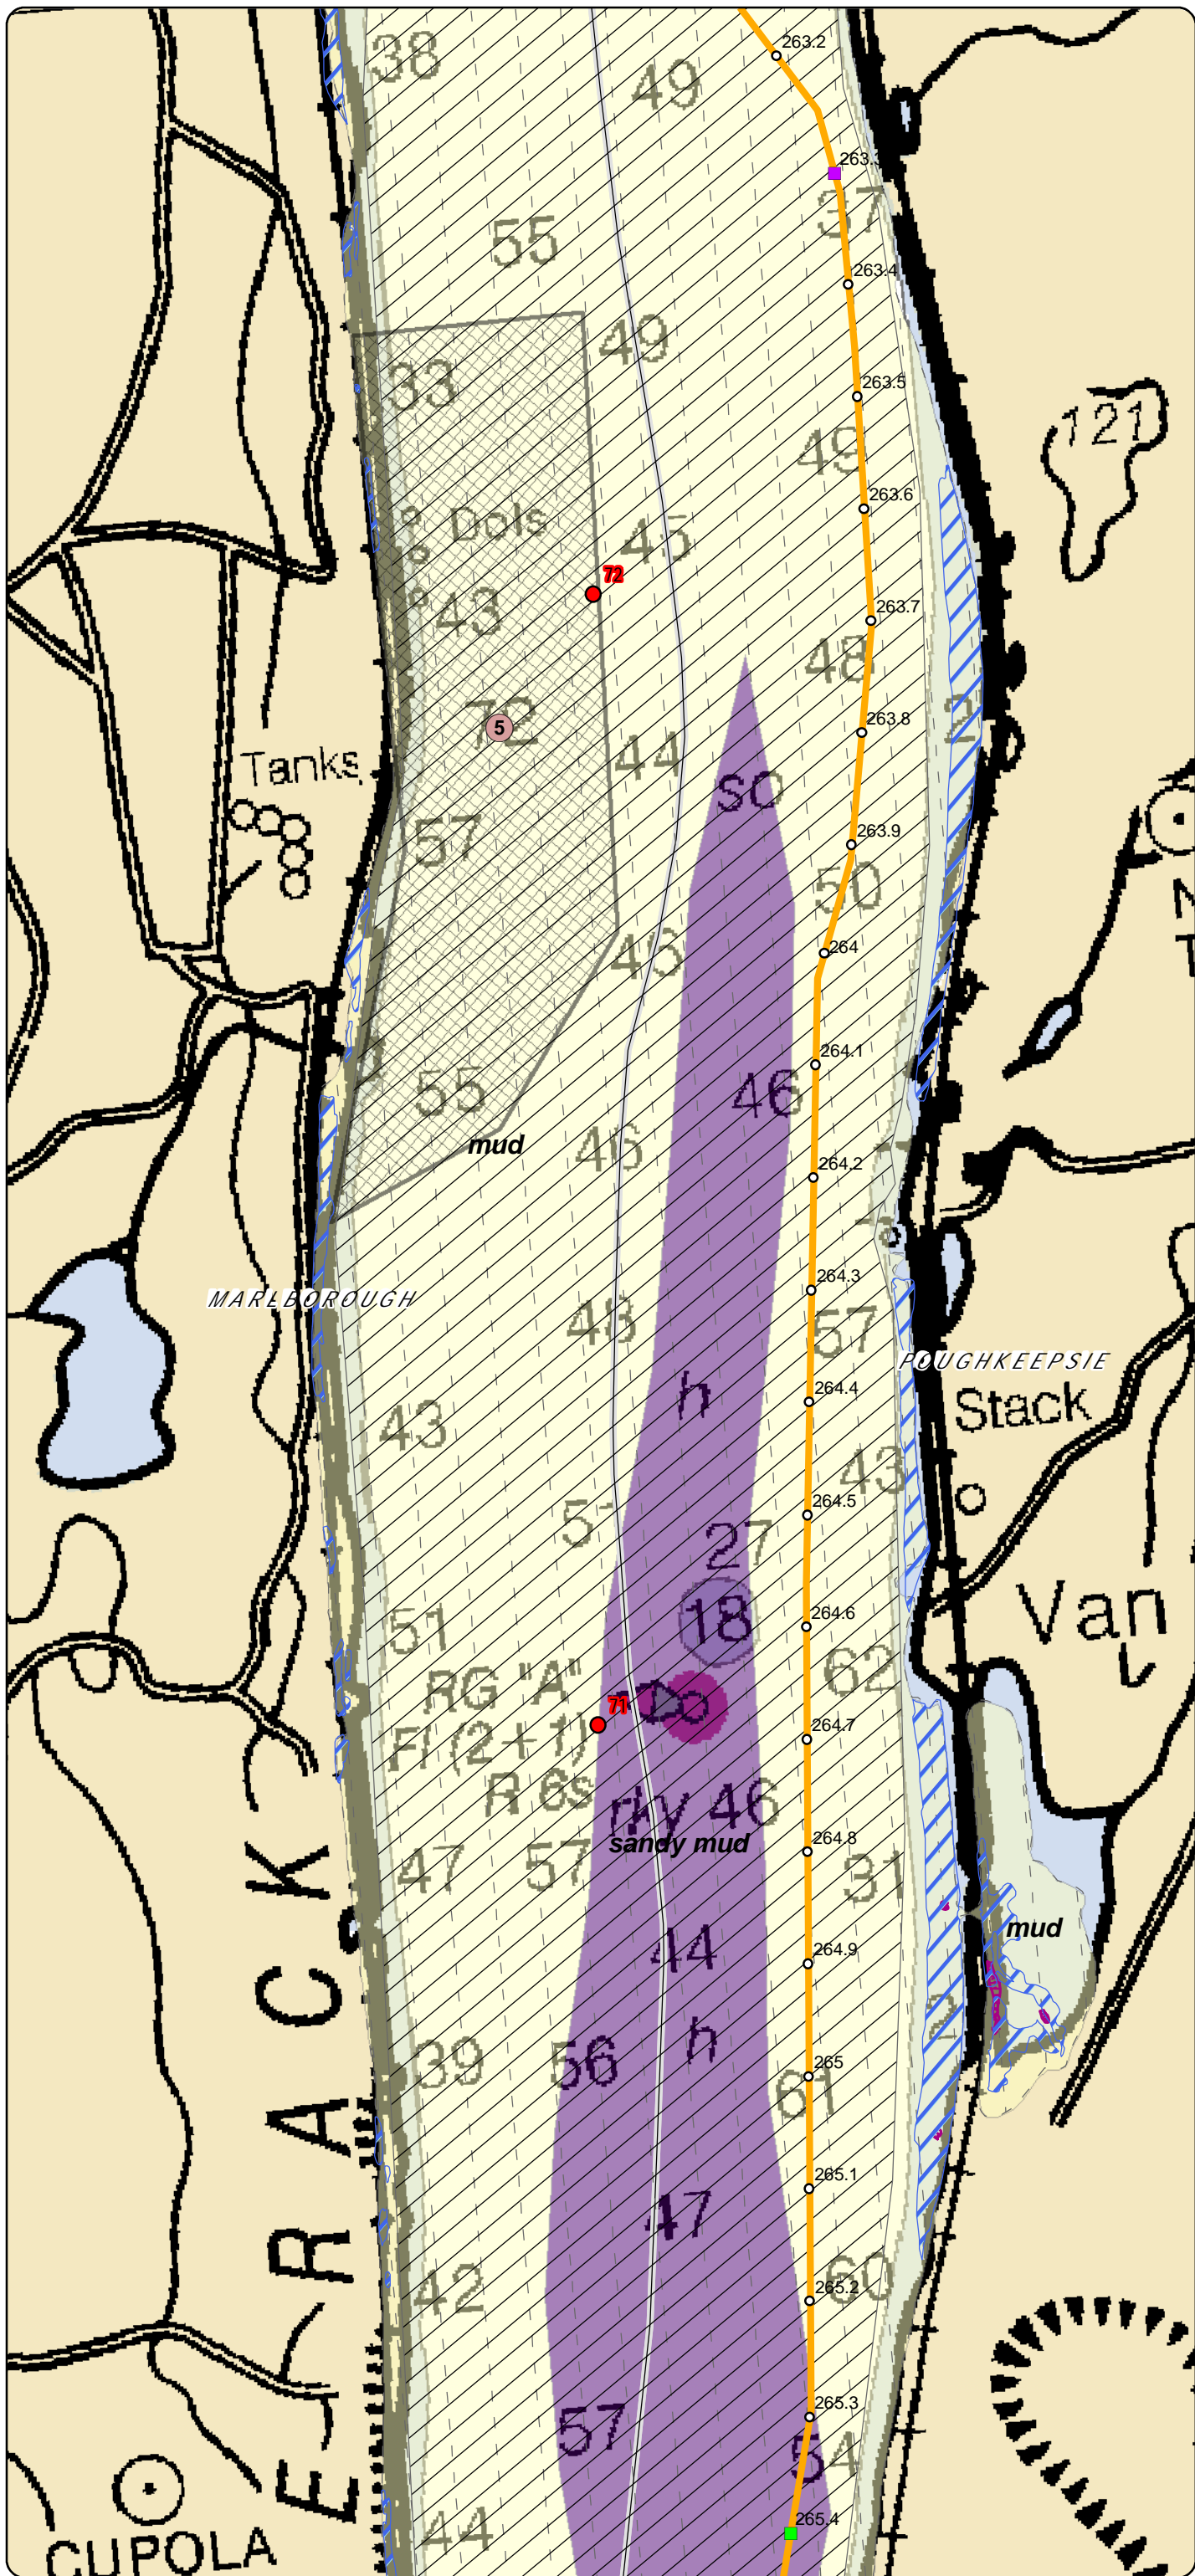

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- 1 CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

0 750  
 Feet

Transmission  
 Developers Inc.

Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*


---

**Hudson River  
 Project Route**  
 Sheet 17 of 43

---

Created: 6/18/2014  
 by: &



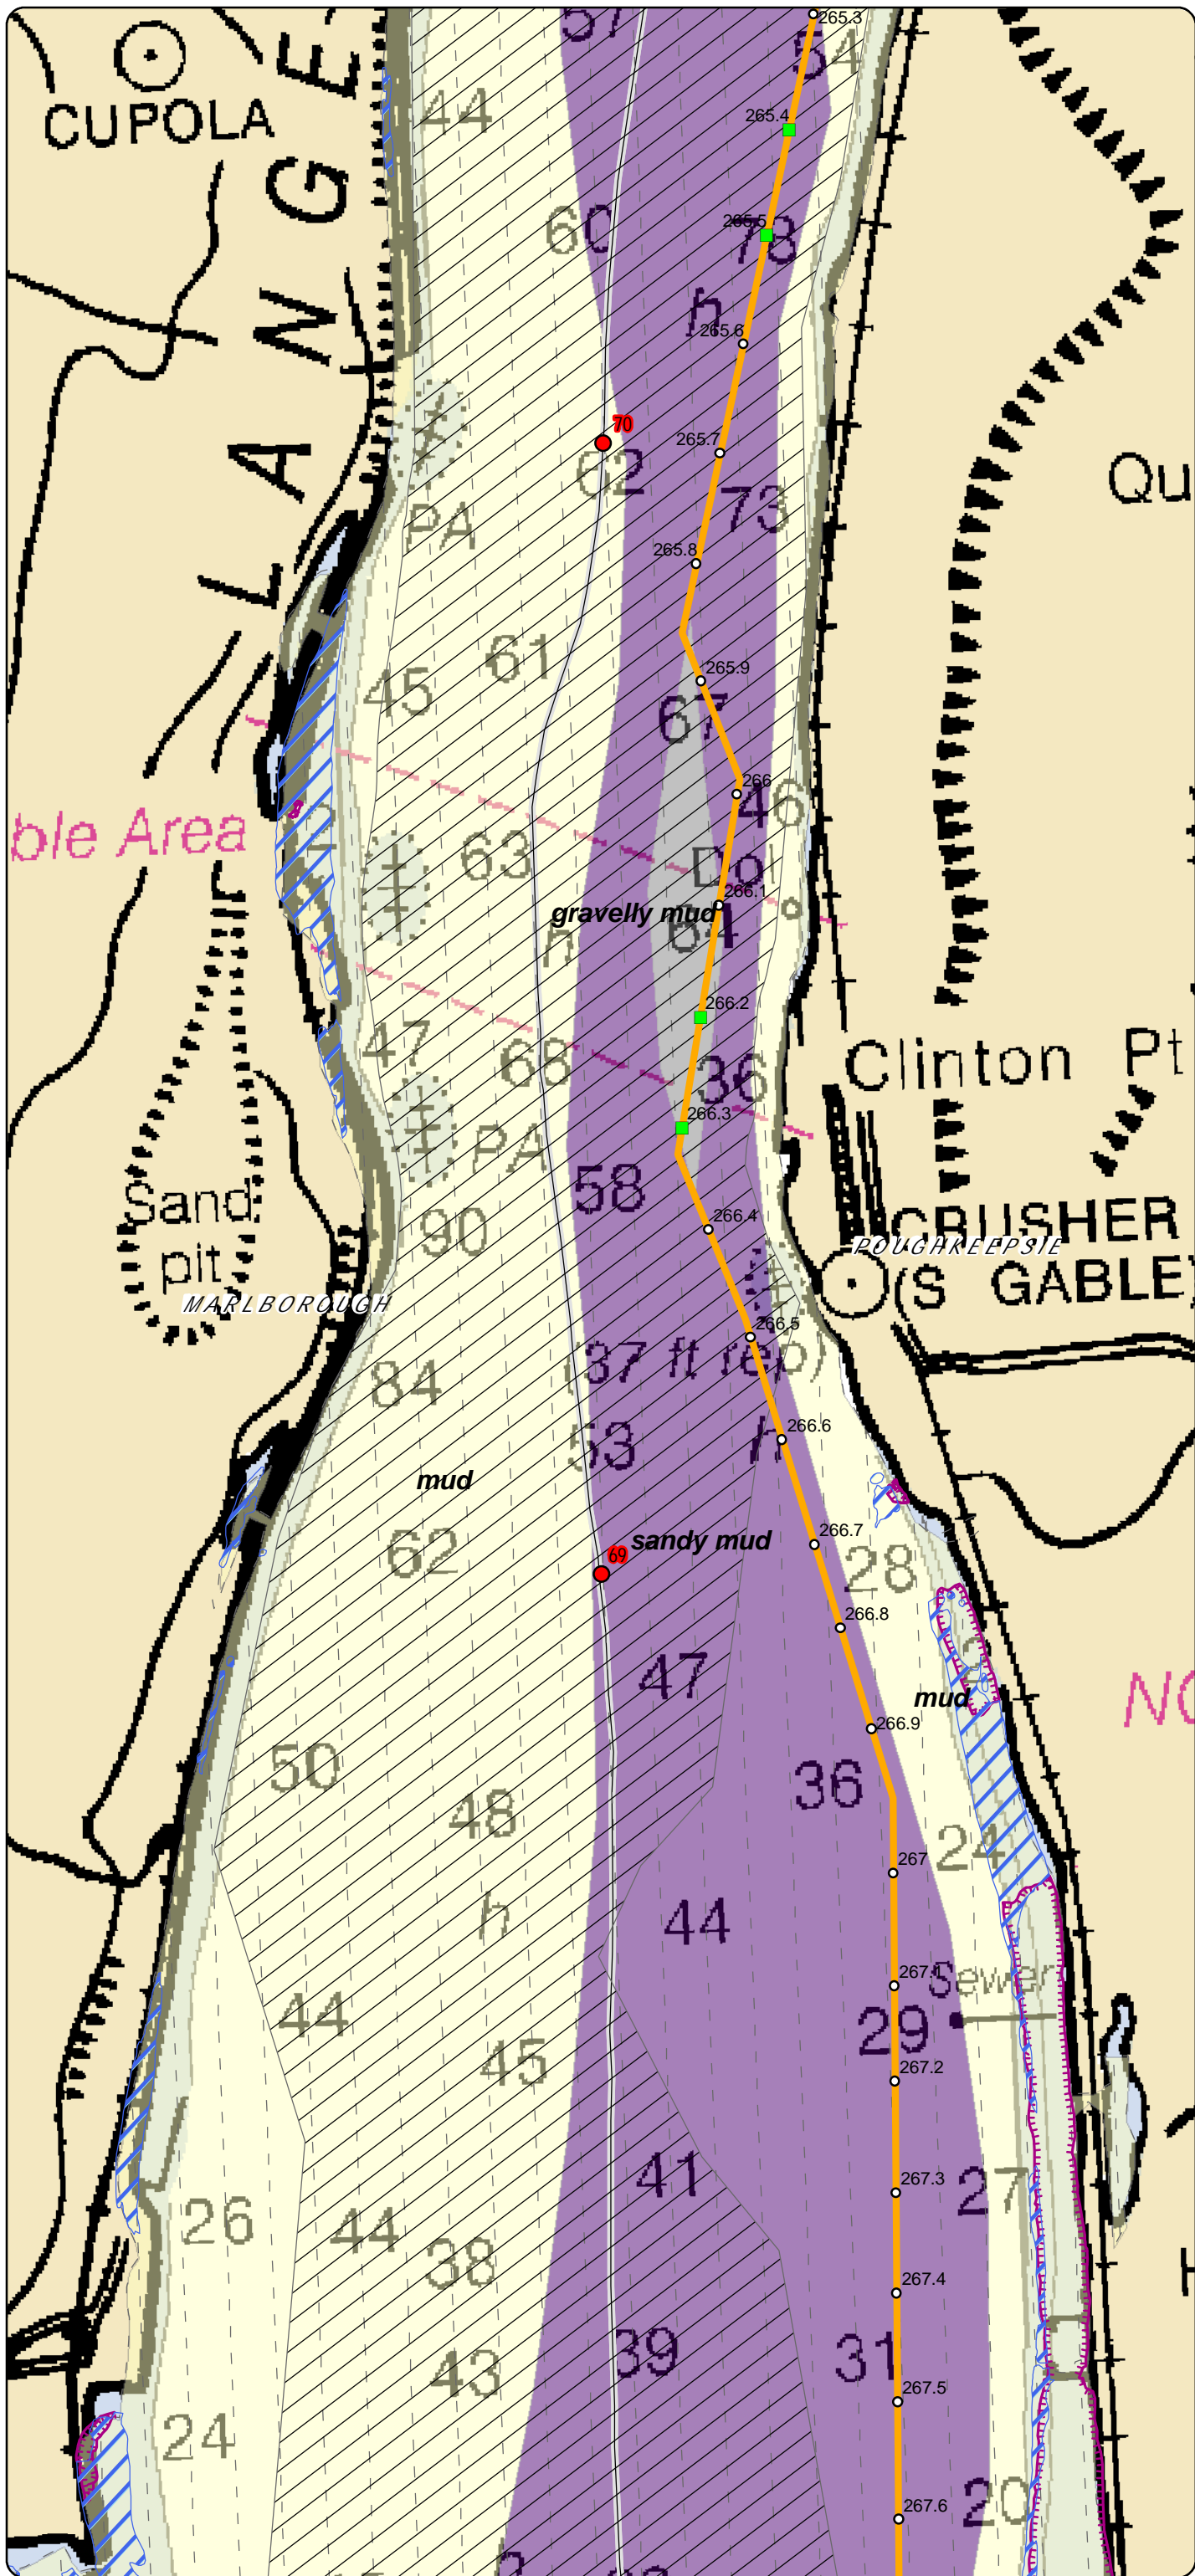

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- 1 CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Coffers Dam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud
- State Boundary
- County Boundary
- Town Boundary

0 750
  
 Feet

Transmission Developers Inc.

Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*



---

**Hudson River Project Route**  
 Sheet 18 of 43

---

Created: 6/18/2014  
 by: &



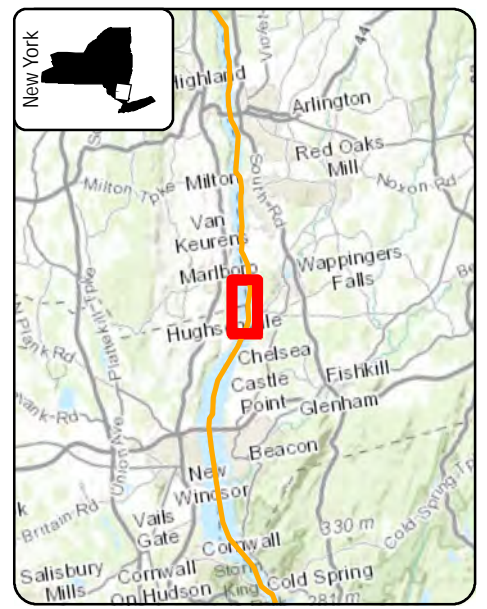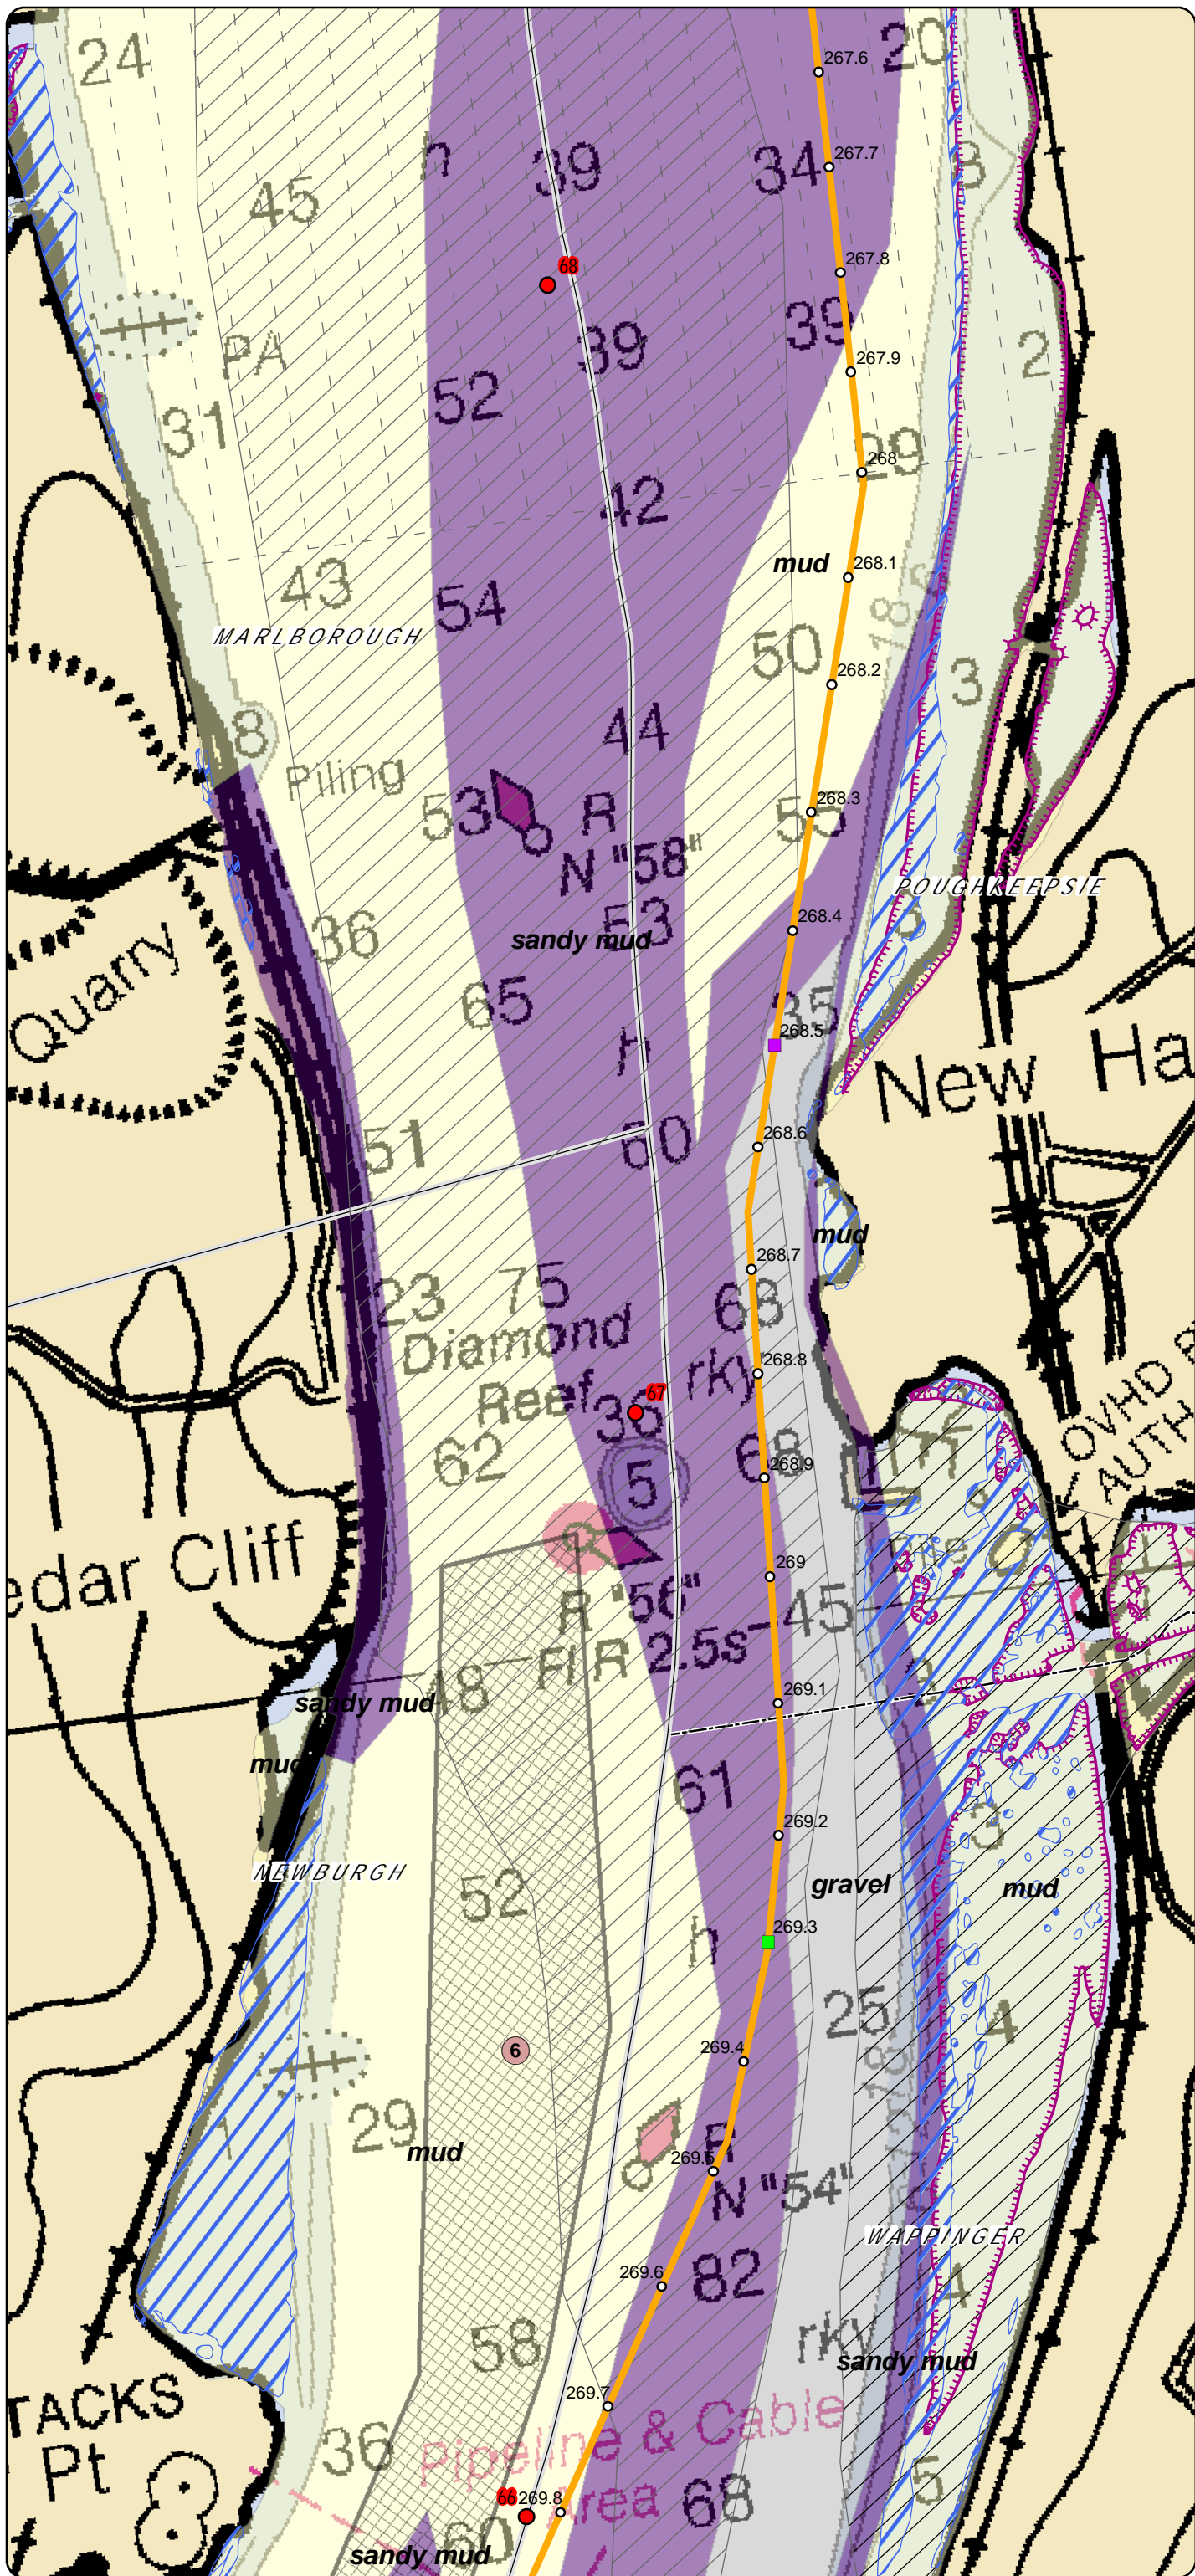


### LEGEND

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

### Sediment Type - NYSDEC Hudson River Estuary Program

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud
- State Boundary
- County Boundary
- Town Boundary



0 750  
Feet



**Transmission Developers Inc.**

Champlain Hudson Power Express Project  
Champlain Hudson Power Express Inc.

---

**Hudson River Project Route**



Sheet 19 of 43

---

Created: 6/18/2014

by: **HDR** **UTA** & **CTRC**



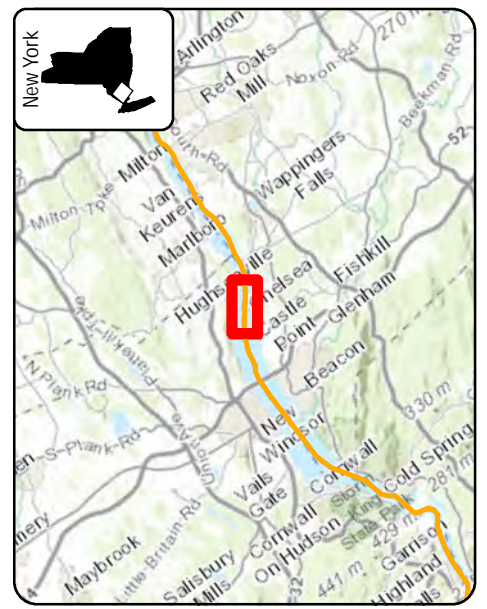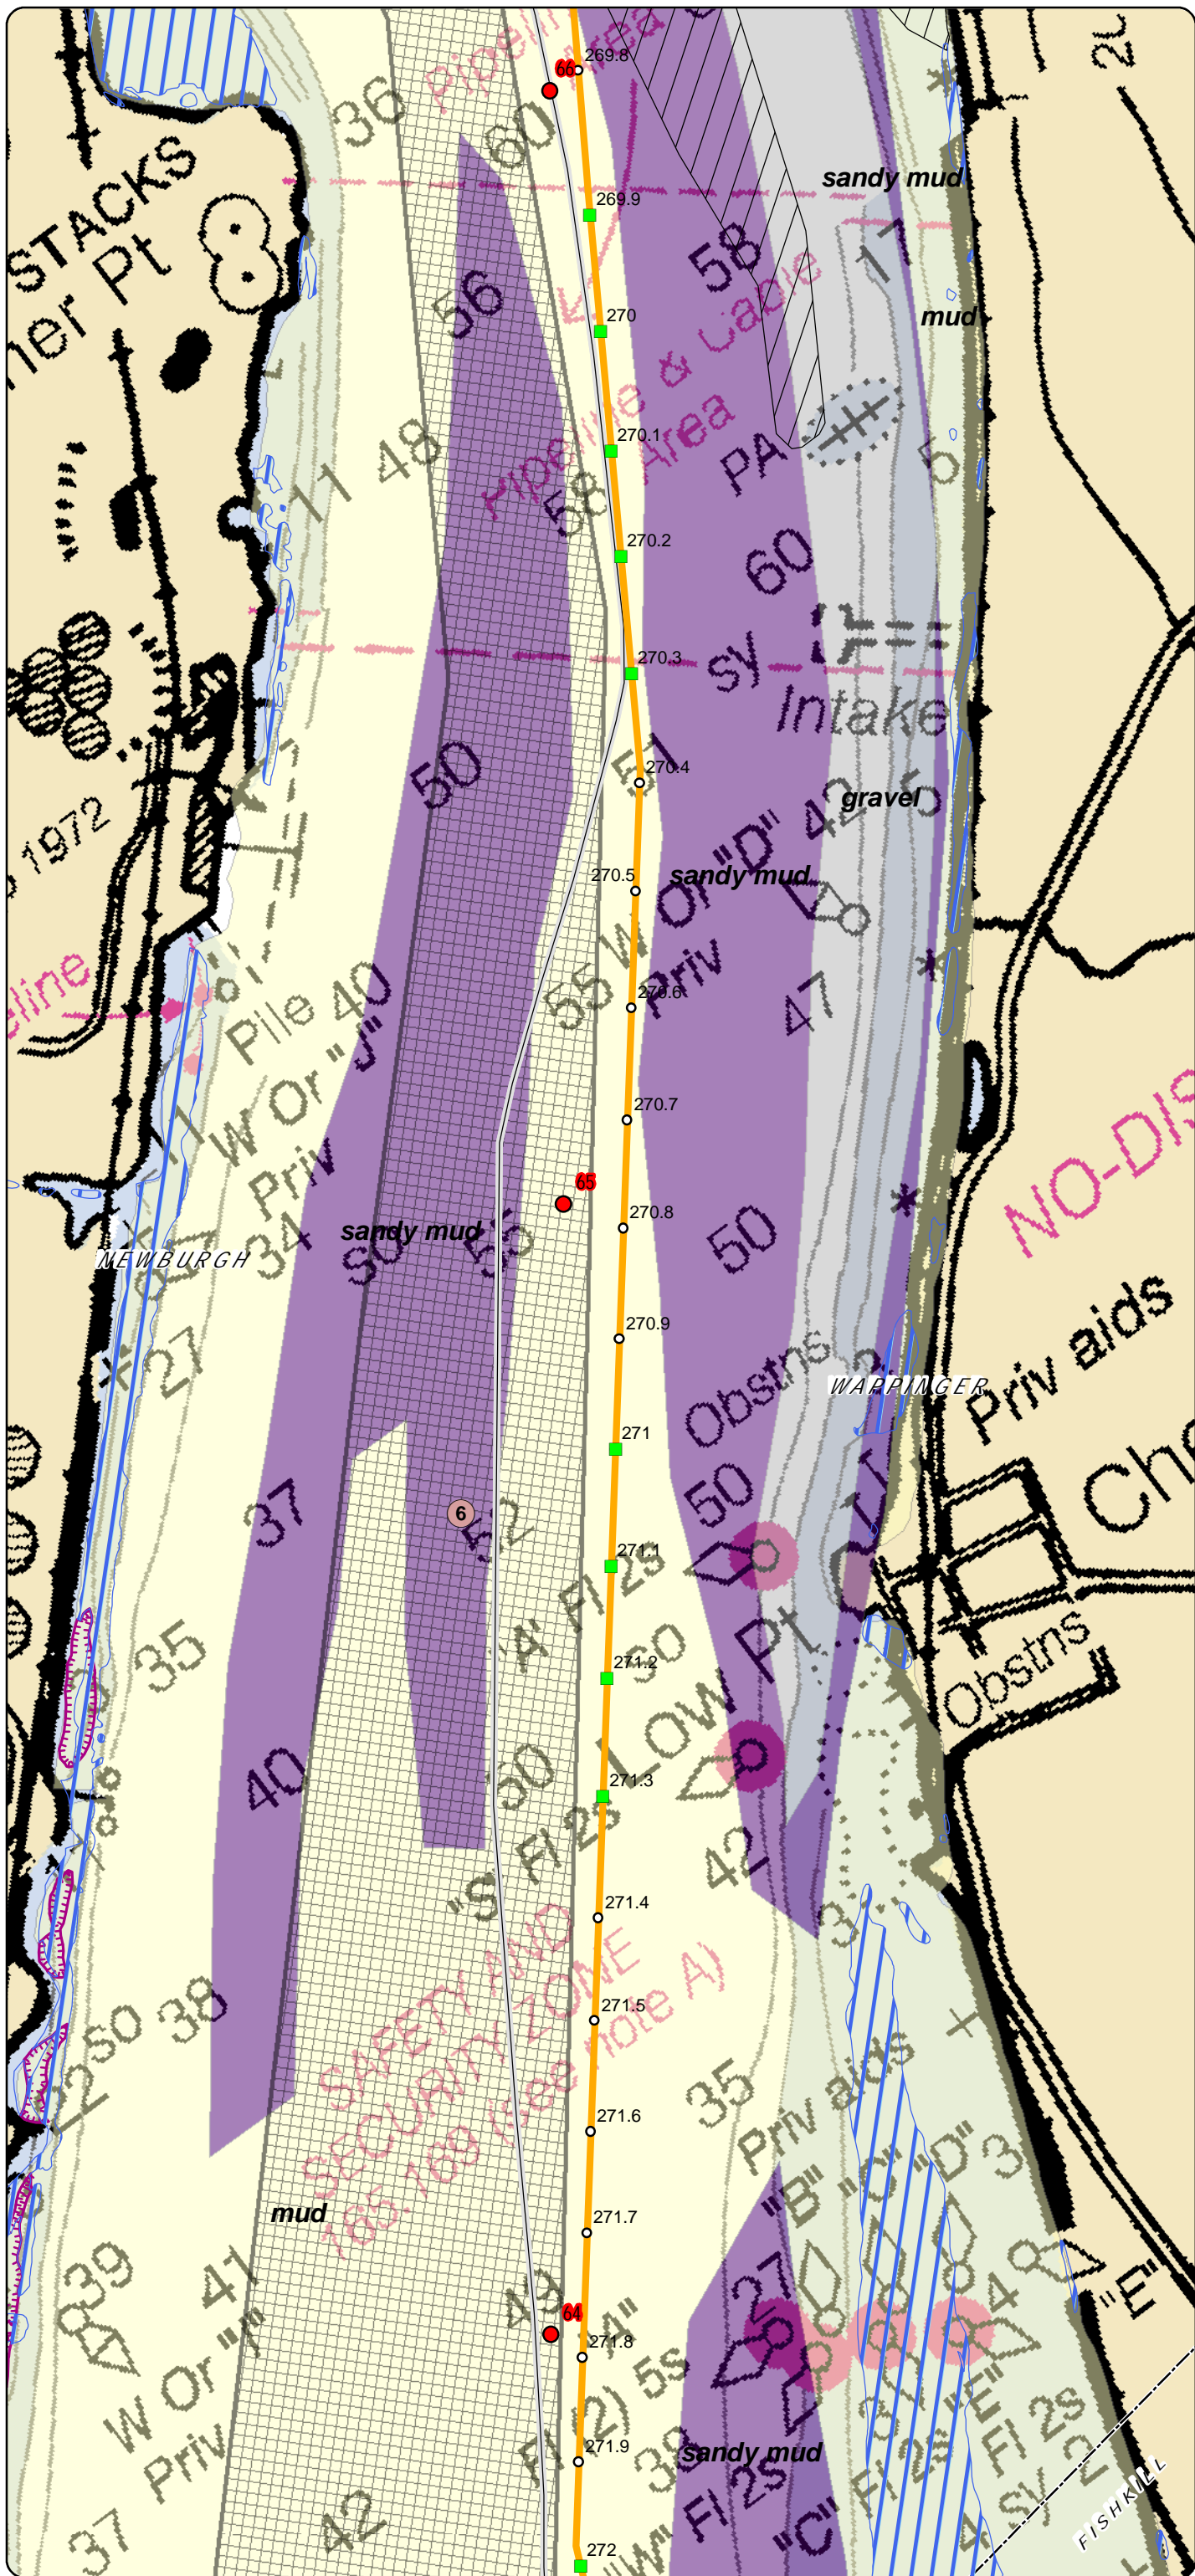



### LEGEND

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- 1 CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

#### Sediment Type - NYSDEC Hudson River Estuary Program

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud
- State Boundary
- County Boundary
- Town Boundary



Transmission  
Developers Inc.

Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*

---

## Hudson River Project Route



Sheet 20 of 43

---

Created: 6/18/2014

by:   & 



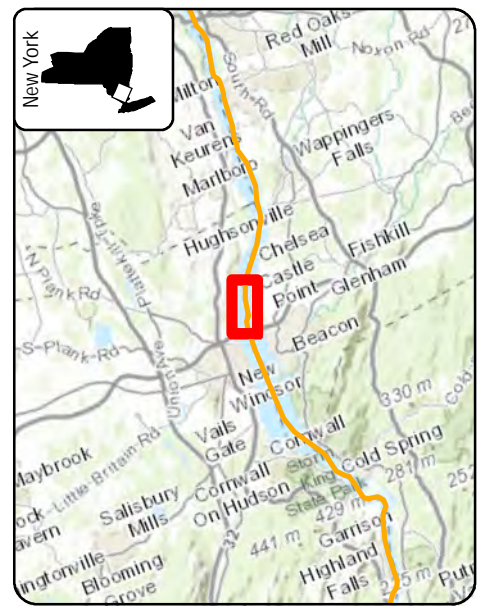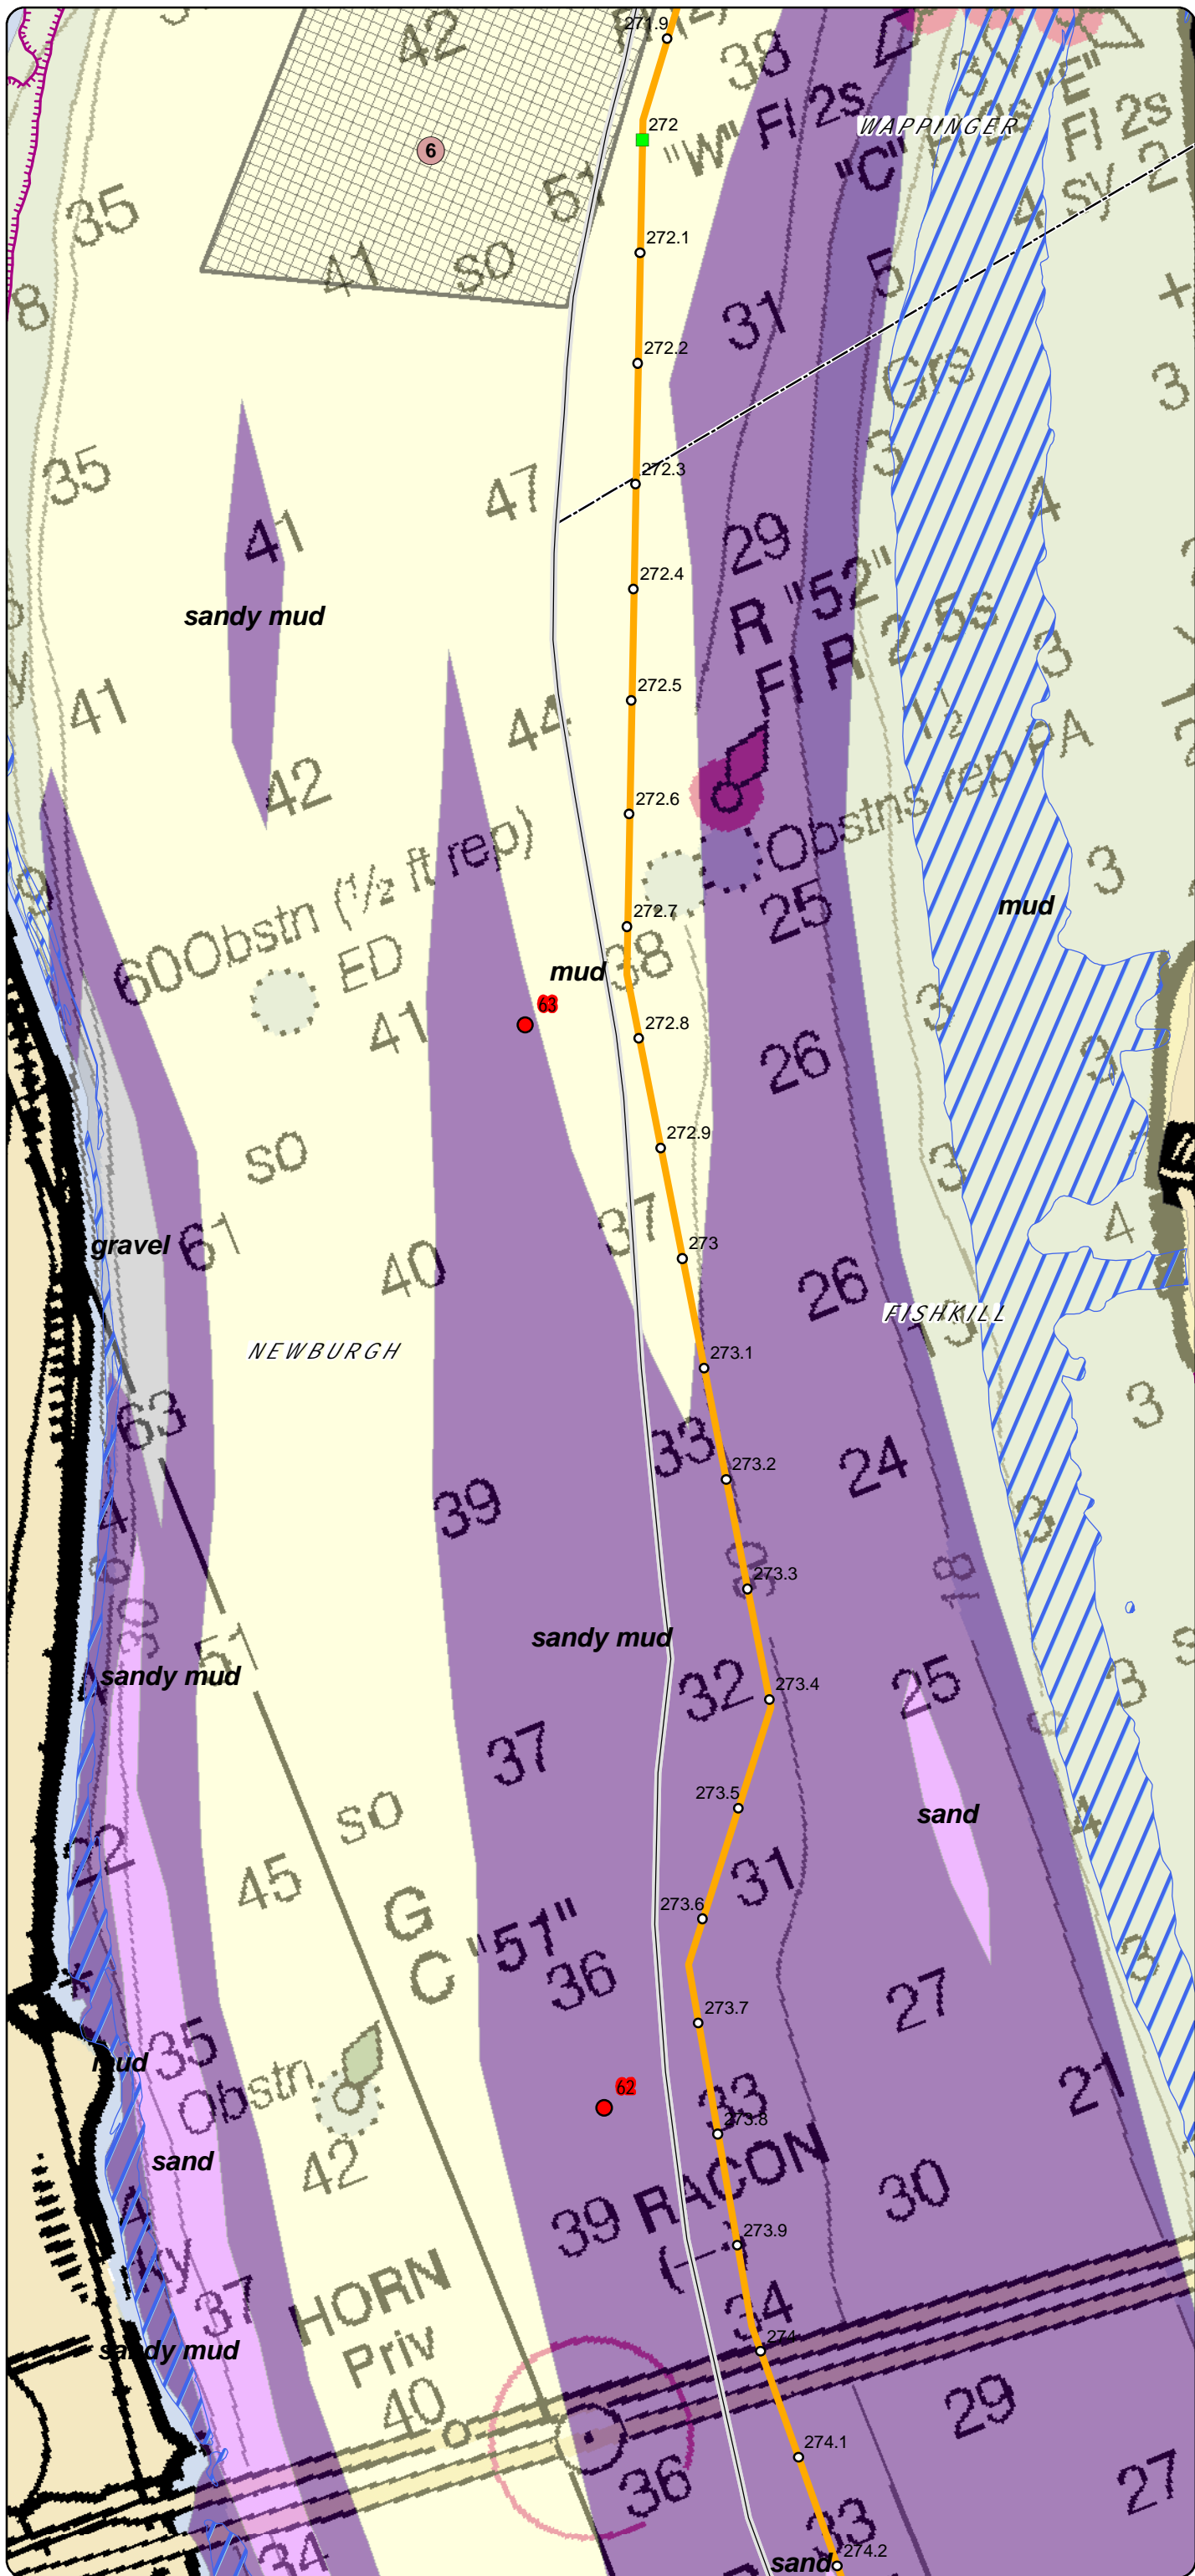

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- 1 CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

0 750  
 Feet

**Transmission Developers Inc.**  
 Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*  




---

**Hudson River Project Route**  
 Sheet 21 of 43  


---

 Created: 6/18/2014  
 by: &



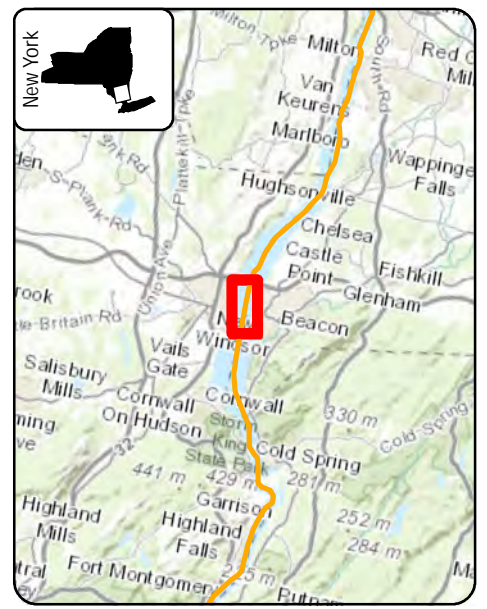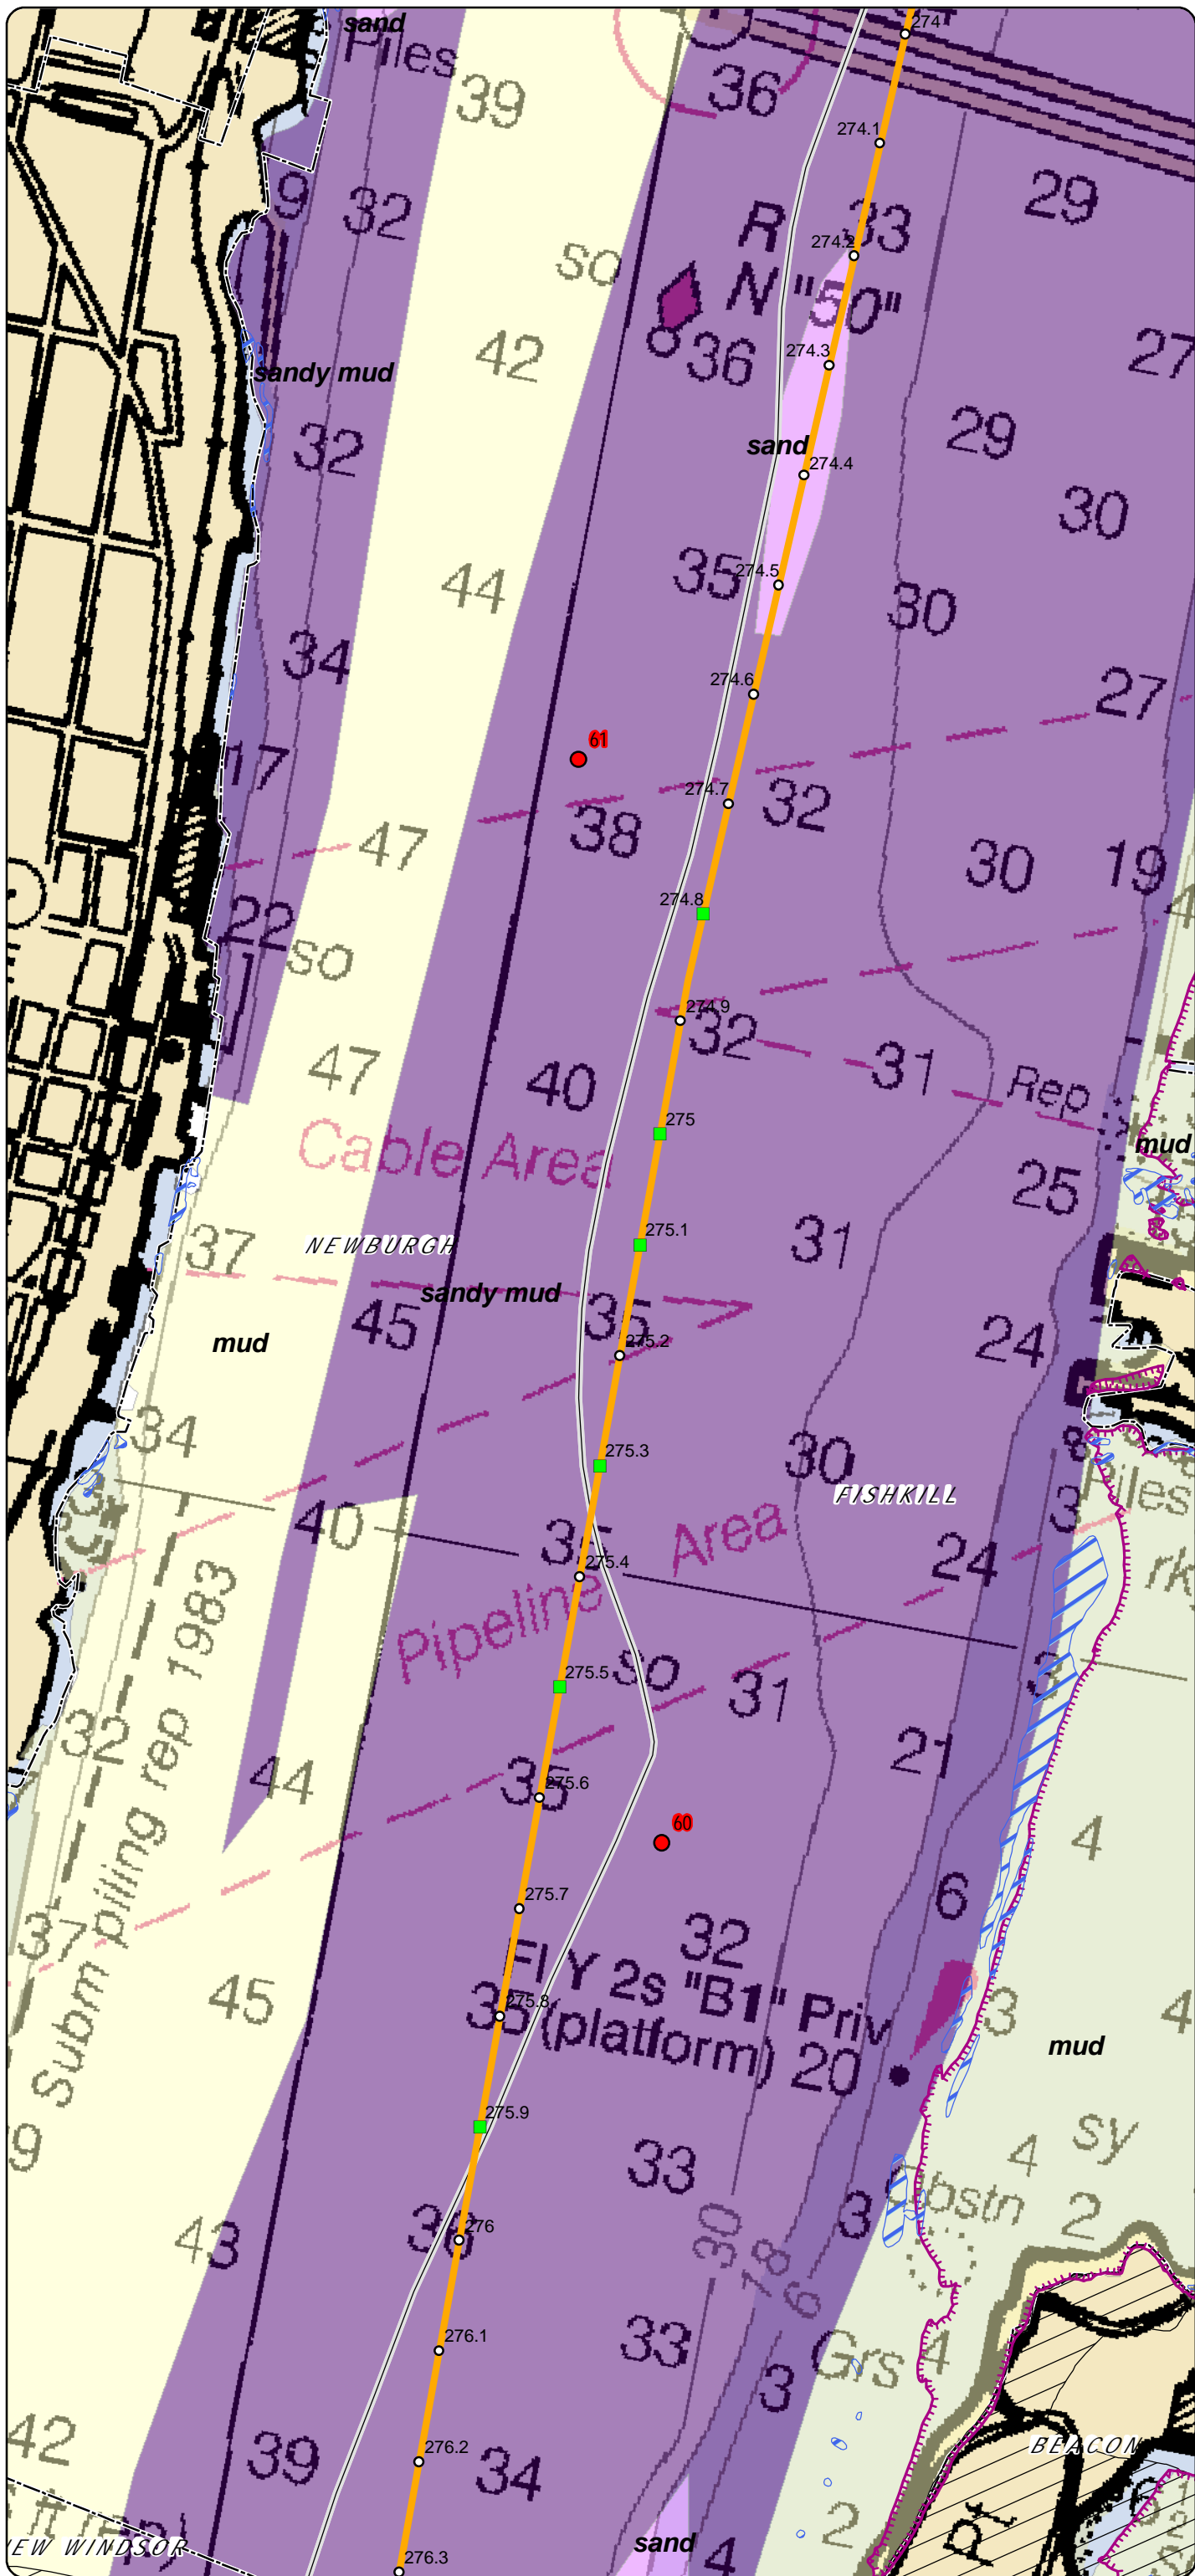

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- 1 CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) ④ Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

0 750  
Feet

**Transmission Developers Inc.**  
 Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*  




---

**Hudson River Project Route**  
 Sheet 22 of 43  


---

 Created: 6/18/2014  
 by: &



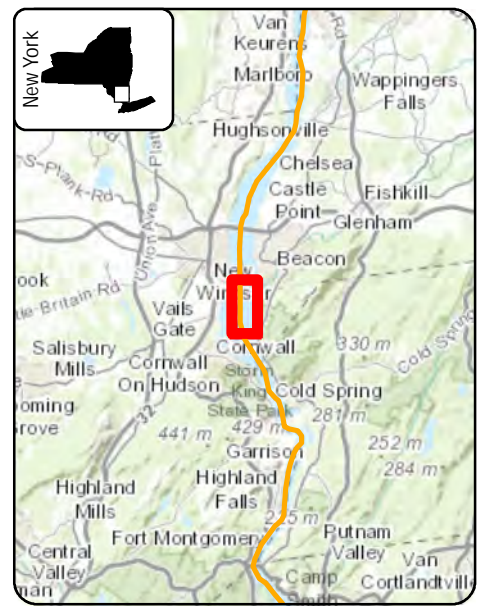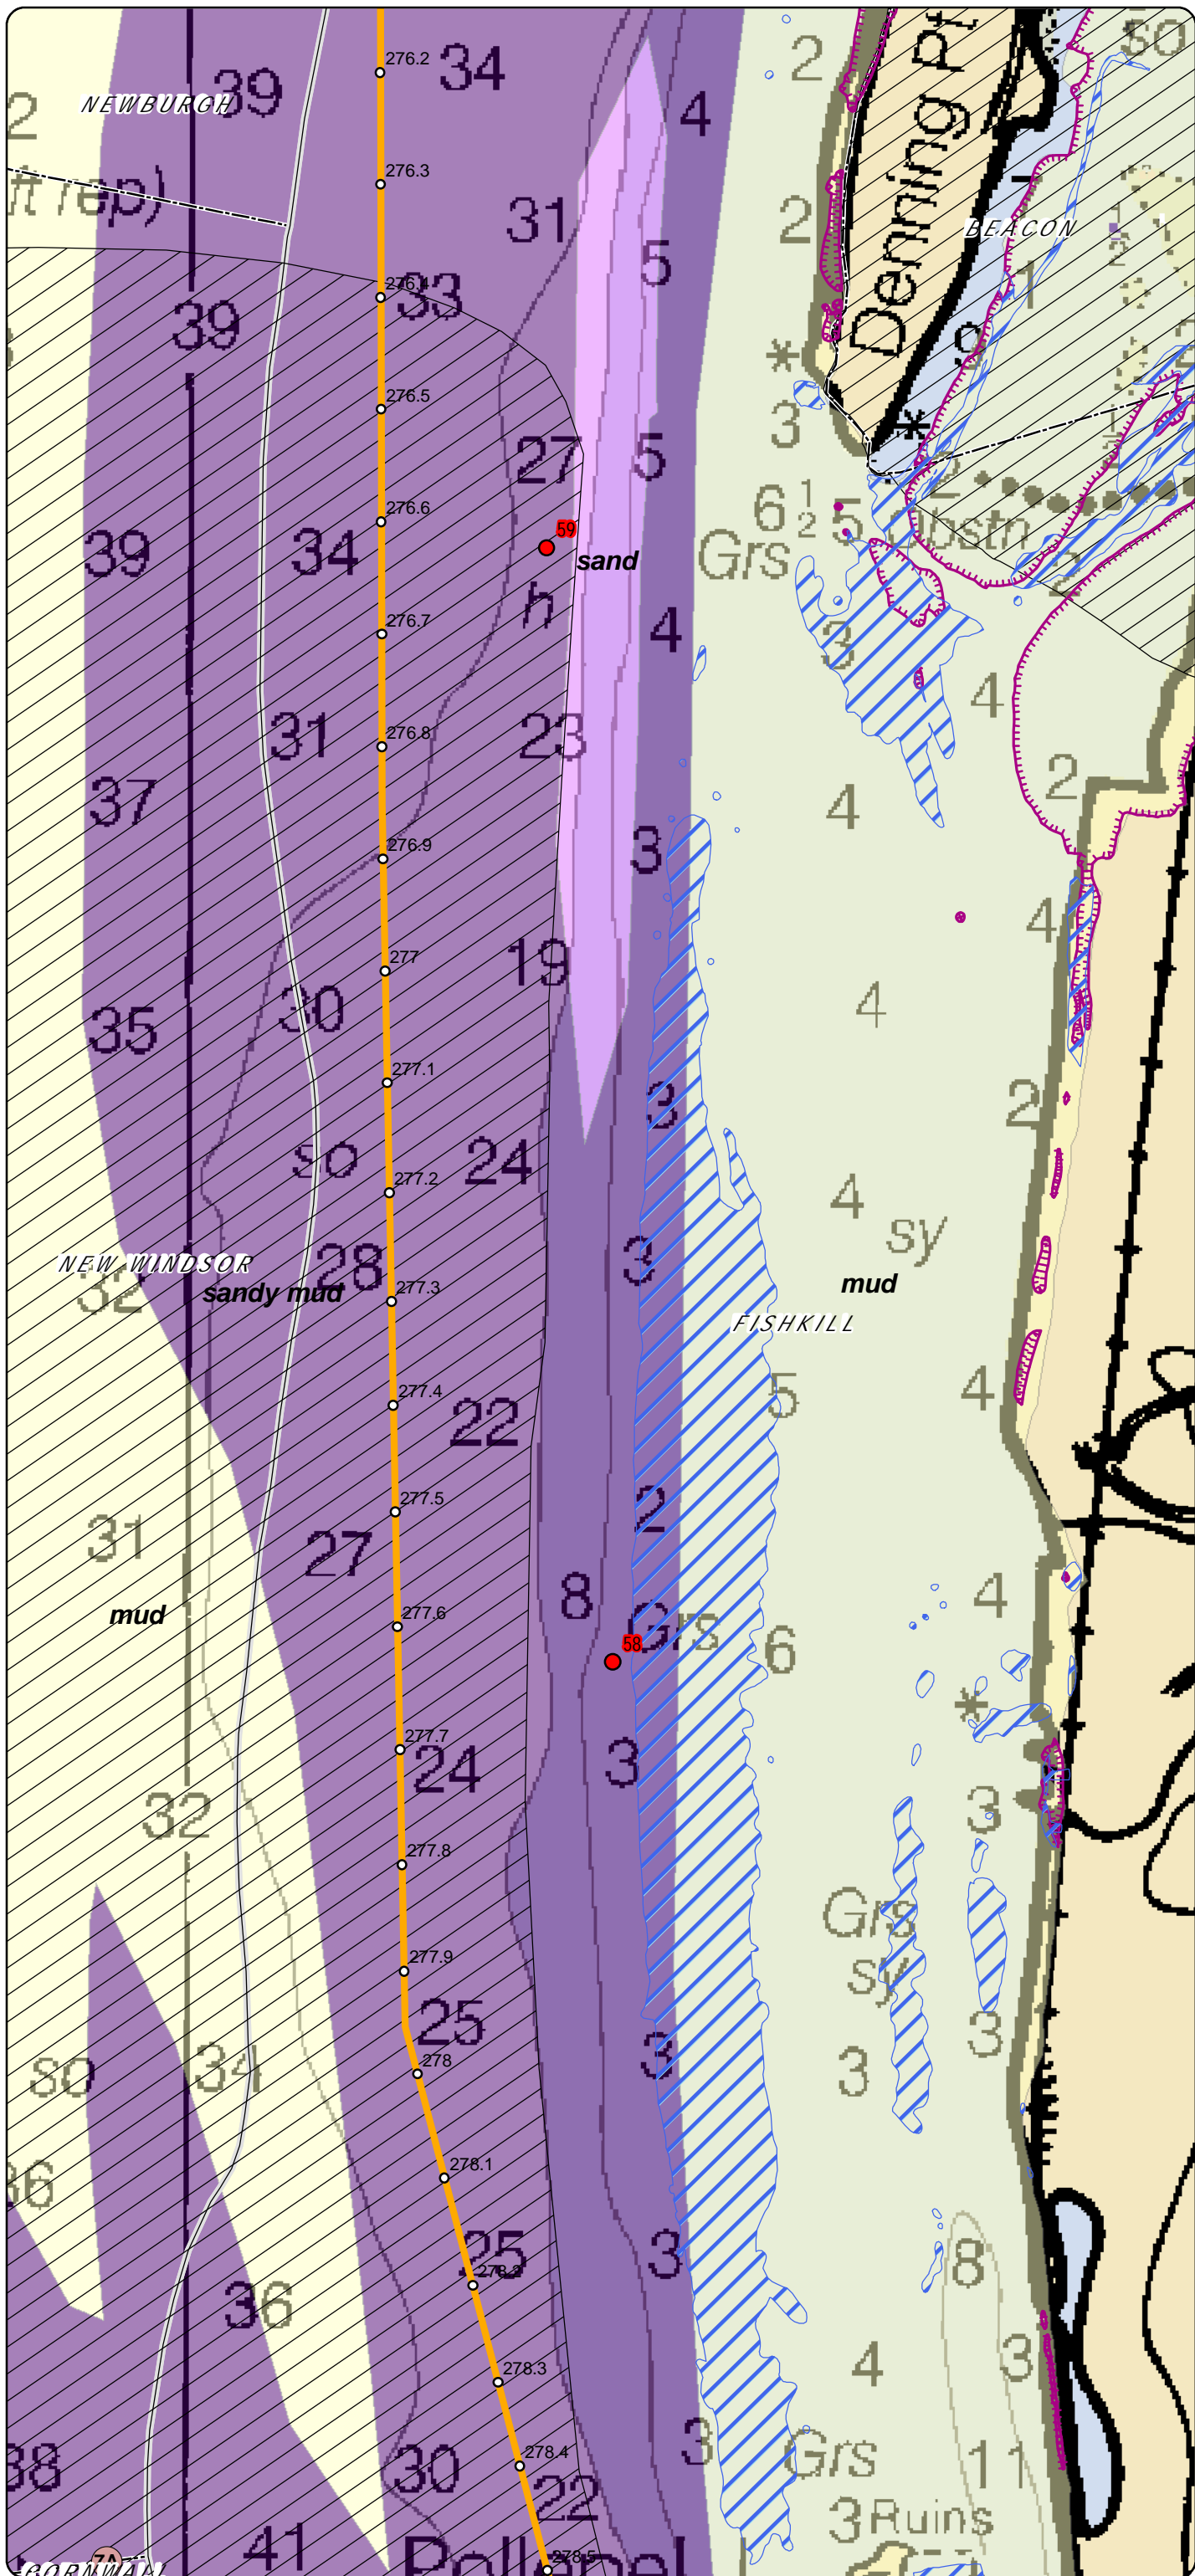

### LEGEND

- Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) ④ Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

### Sediment Type - NYSDEC Hudson River Estuary Program

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud
- State Boundary
- County Boundary
- Town Boundary

0 750  
Feet

**Transmission Developers Inc.**

Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*

---

**Hudson River Project Route**


Sheet 23 of 43

---

Created: 6/18/2014

by: &



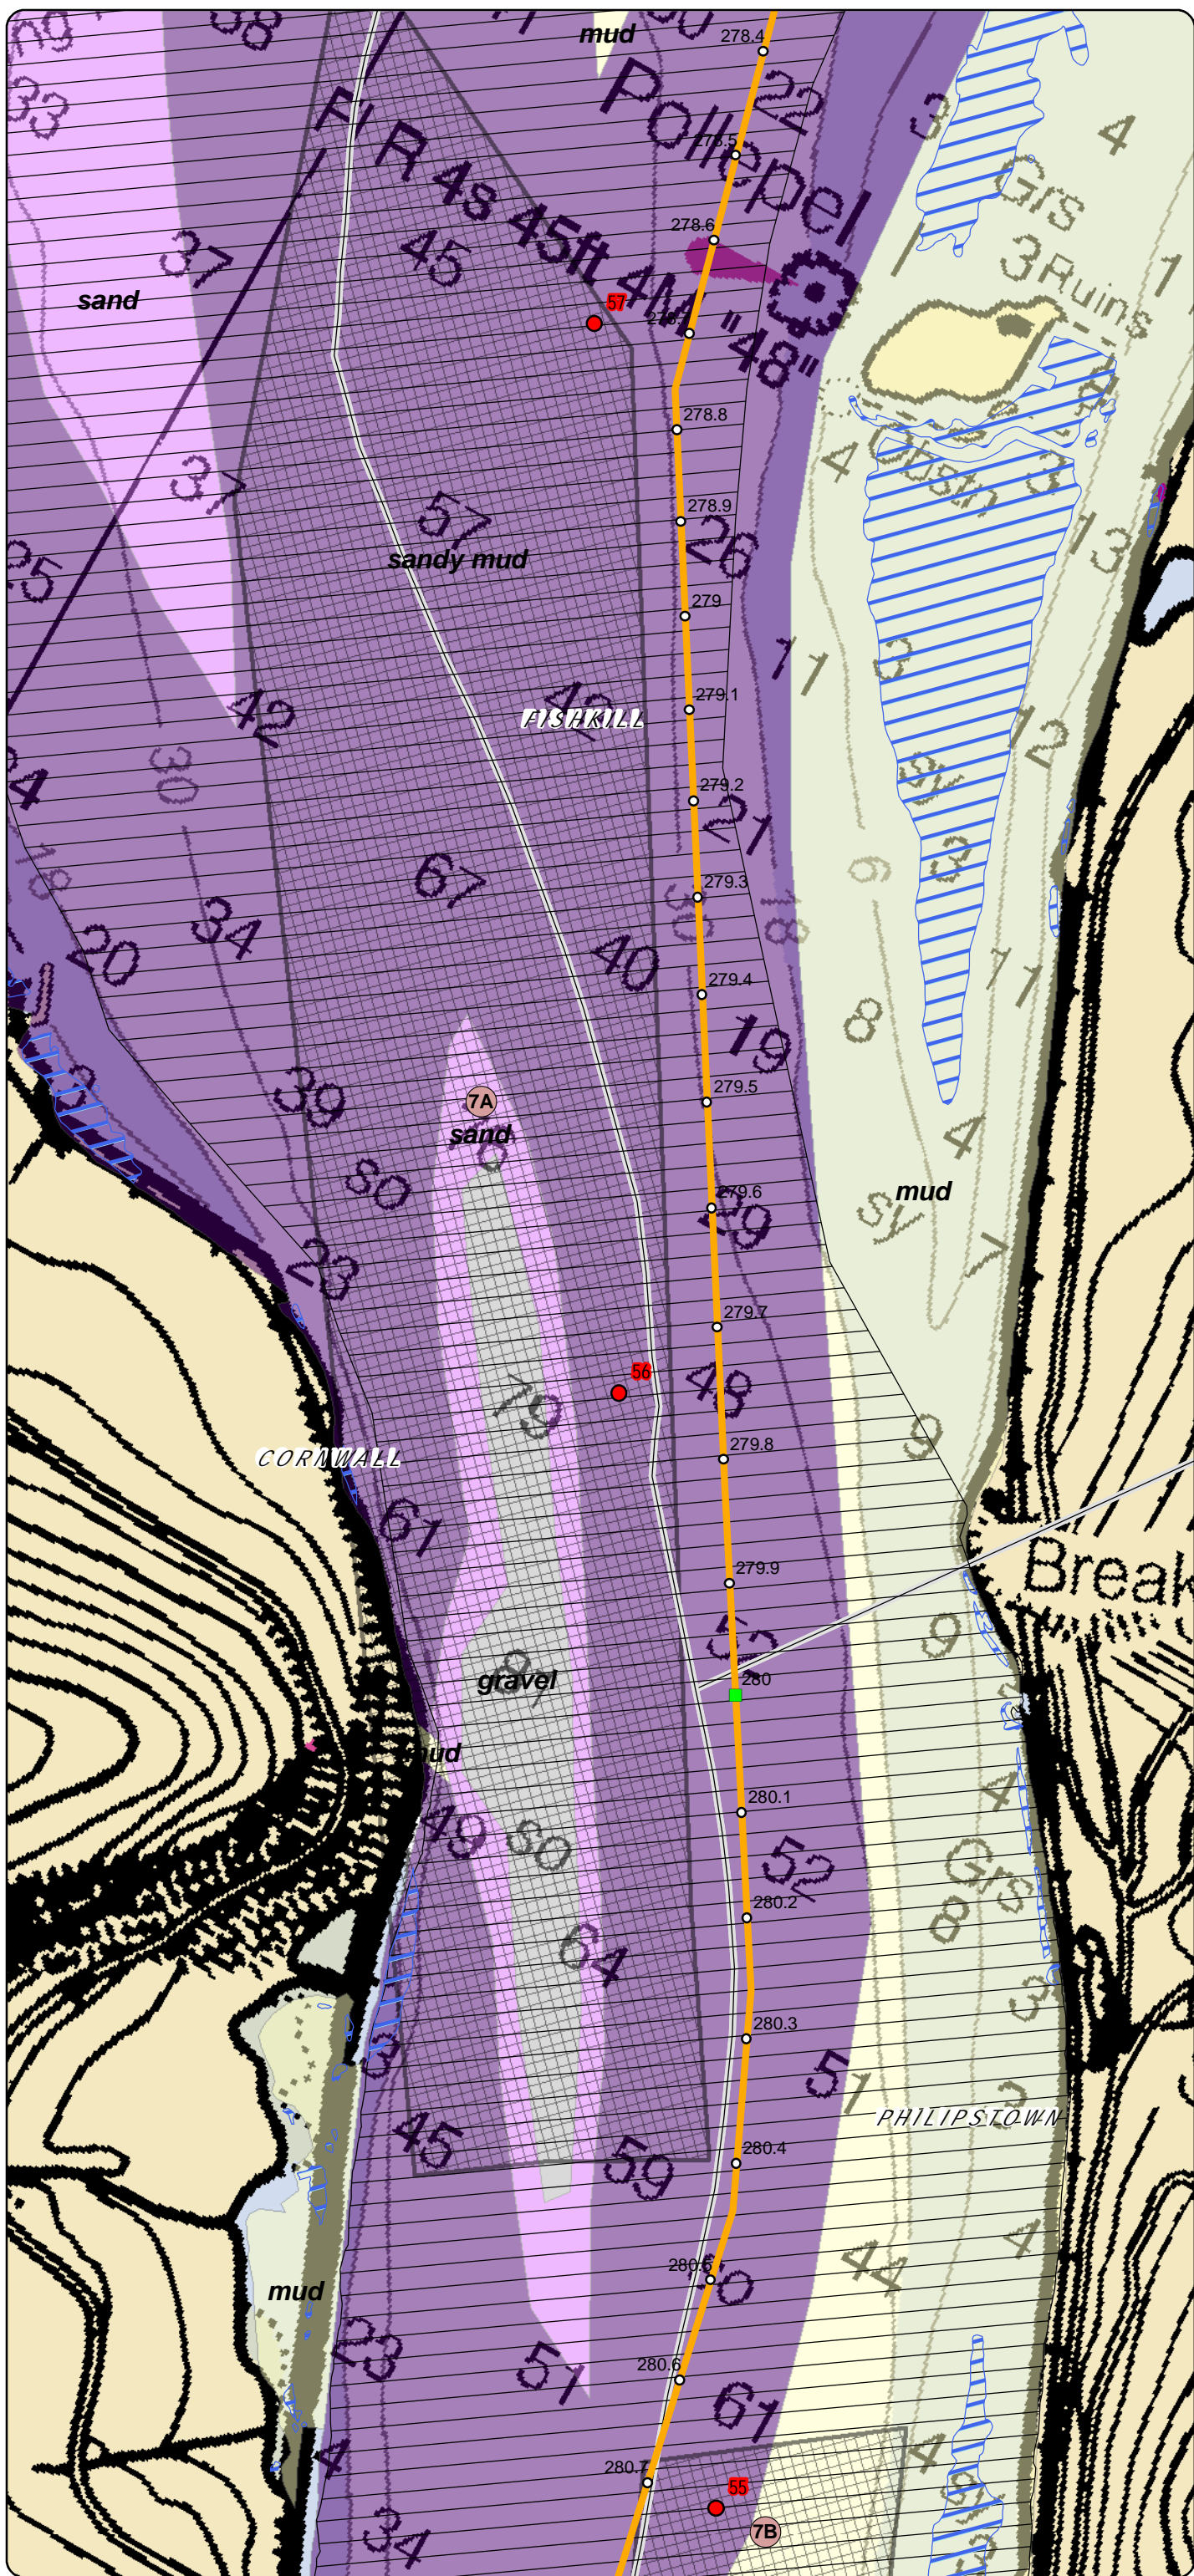

### LEGEND

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC)  Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

#### Sediment Type - NYSDEC Hudson River Estuary Program

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

Transmission Developers Inc.

Champlain Hudson Power Express Project  
Champlain Hudson Power Express Inc.


## Hudson River Project Route

Sheet 24 of 43

Created: 6/18/2014

by: &



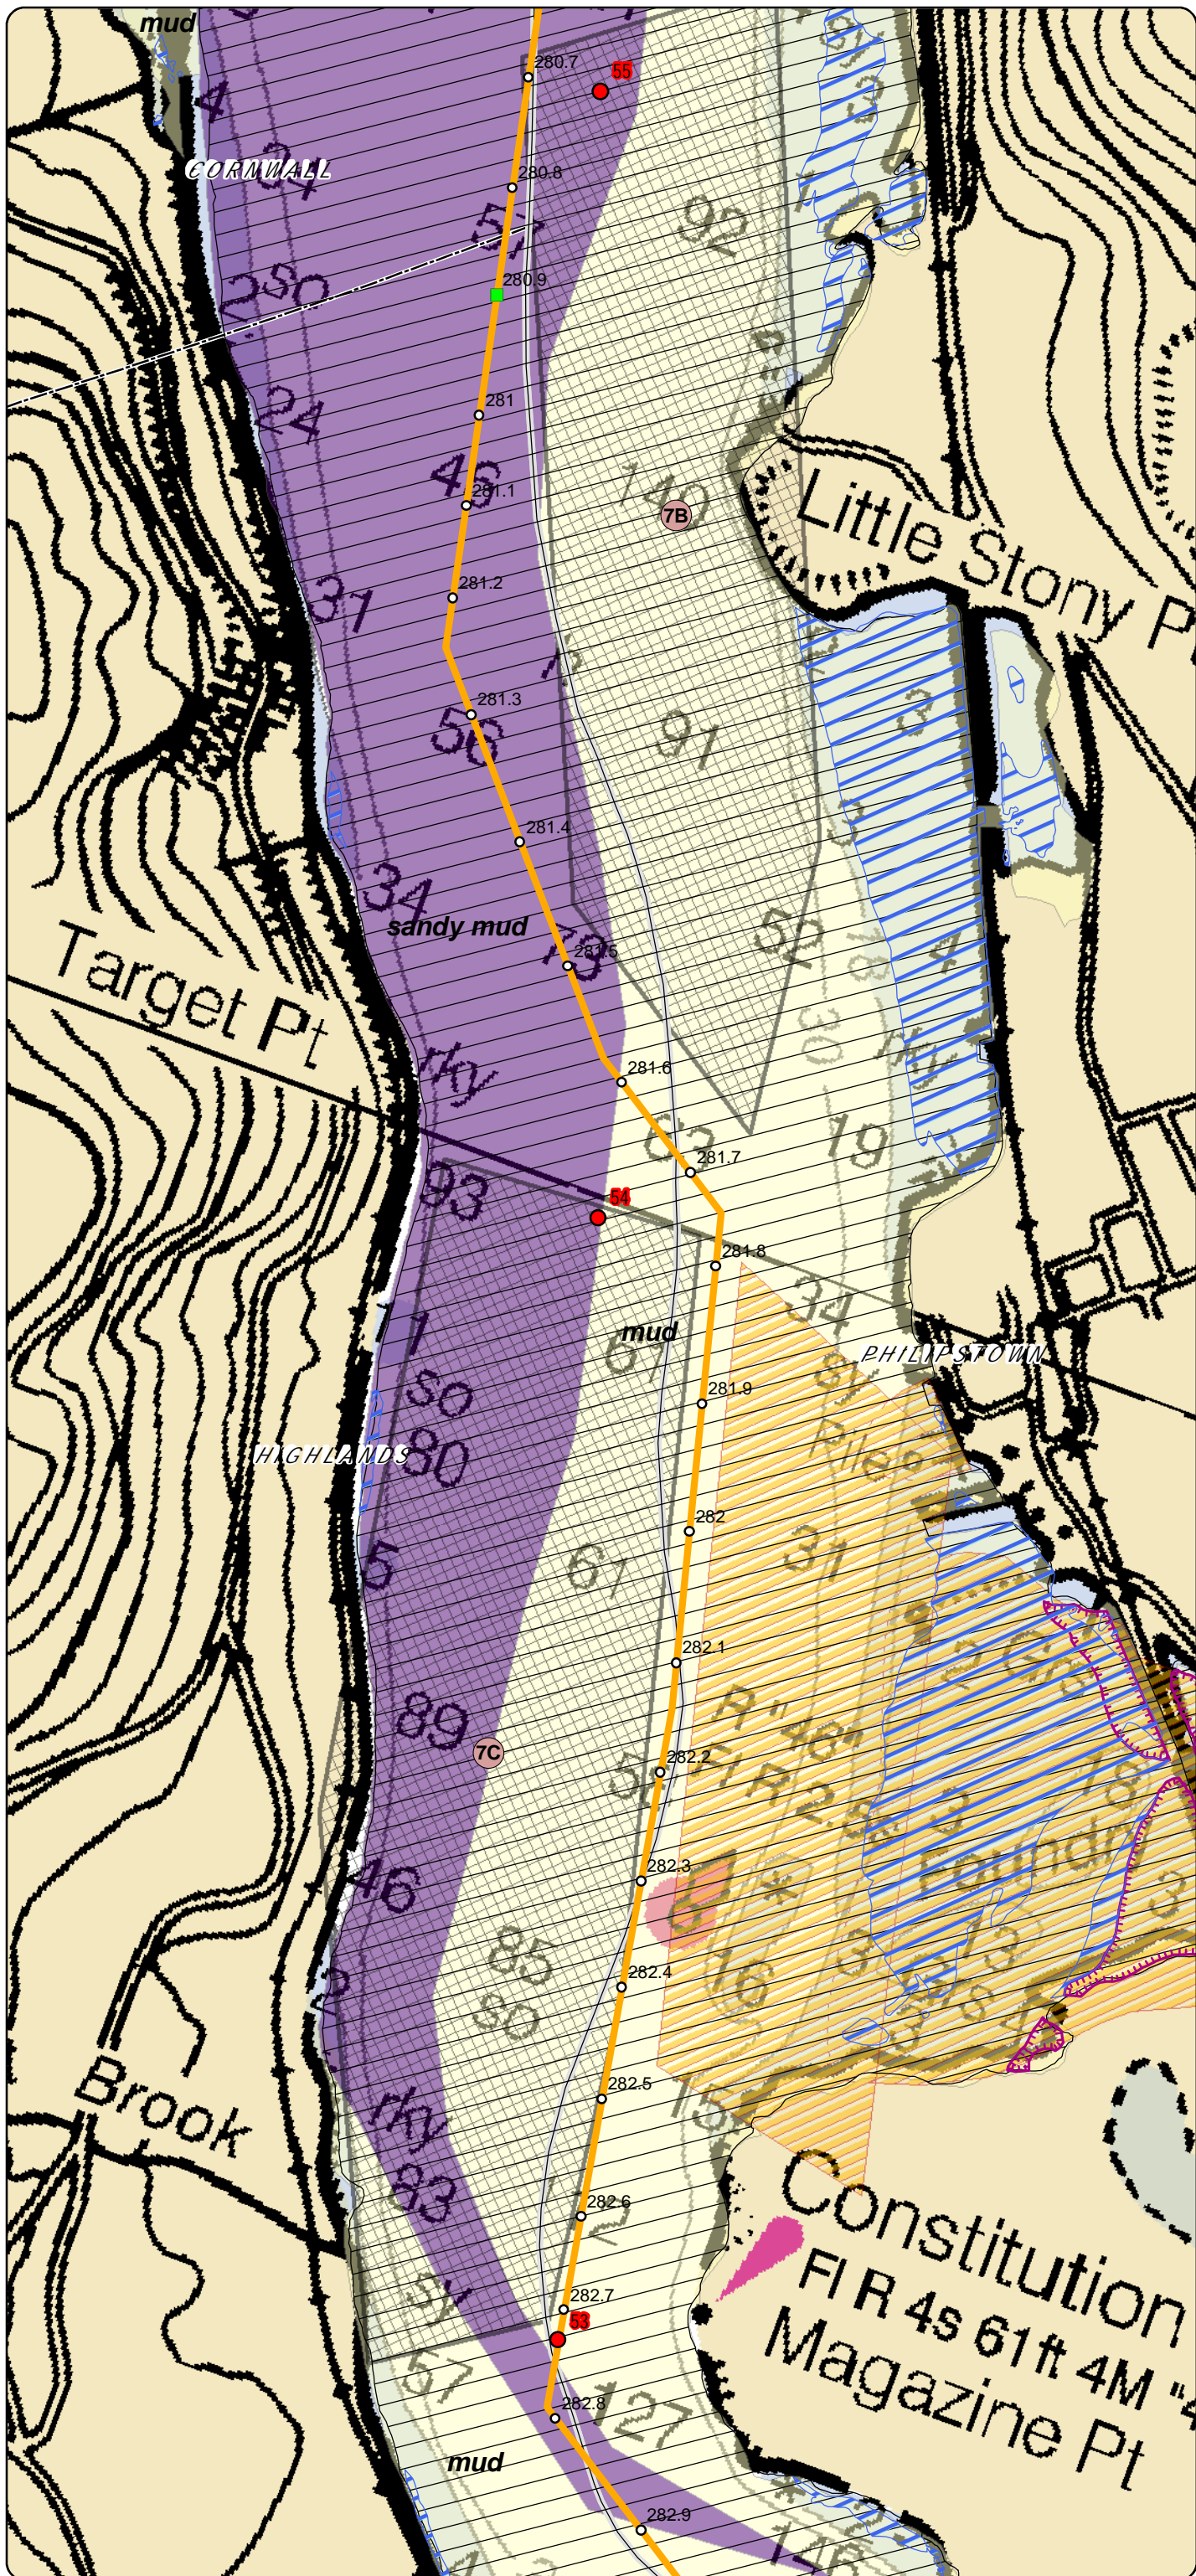

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- 1 CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

**Transmission Developers Inc.**  
 Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*


---

**Hudson River Project Route**  
 Sheet 25 of 43

---

Created: 6/18/2014  
 by: &



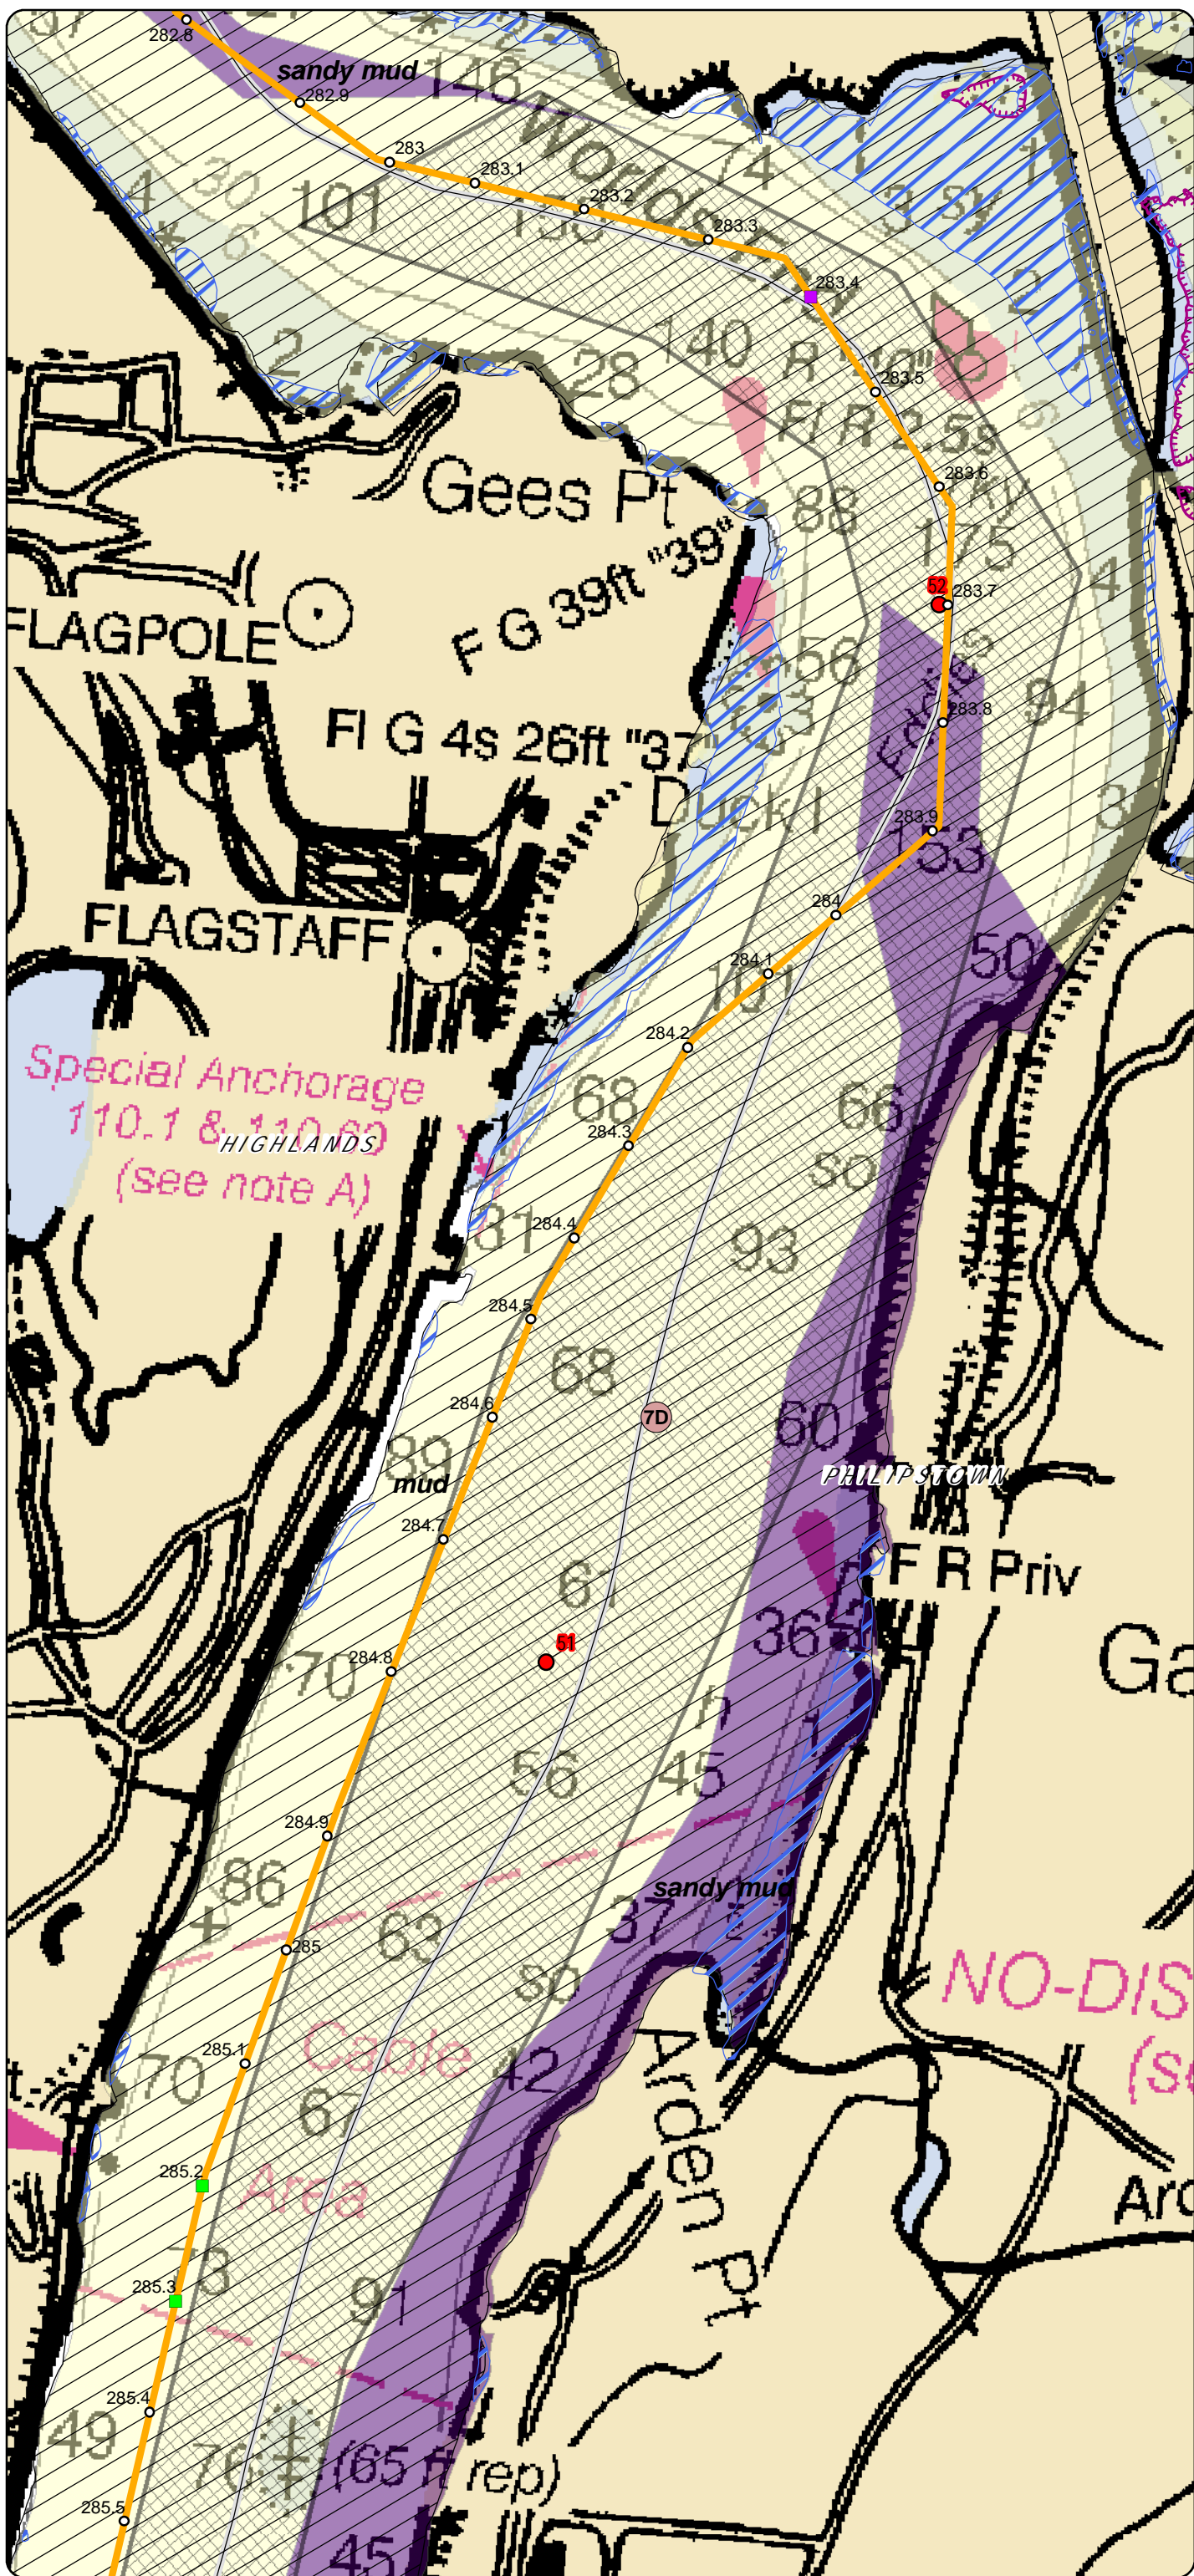

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- 1 CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

0 750  
 Feet

Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*  



---

**Hudson River Project Route**  
 Sheet 26 of 43  


---

 Created: 6/18/2014  
 by: &



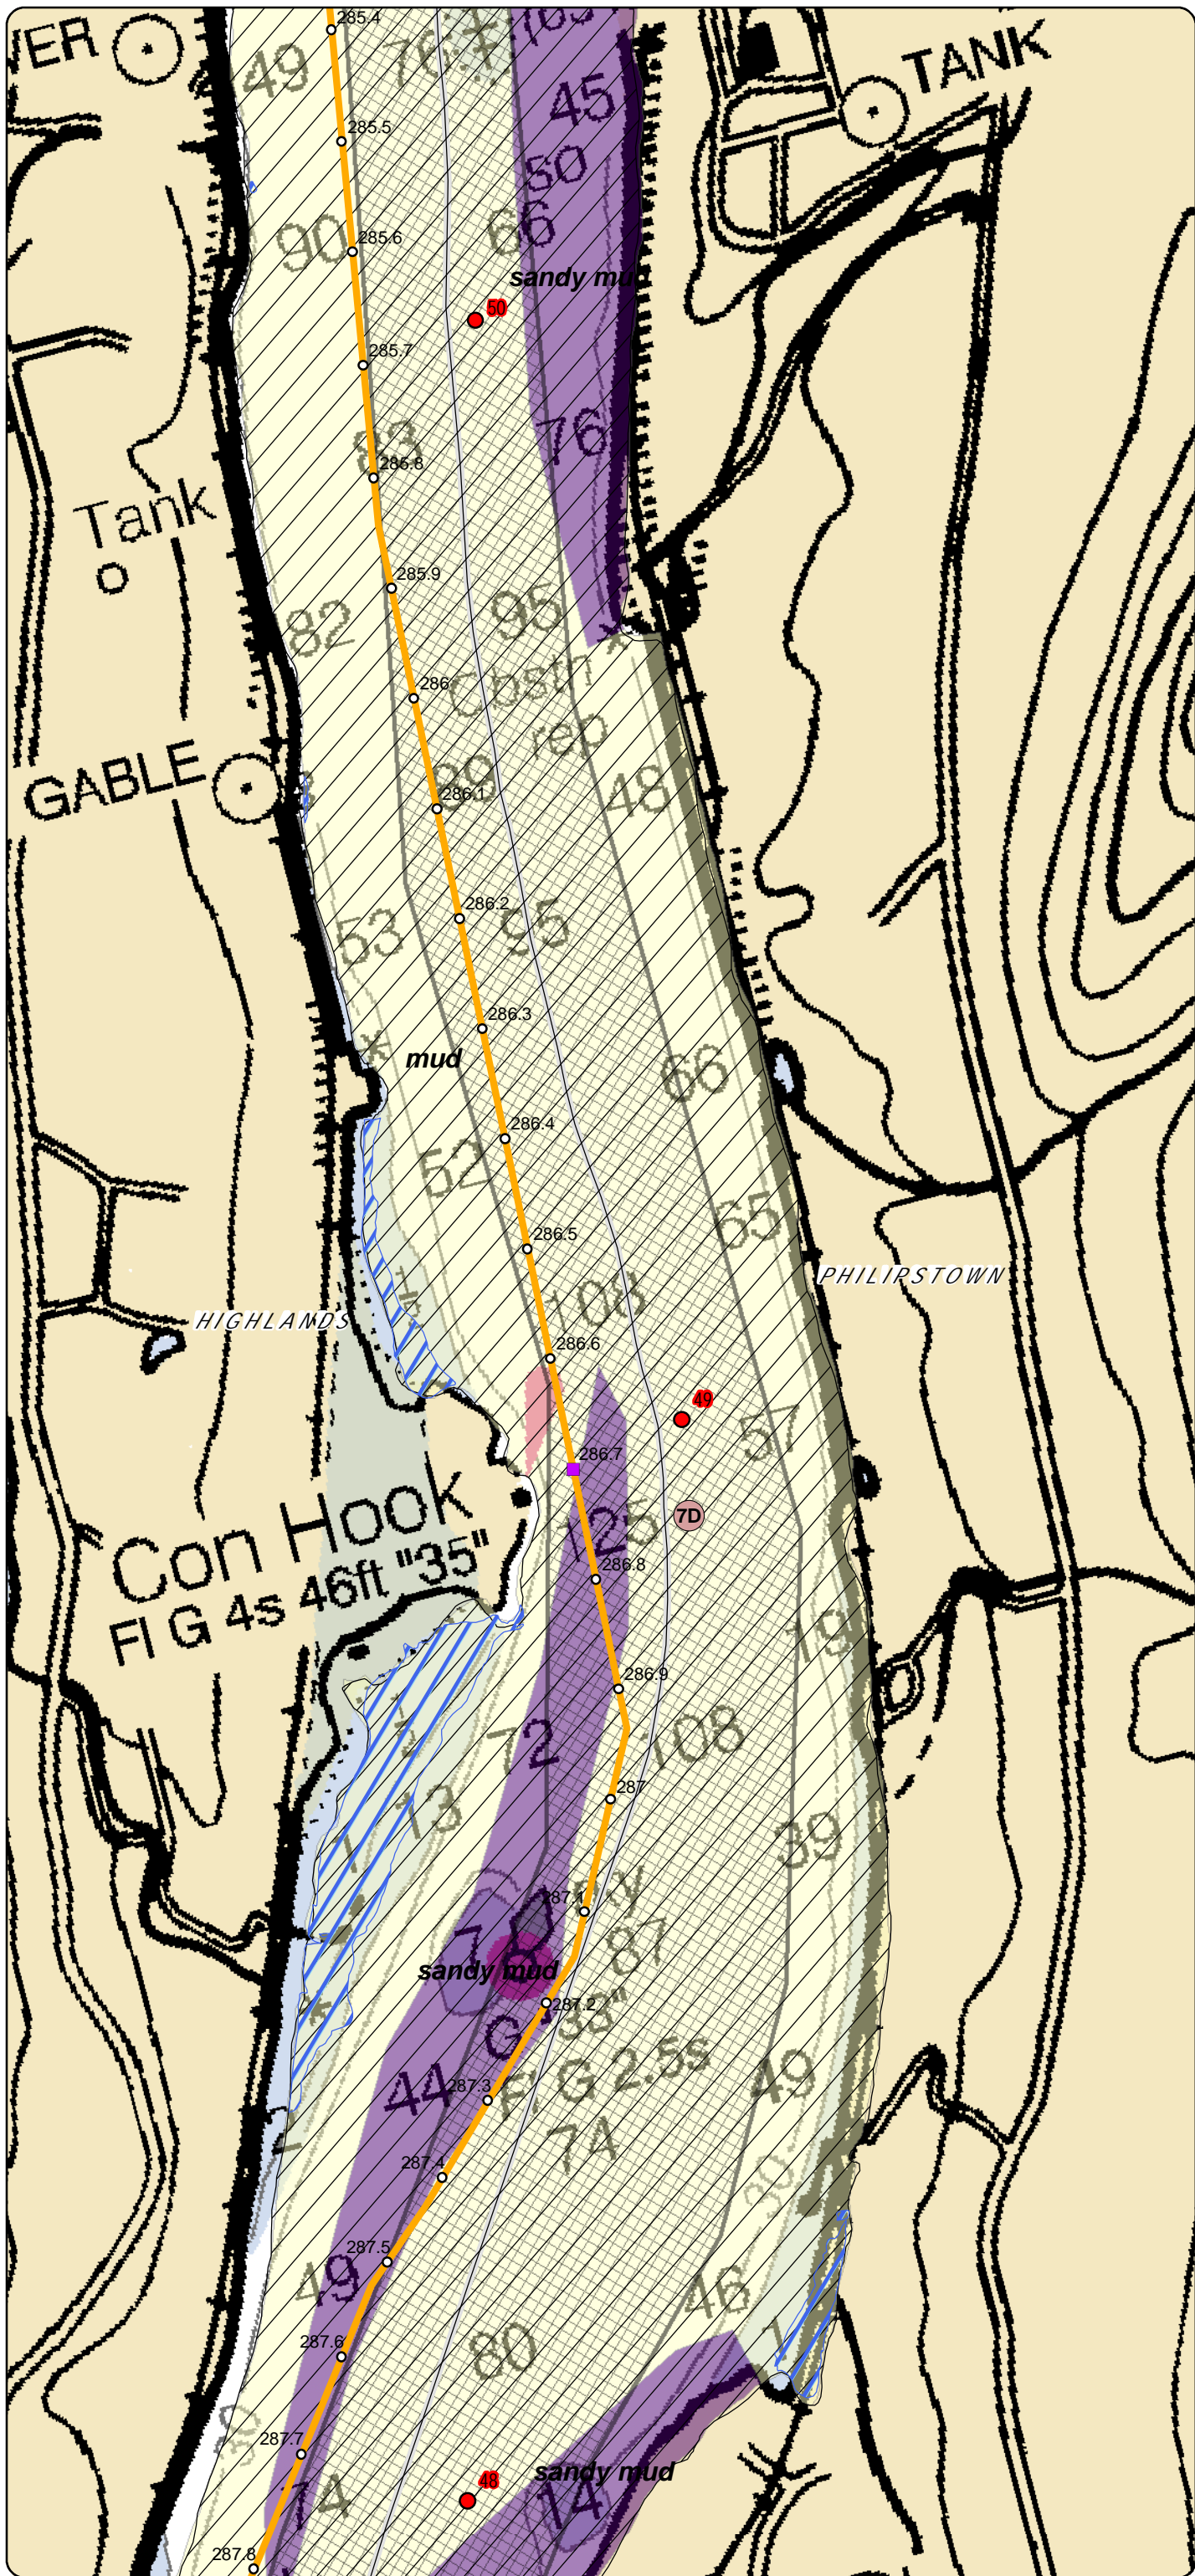


**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- 1 CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud
- State Boundary
- County Boundary
- Town Boundary

  
 0 750  
 Feet

  
**Transmission Developers Inc.**  
 Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*  



---

**Hudson River Project Route**  
 Sheet 27 of 43  


---

 Created: 6/18/2014  
 by:   & 



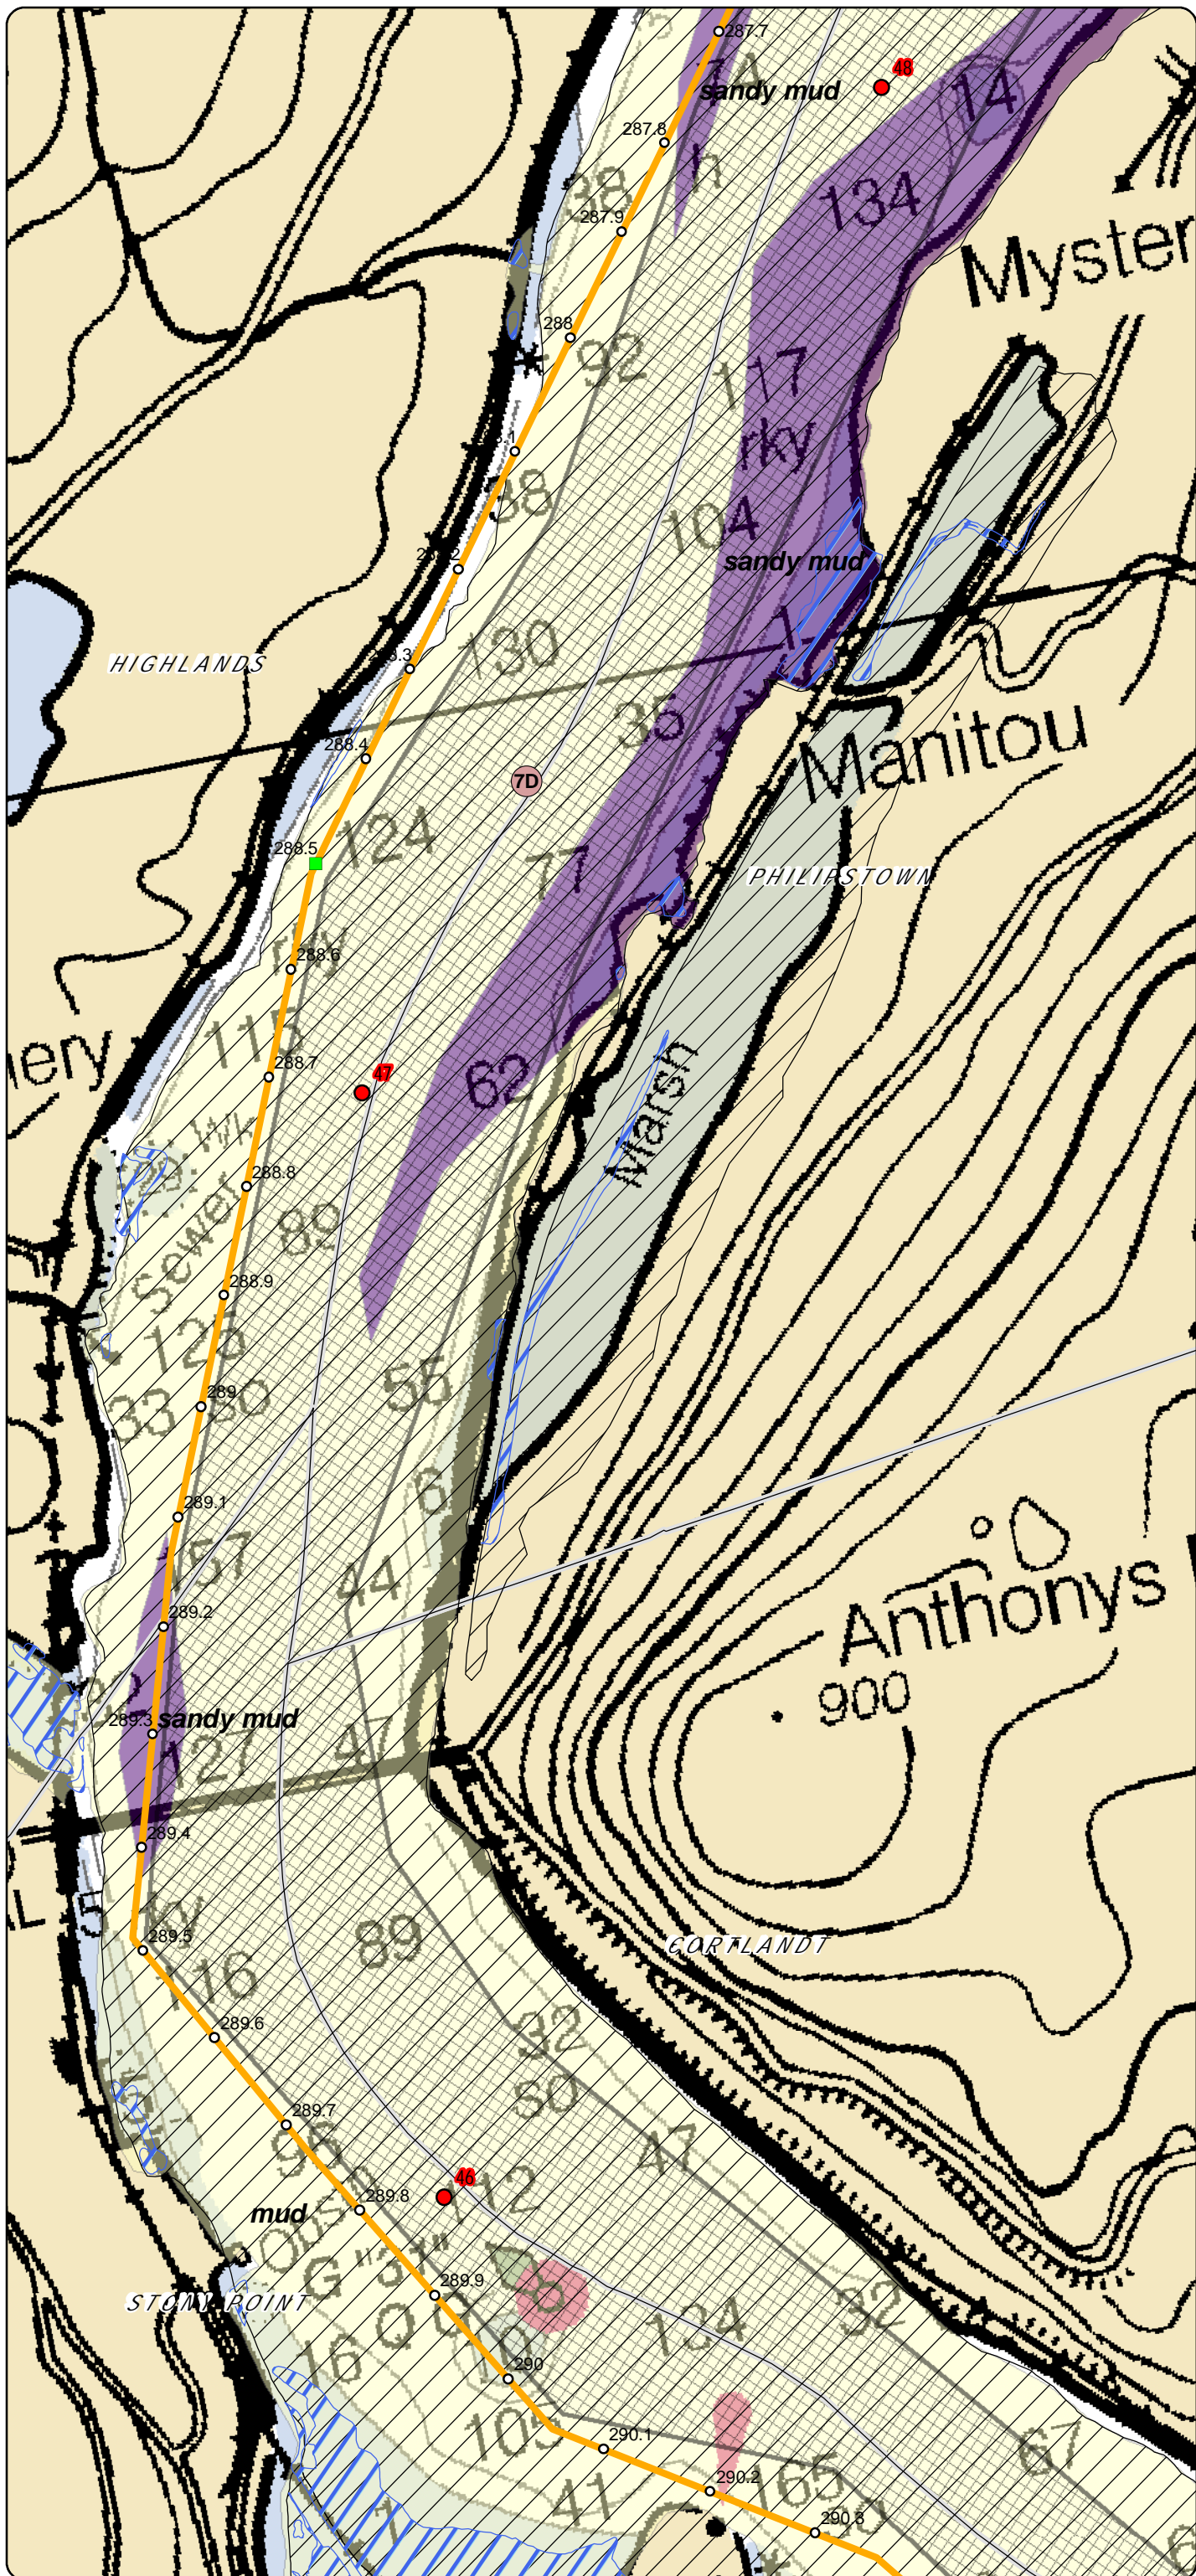

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- 1 CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

0 750  
 Feet

Transmission Developers Inc.  
 Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*



---

**Hudson River Project Route**  
 Sheet 28 of 43

---

Created: 6/18/2014  
 by: &



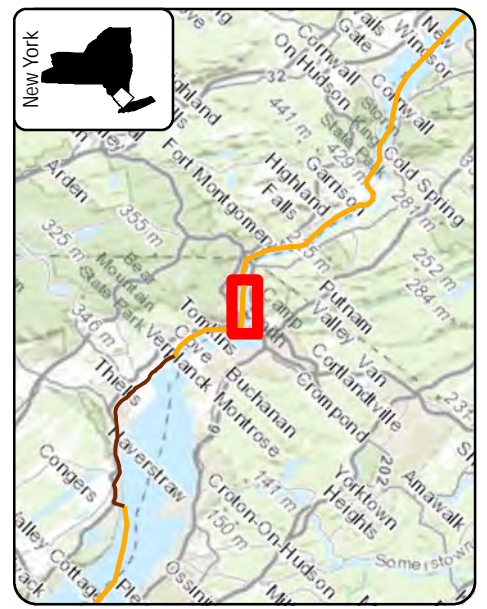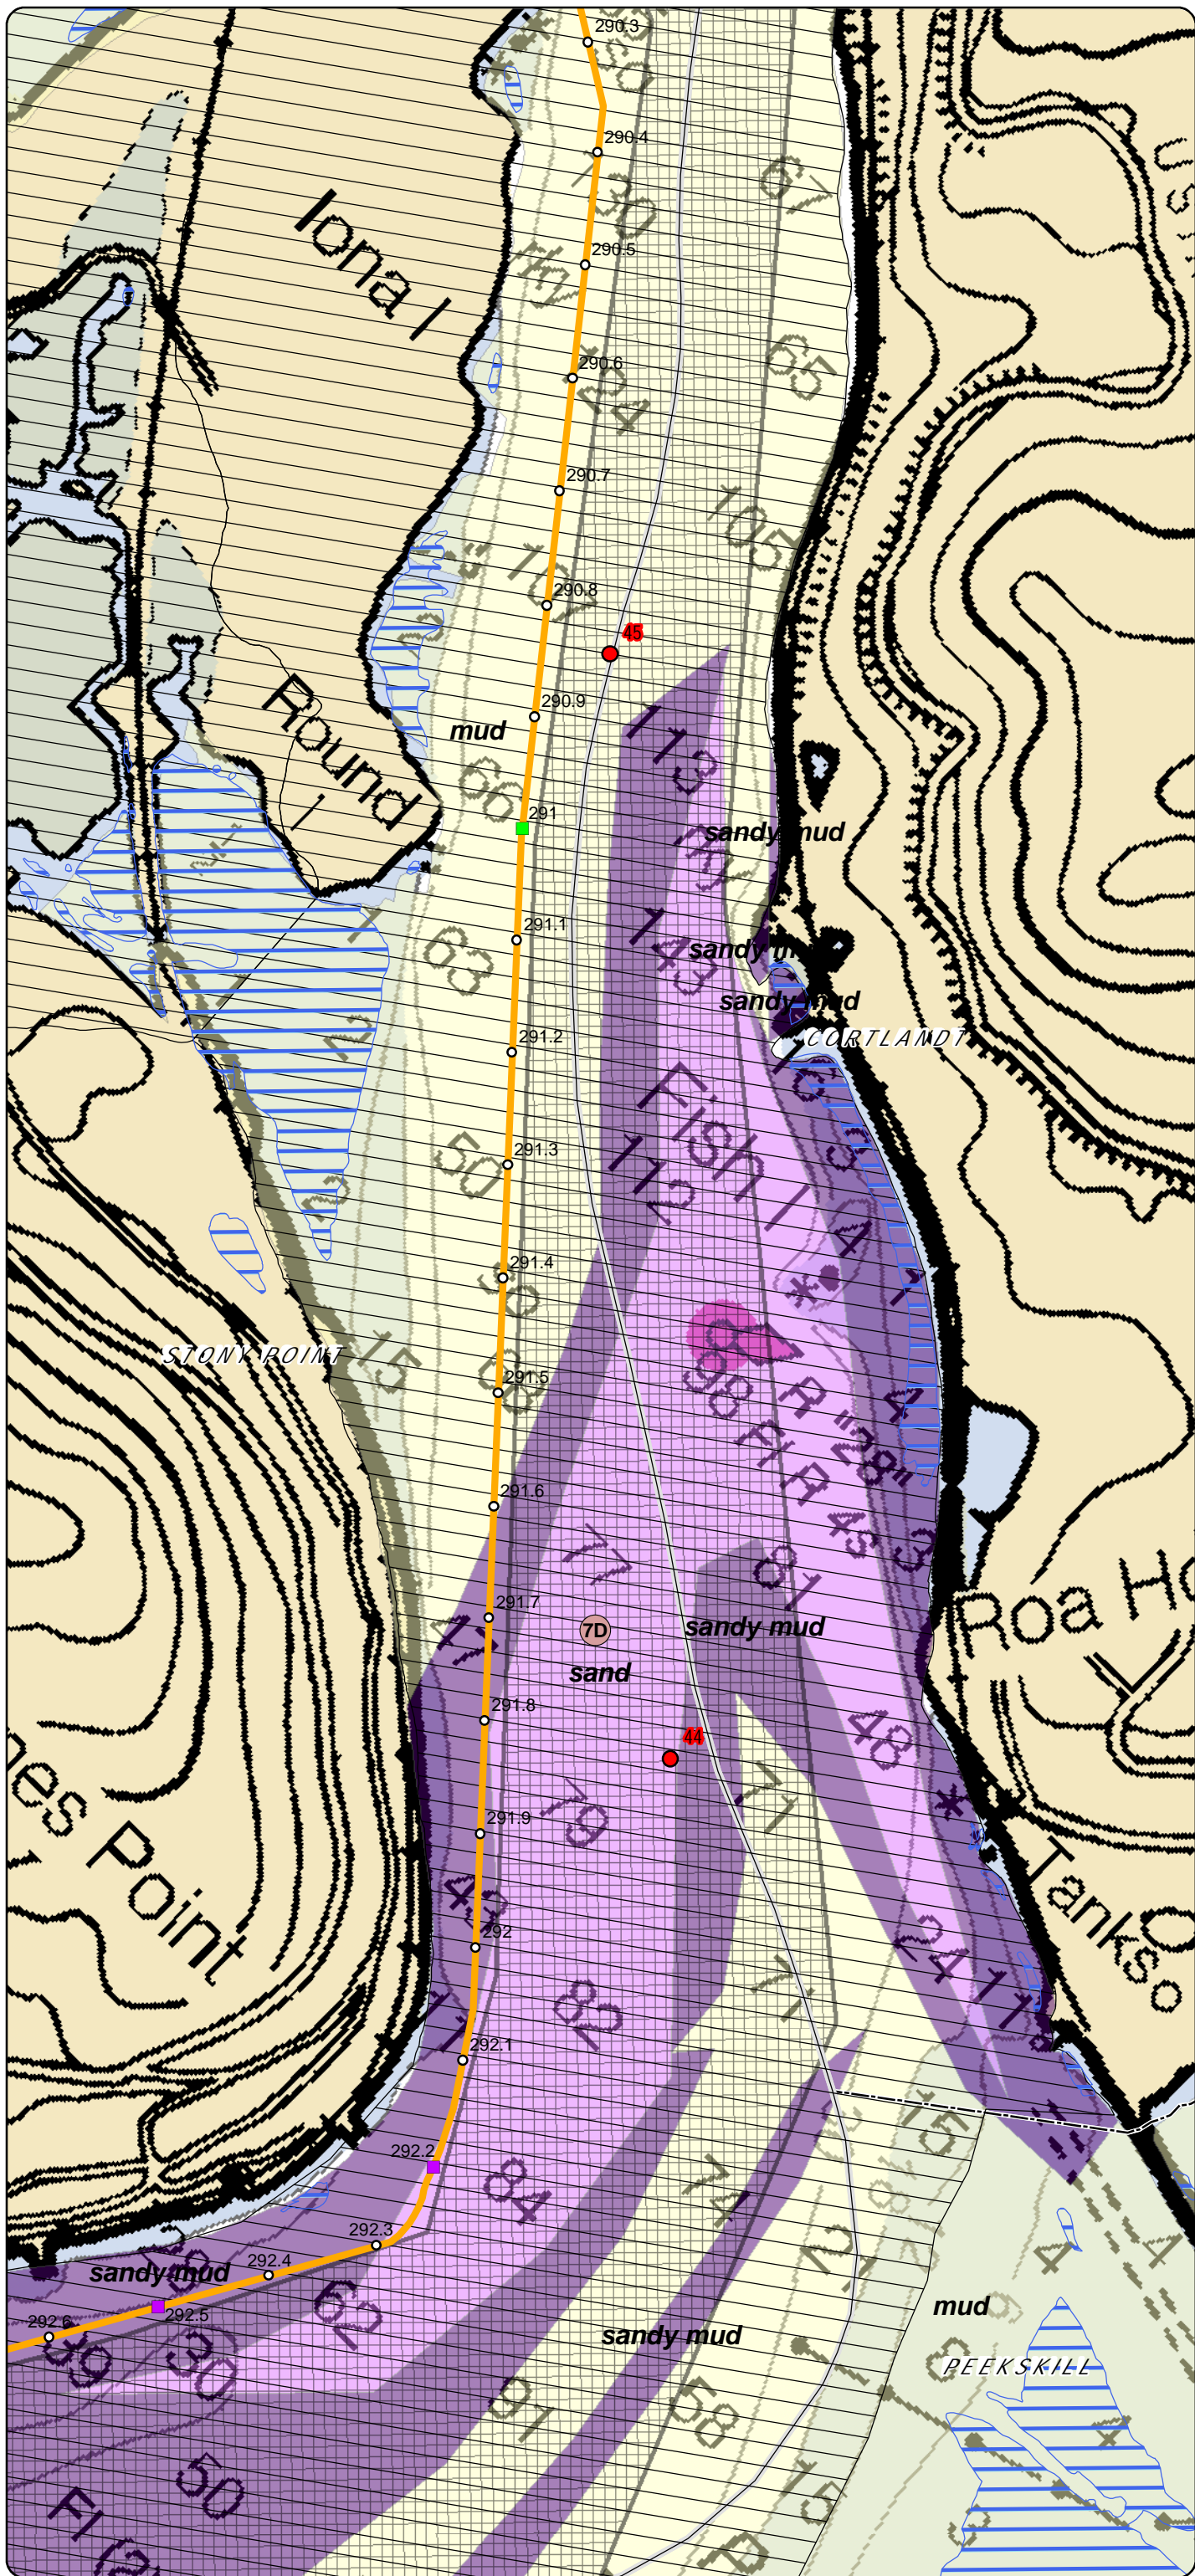


**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- 1 CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

  
 0 750  
 Feet

  
**Transmission Developers Inc.**  
 Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*  



---

**Hudson River Project Route**  
 Sheet 29 of 43  


---

 Created: 6/18/2014  
 by:   & 



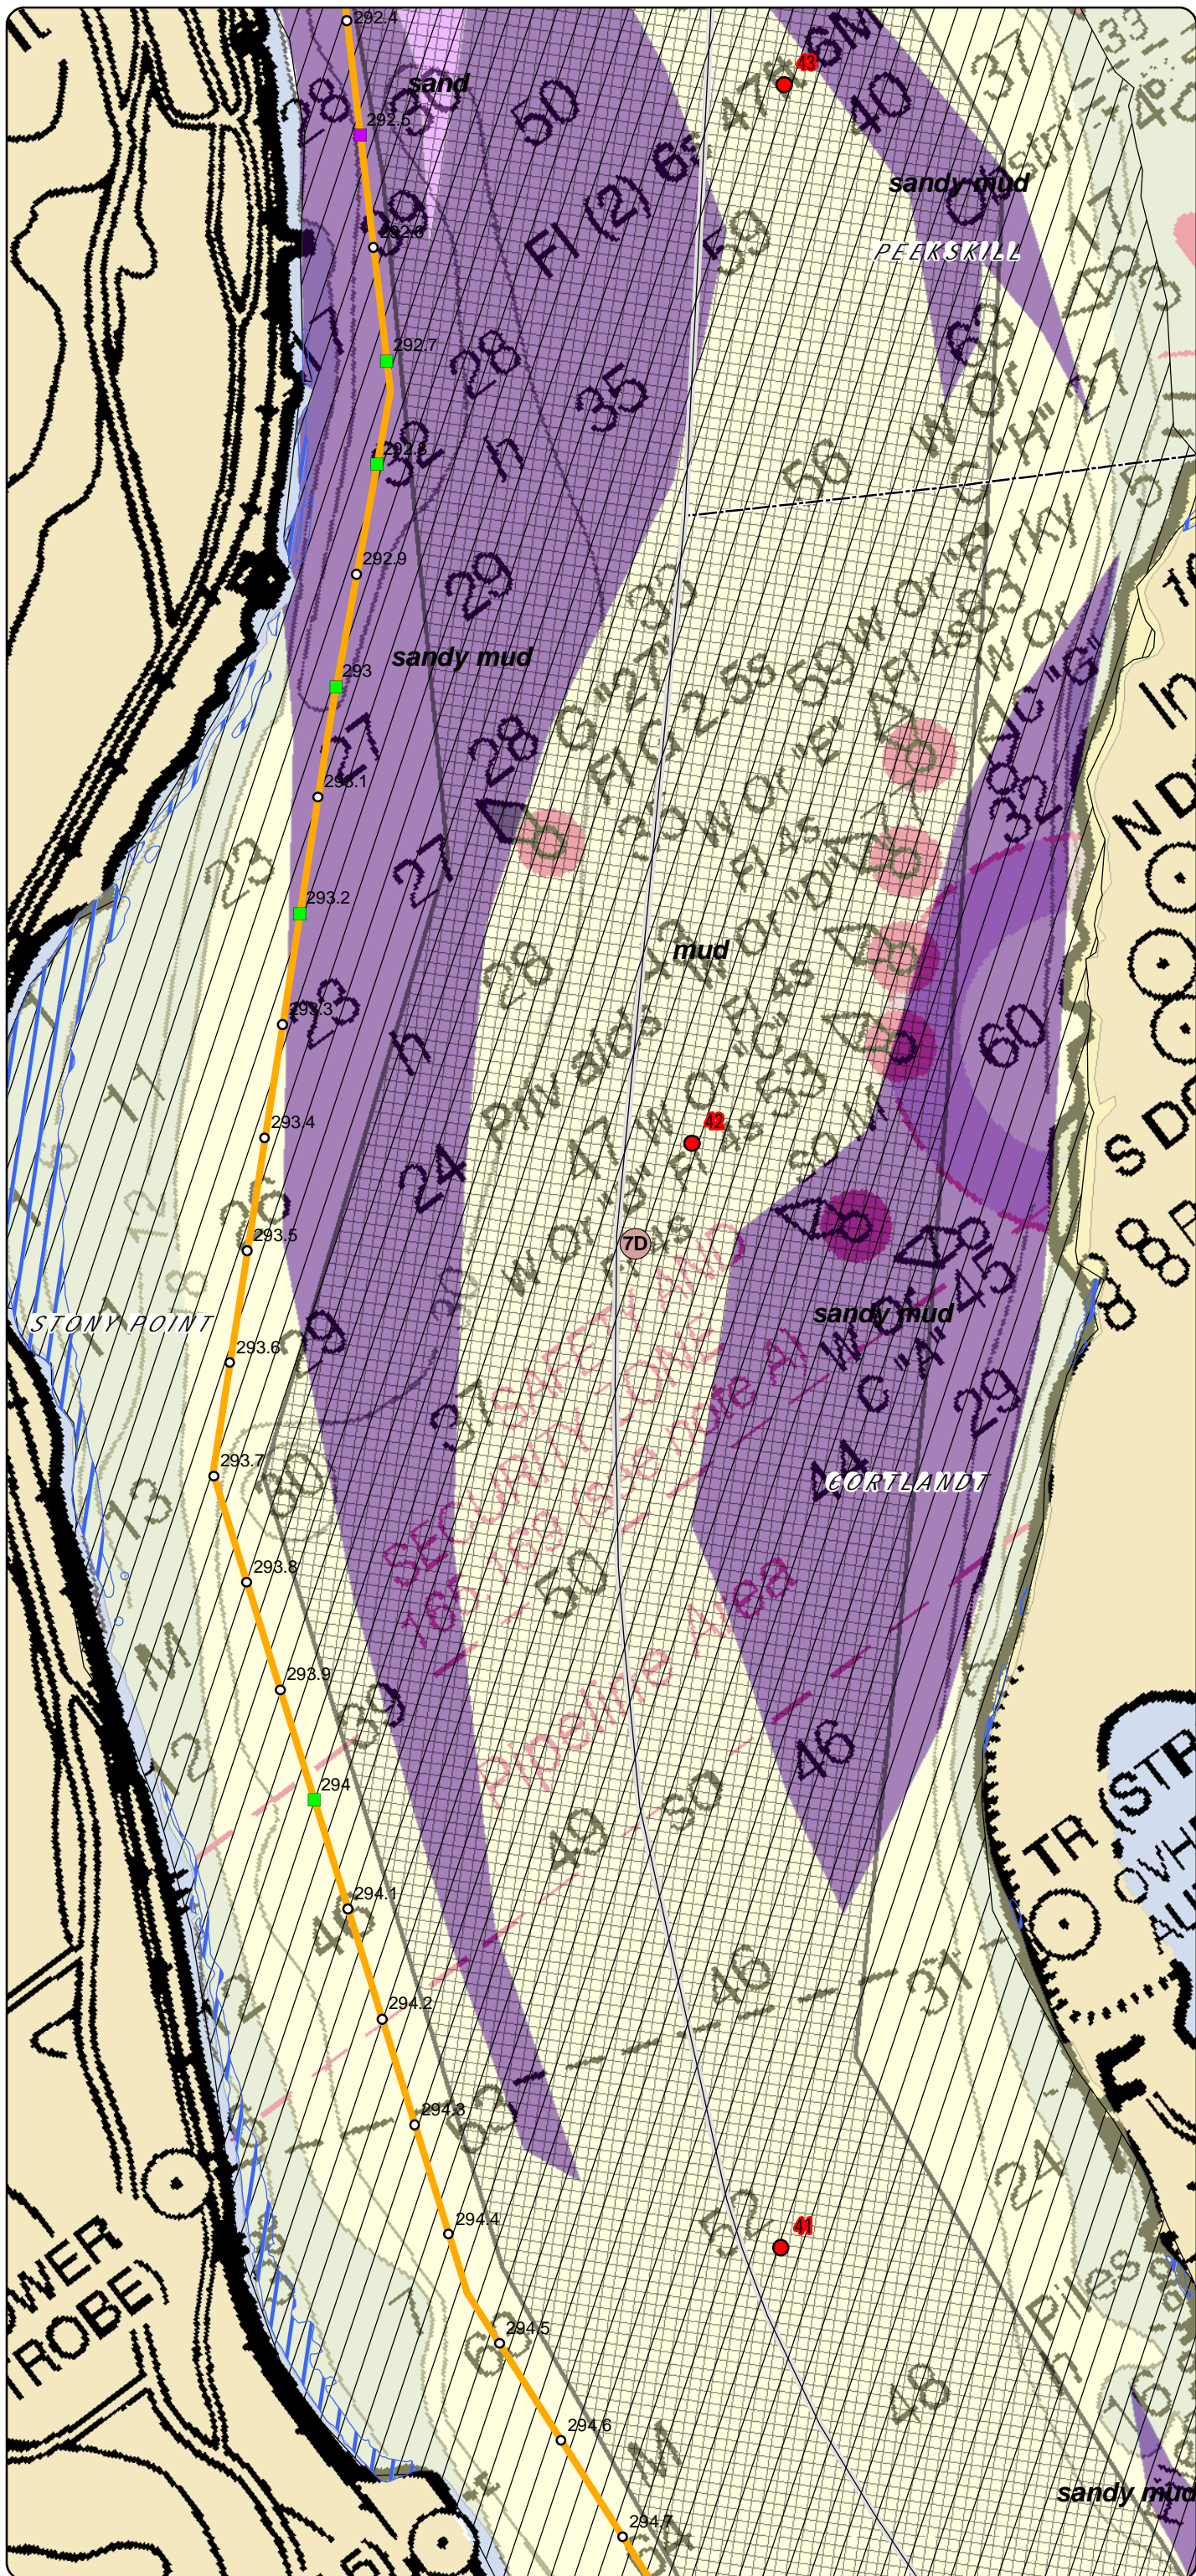

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- 1 CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**



- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

0 750  
 Feet

Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*  
**Hudson River Project Route**  
 Sheet 30 of 43  
 Created: 6/18/2014  
 by: &



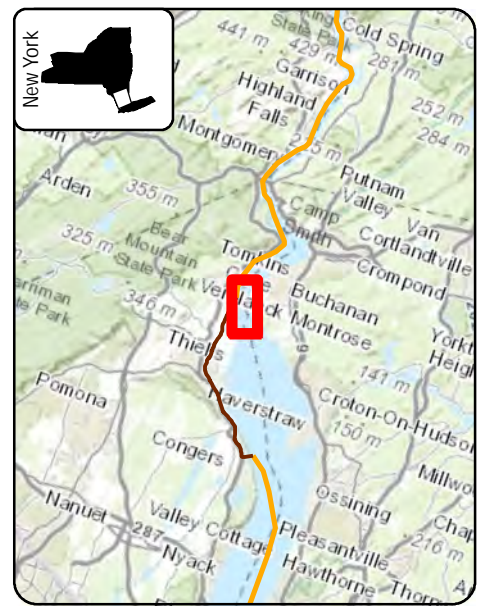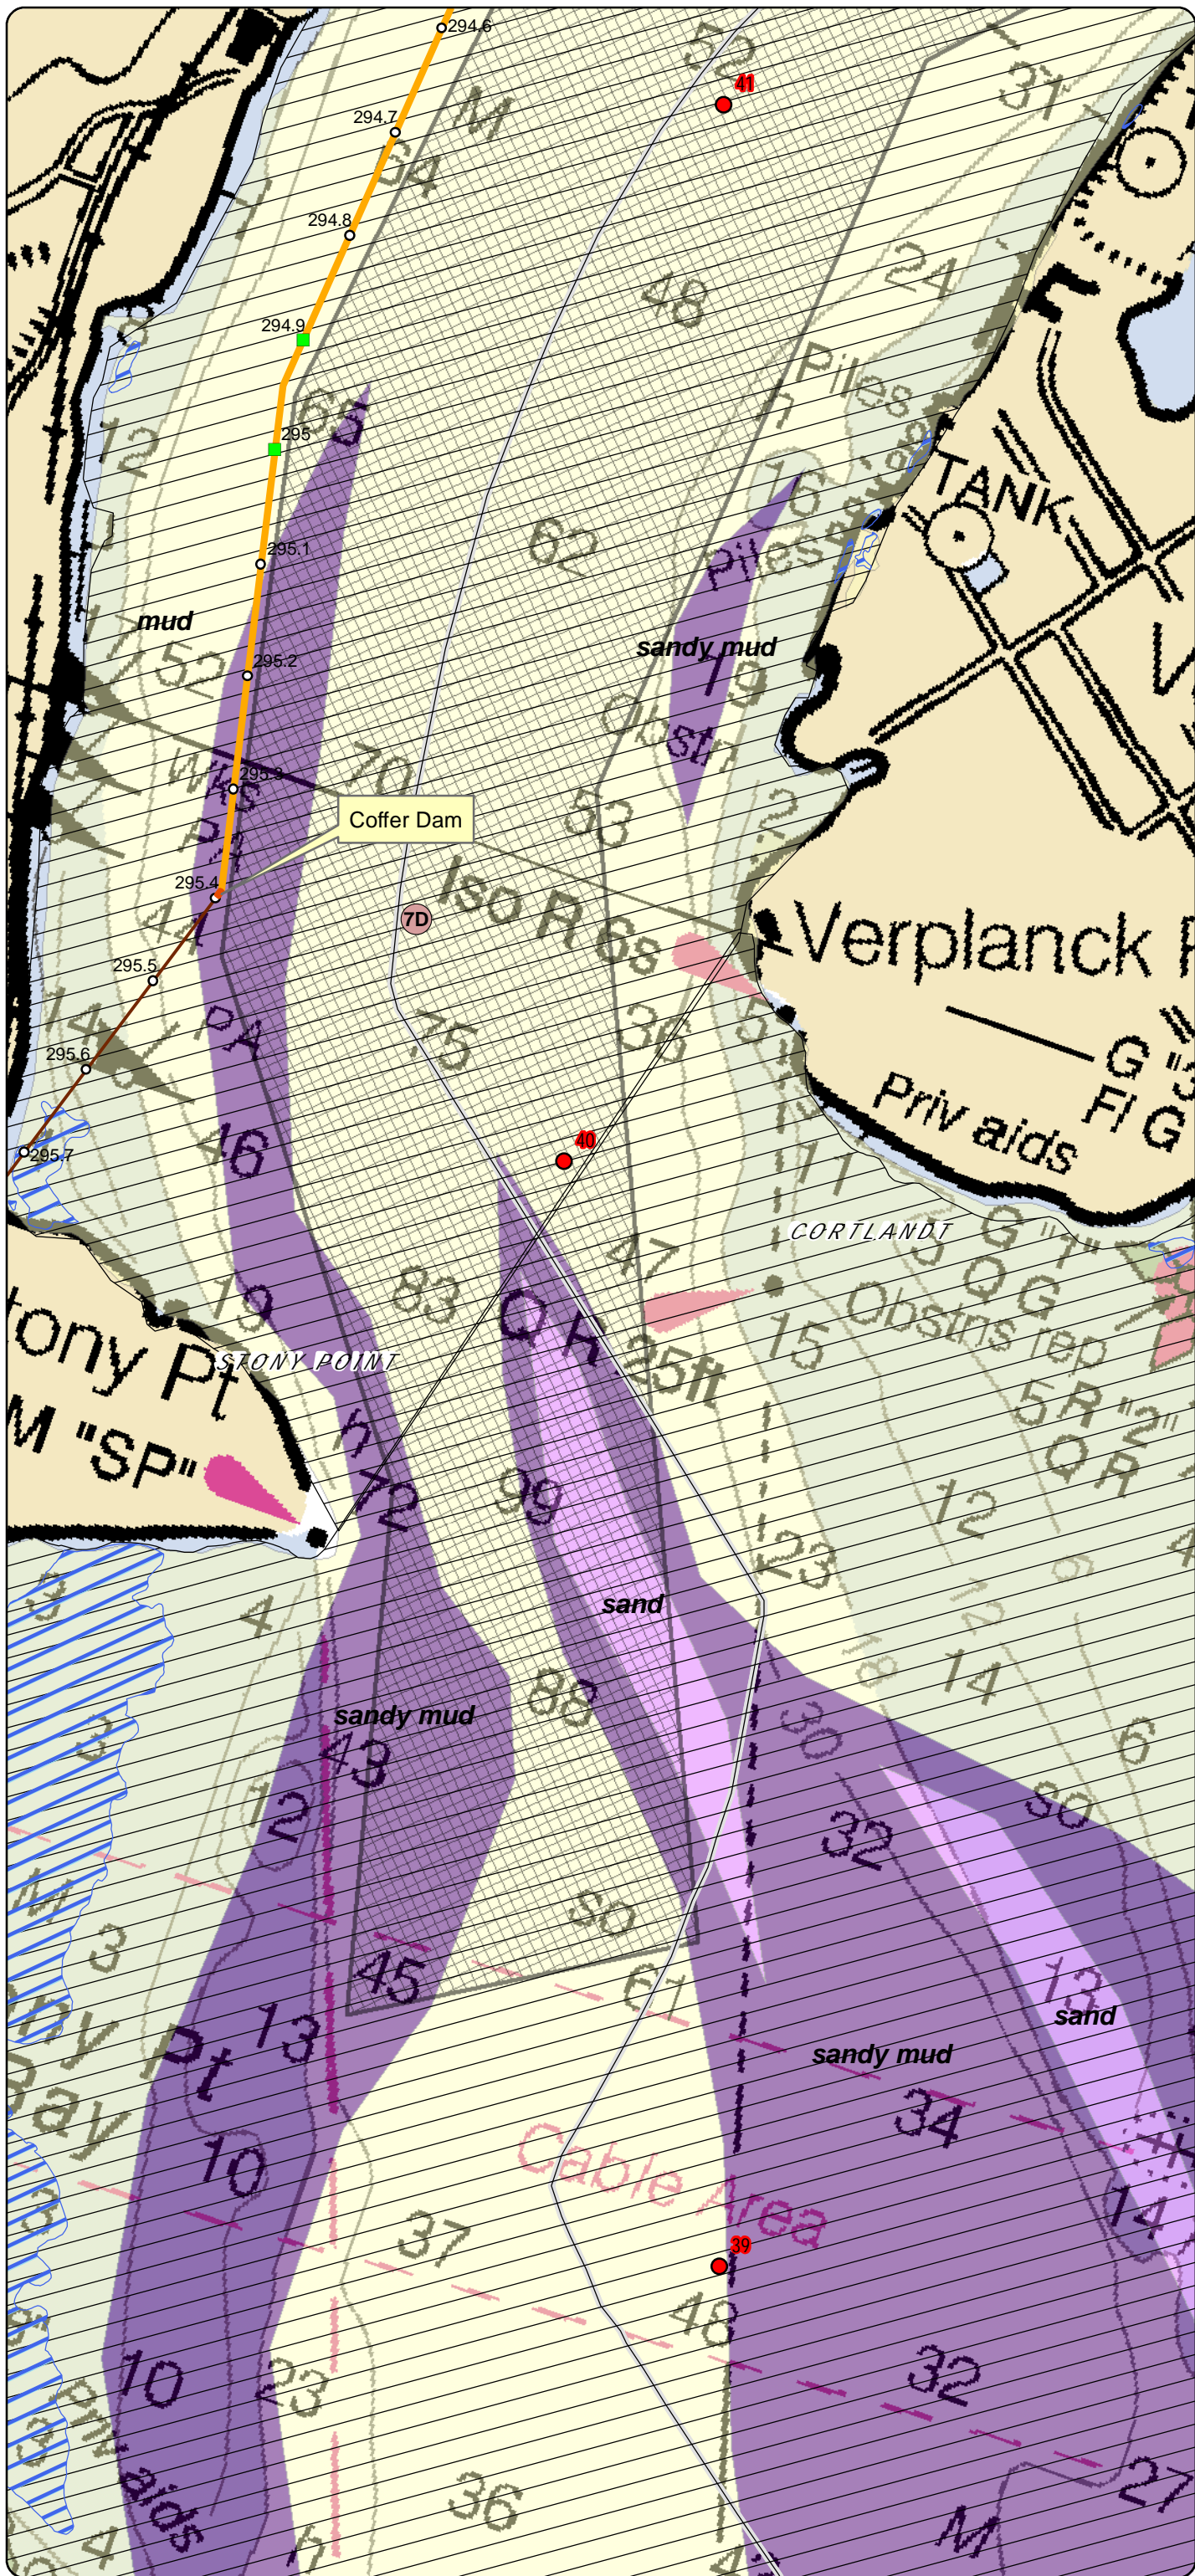

### LEGEND

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Coffer Dam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC)  Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

### Sediment Type - NYSDEC Hudson River Estuary Program

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

0 750  
Feet

**Transmission**  
Developers Inc.


Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*

**Hudson River**  
**Project Route**  
Sheet 31 of 43

Created: 6/18/2014

by: **HDR** **PTA** & **CTRC**



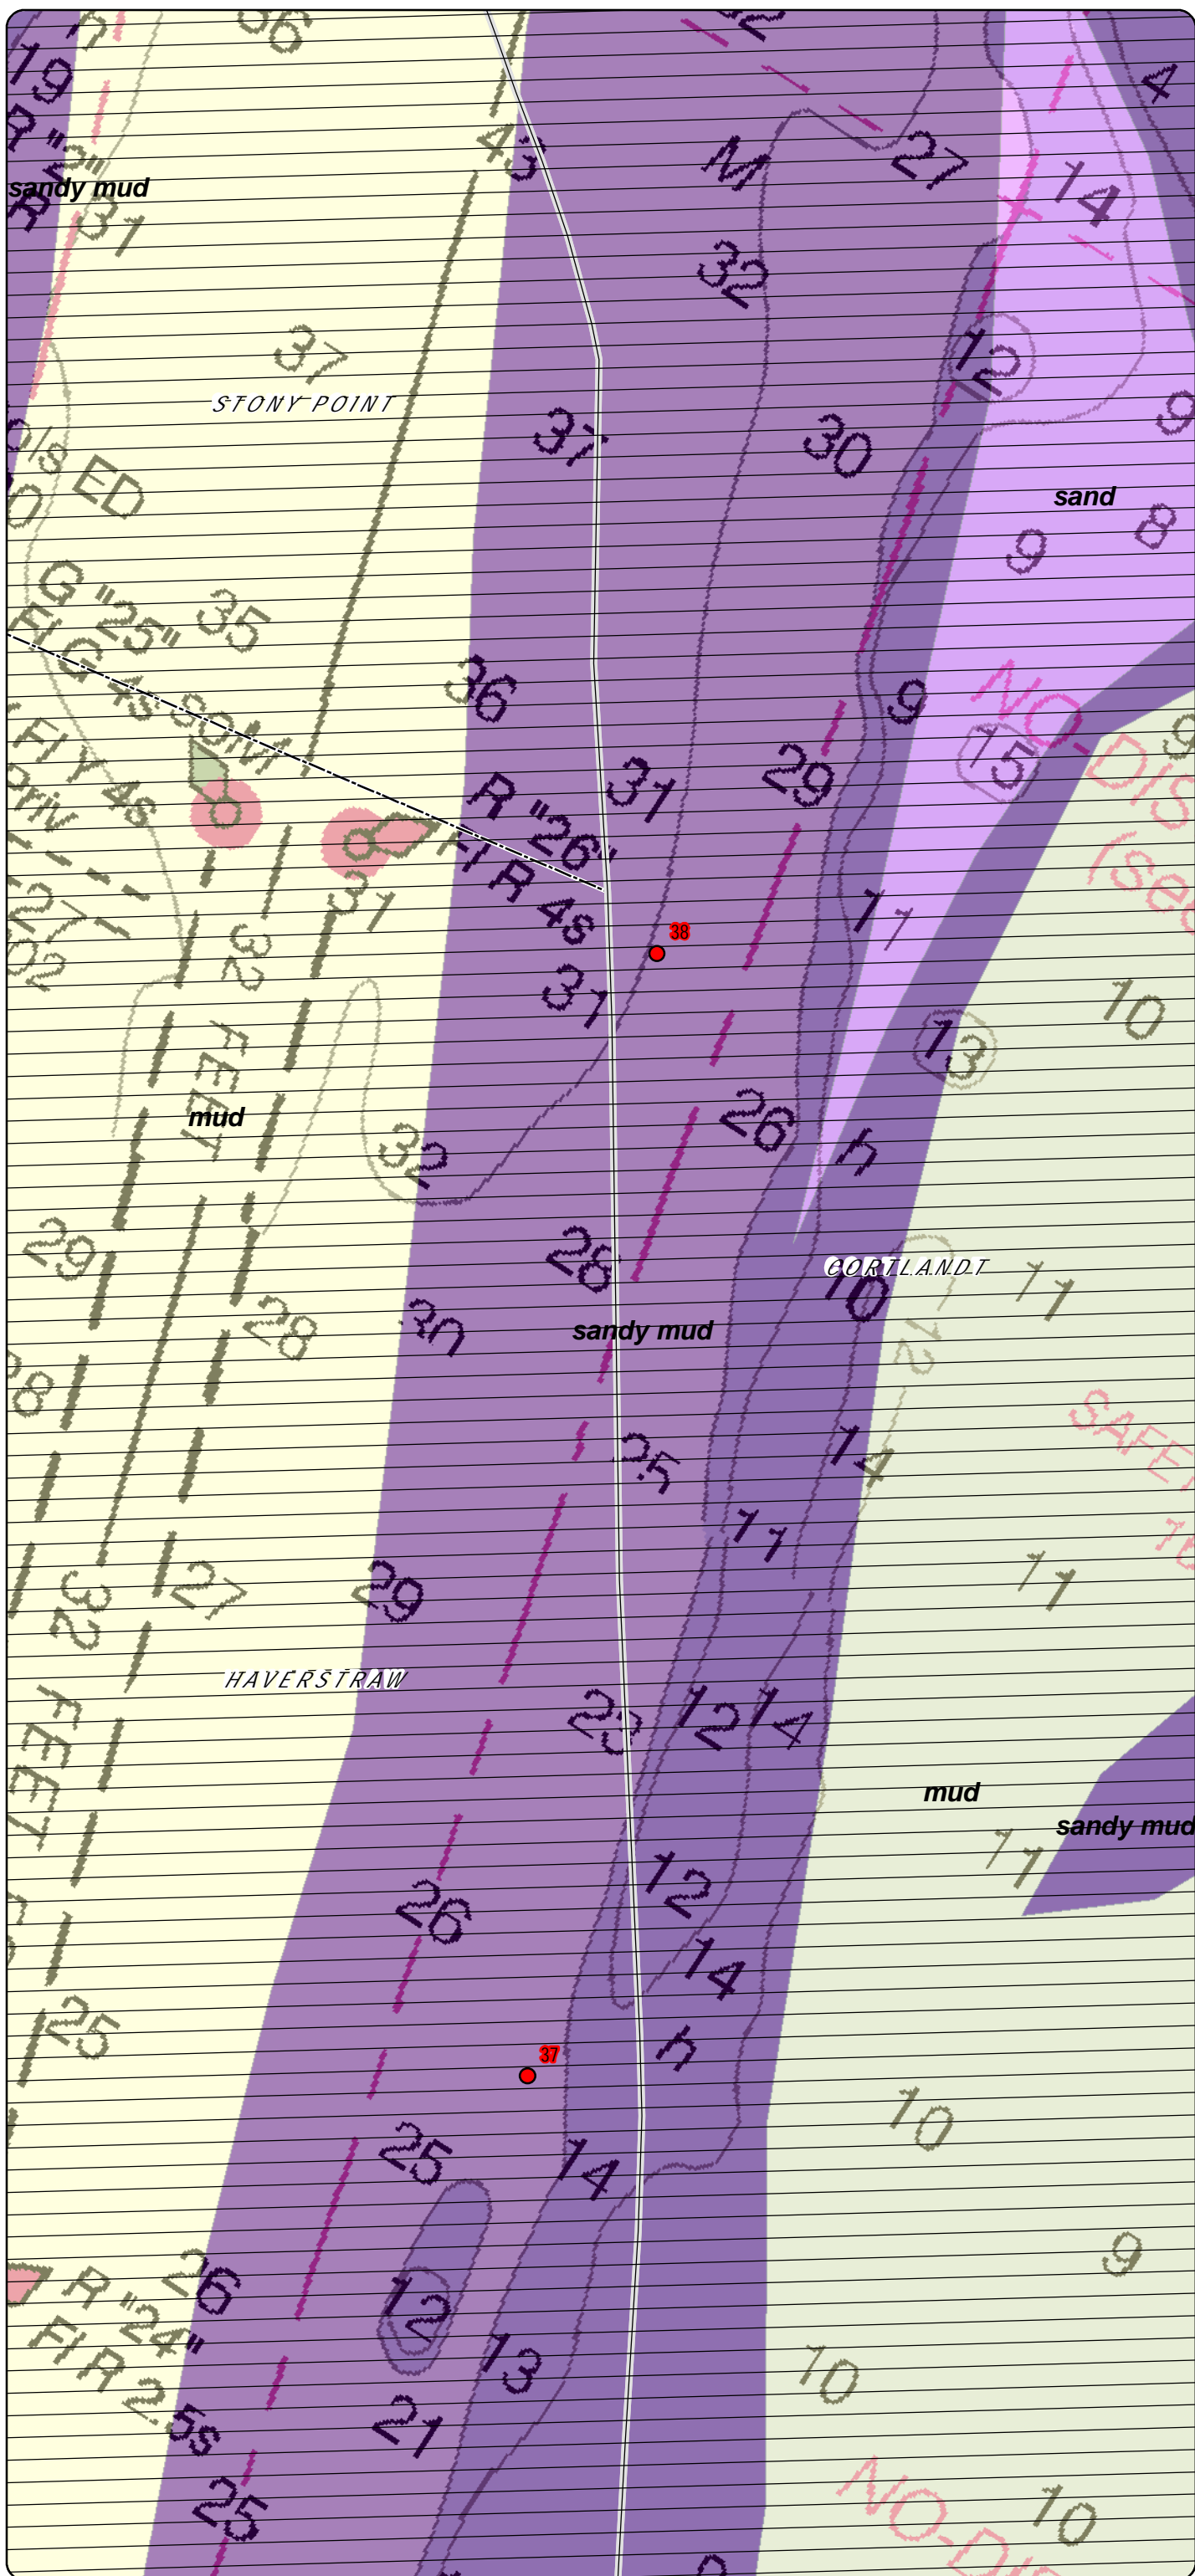

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC)  Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

0 750  
Feet

  
 Transmission Developers Inc.  
 Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*  




---

**Hudson River Project Route**  
 Sheet 32 of 43  


---

 Created: 6/18/2014  
 by:   & 



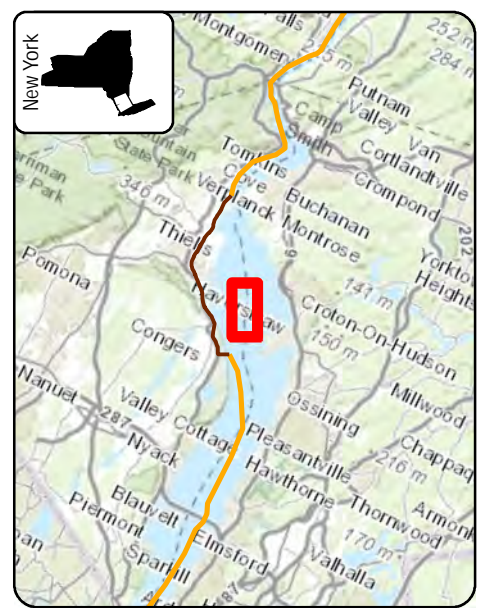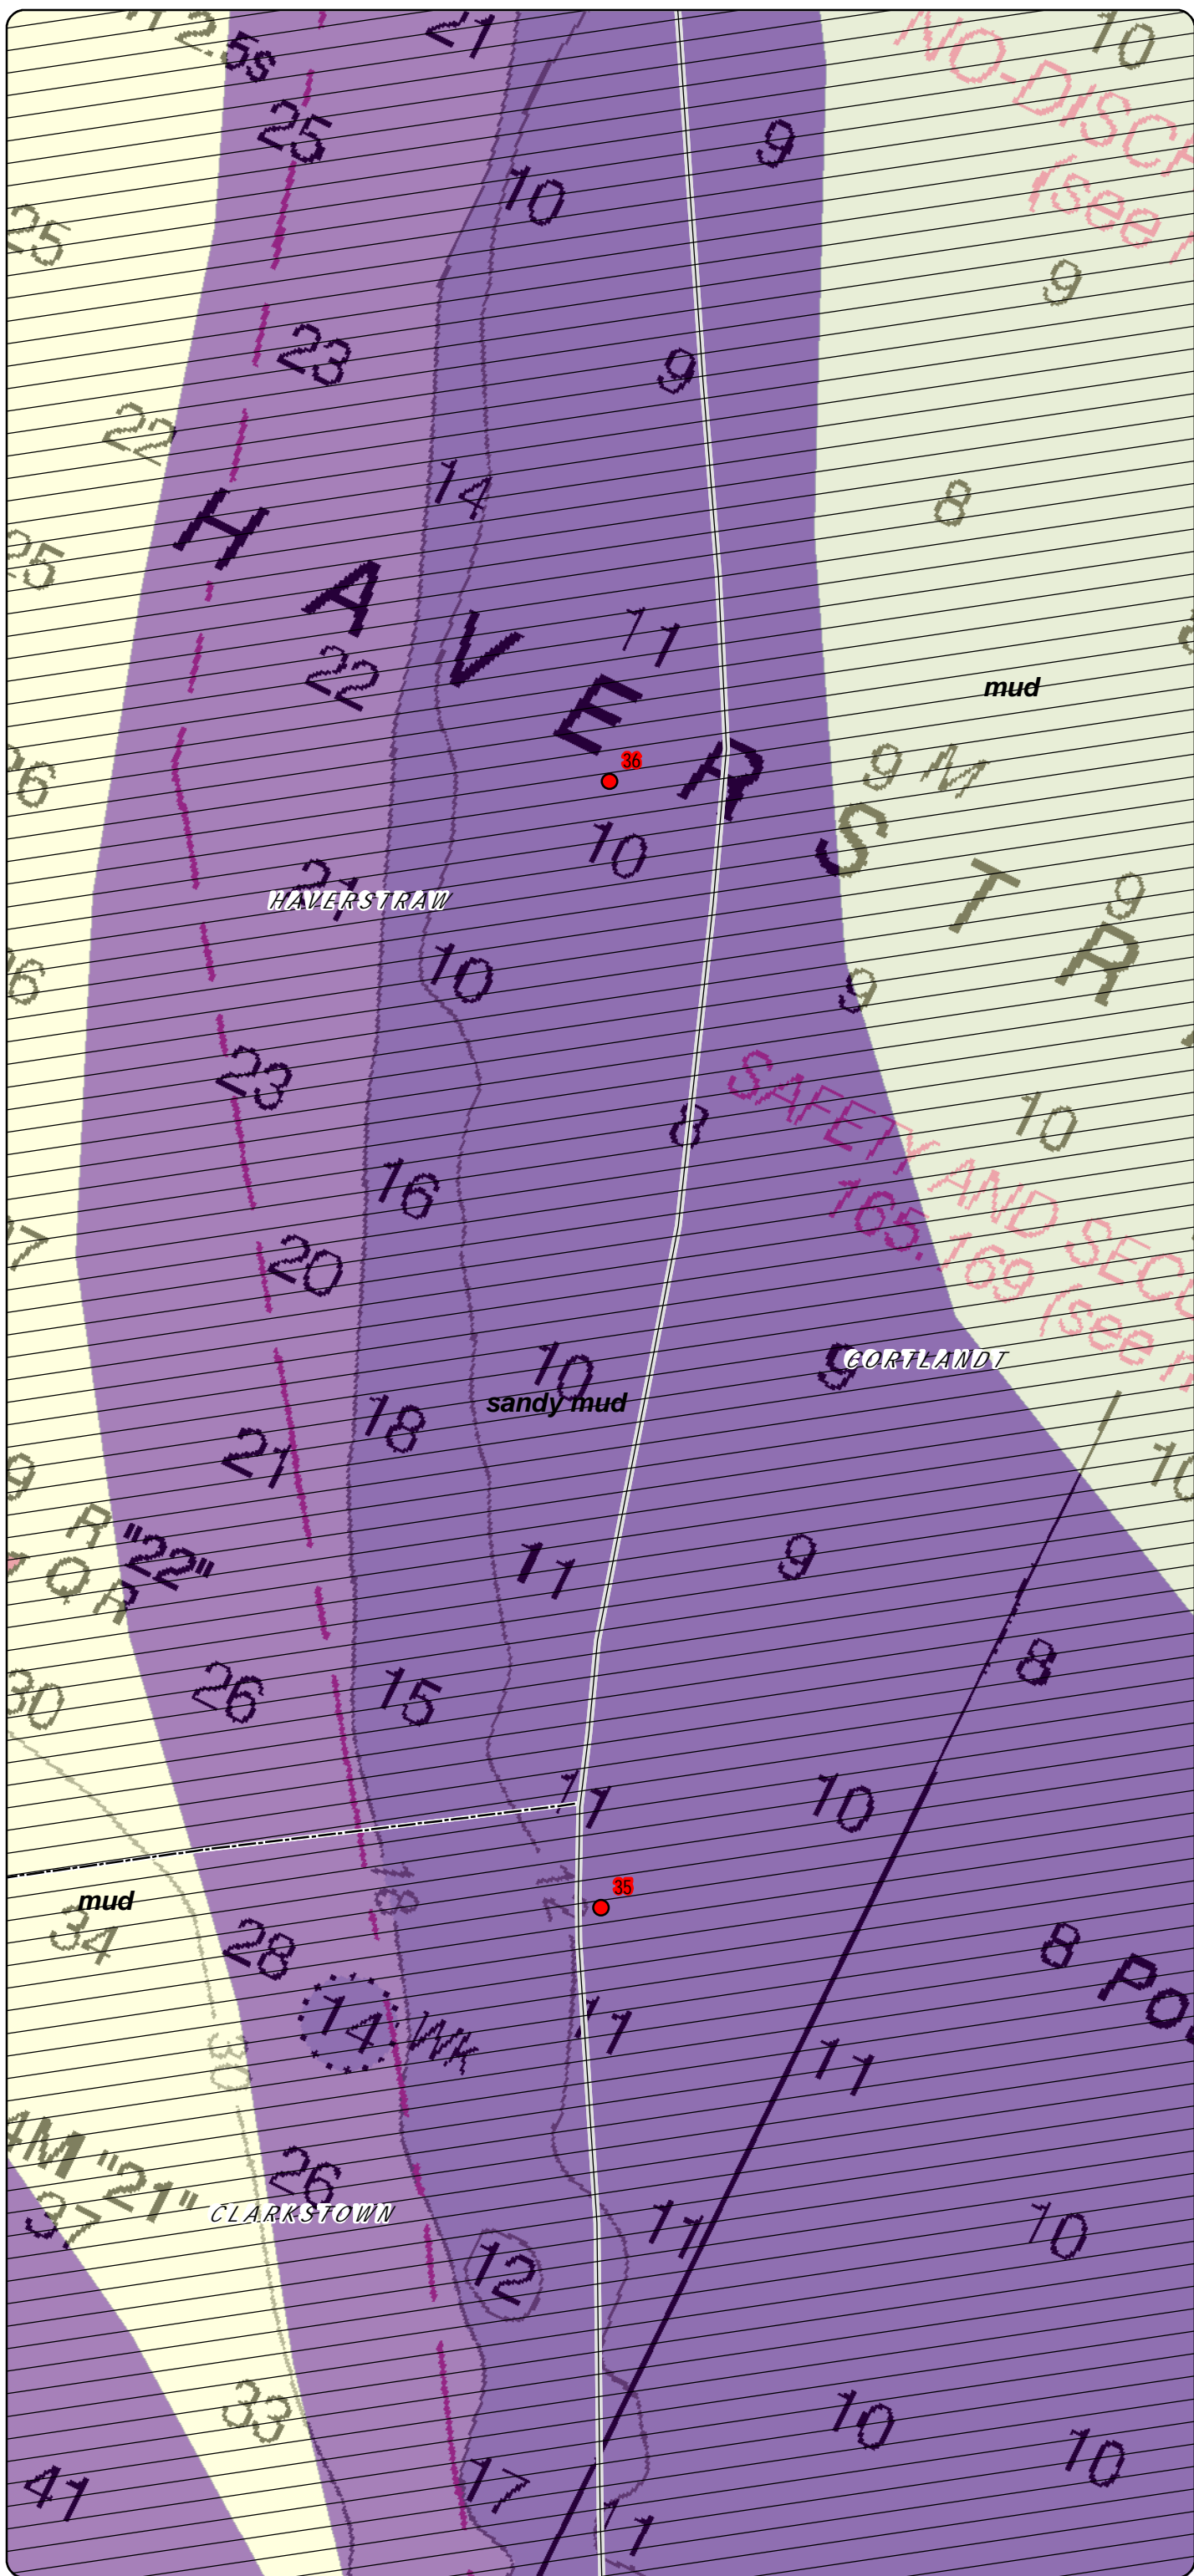

### LEGEND

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

#### Sediment Type - NYSDEC Hudson River Estuary Program

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

Transmission Developers Inc.

Champlain Hudson Power Express Project  
Champlain Hudson Power Express Inc.

---

## Hudson River Project Route



Sheet 33 of 43

---

Created: 6/18/2014

by: &



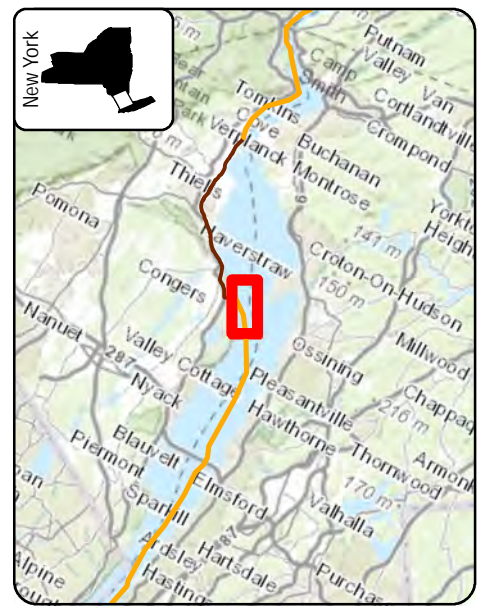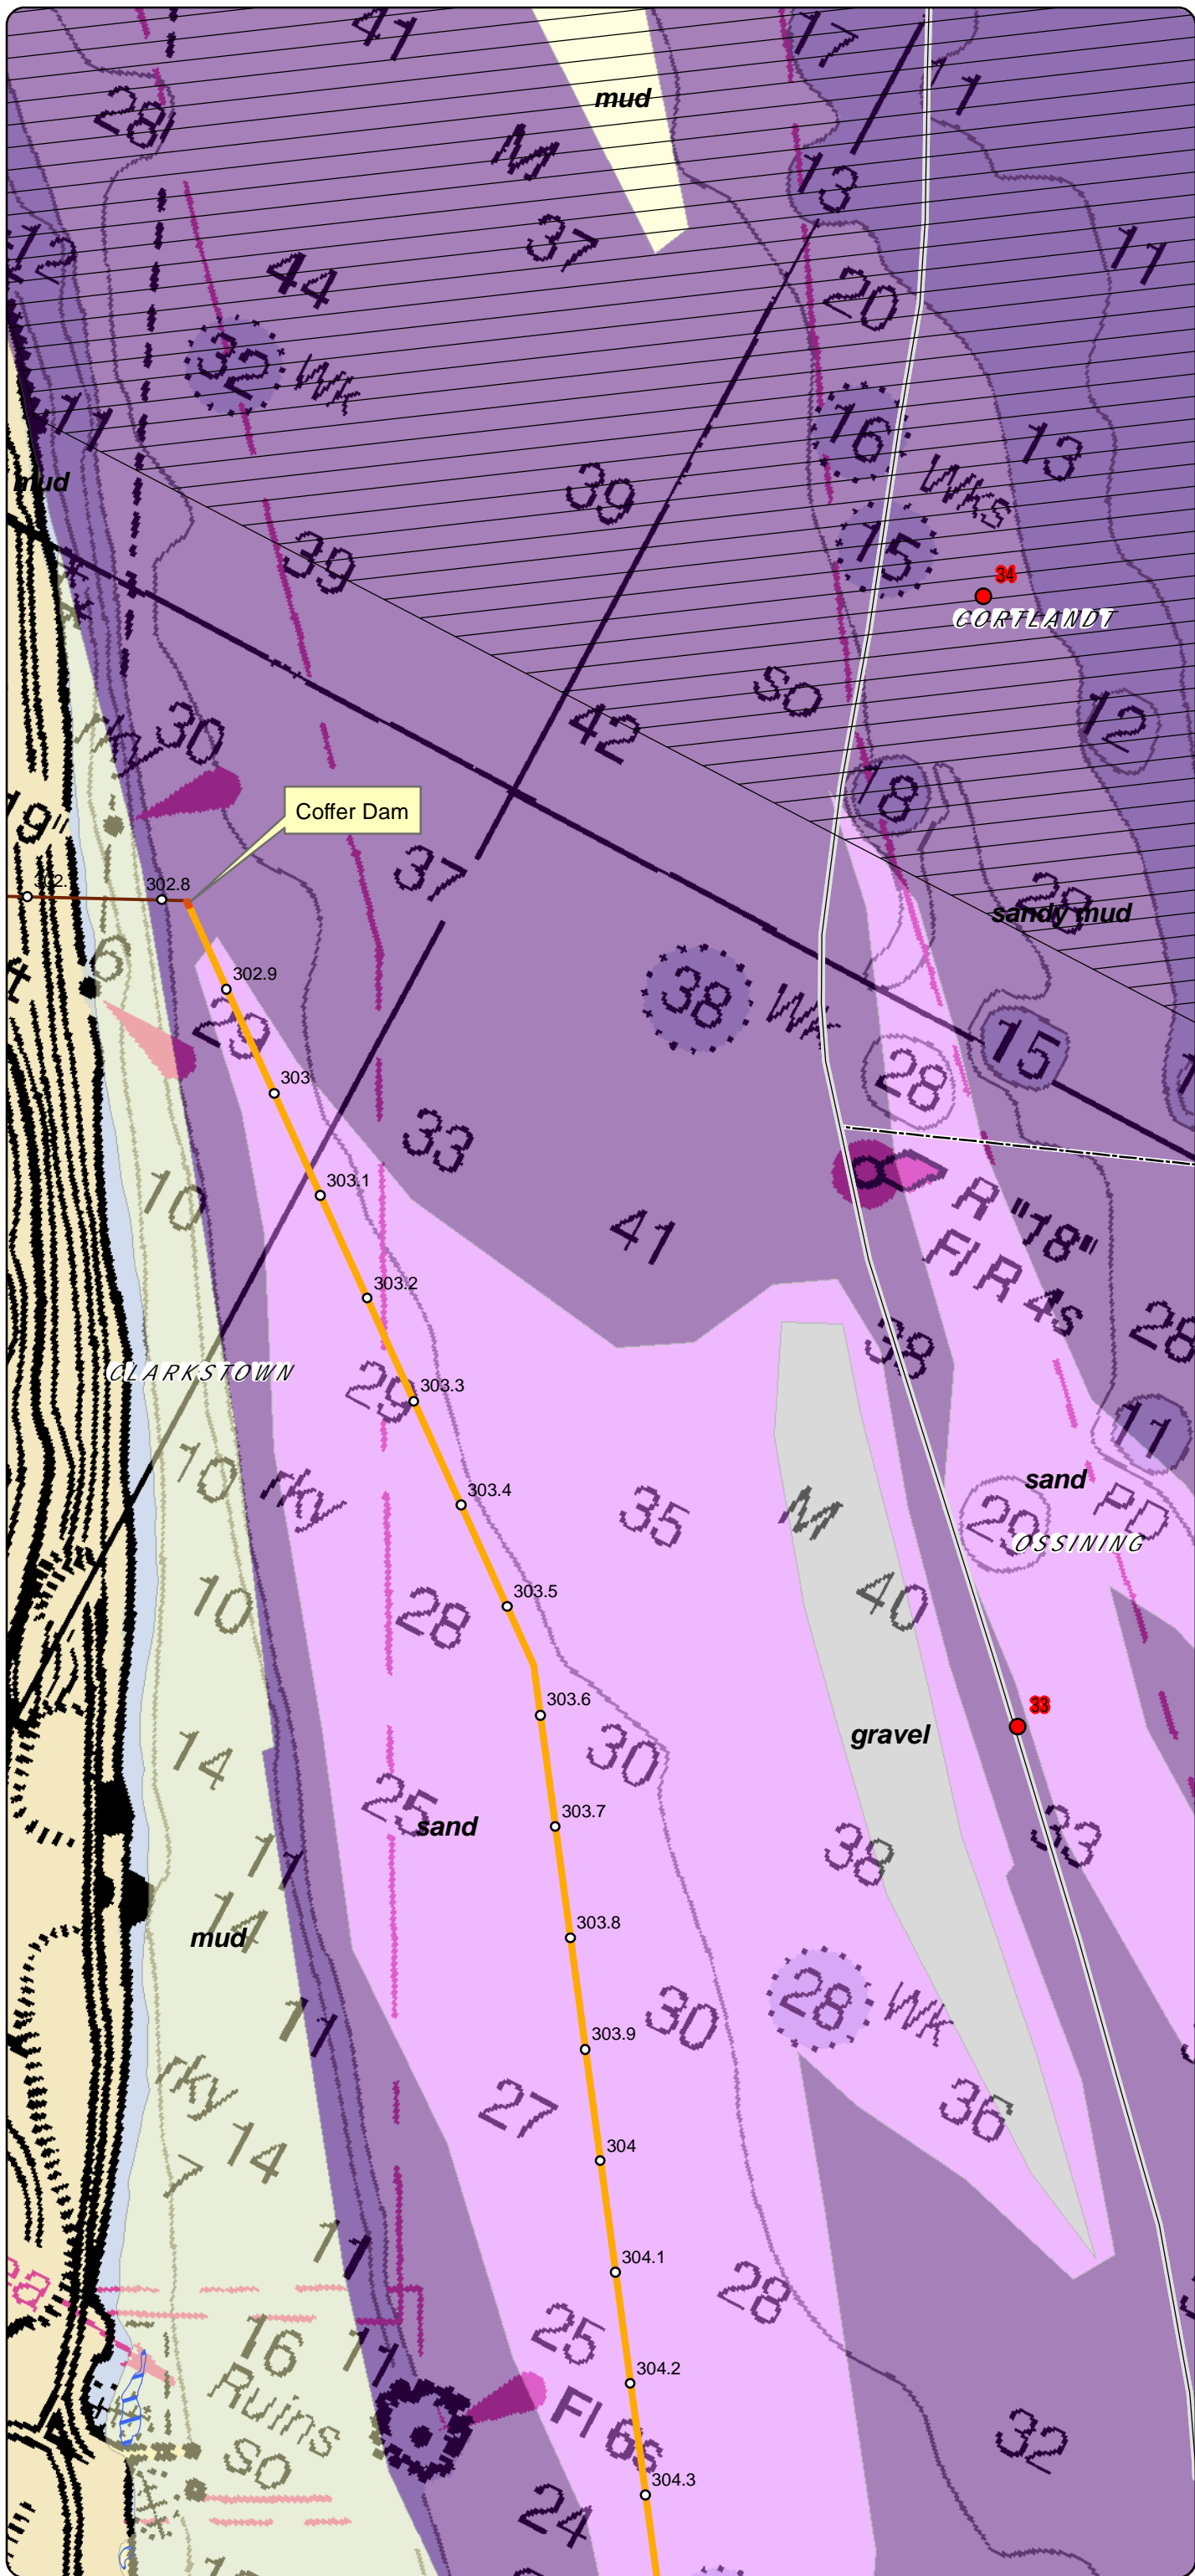

### LEGEND

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Coffer Dam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC)  Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

### Sediment Type - NYSDEC Hudson River Estuary Program

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

Transmission  
Developers Inc.

Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*

---

## Hudson River Project Route



Sheet 34 of 43

---

Created: 6/18/2014

by: &



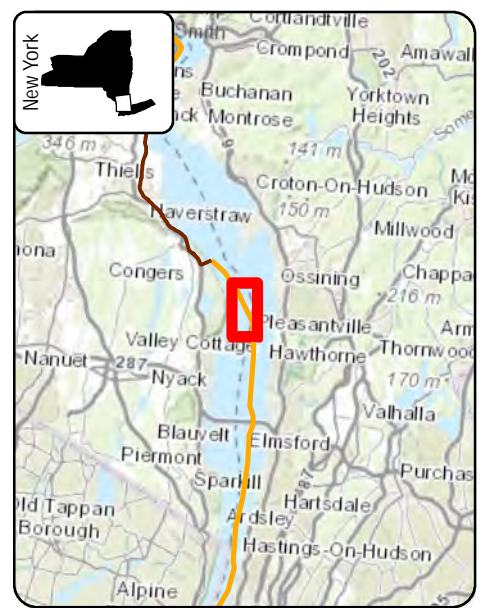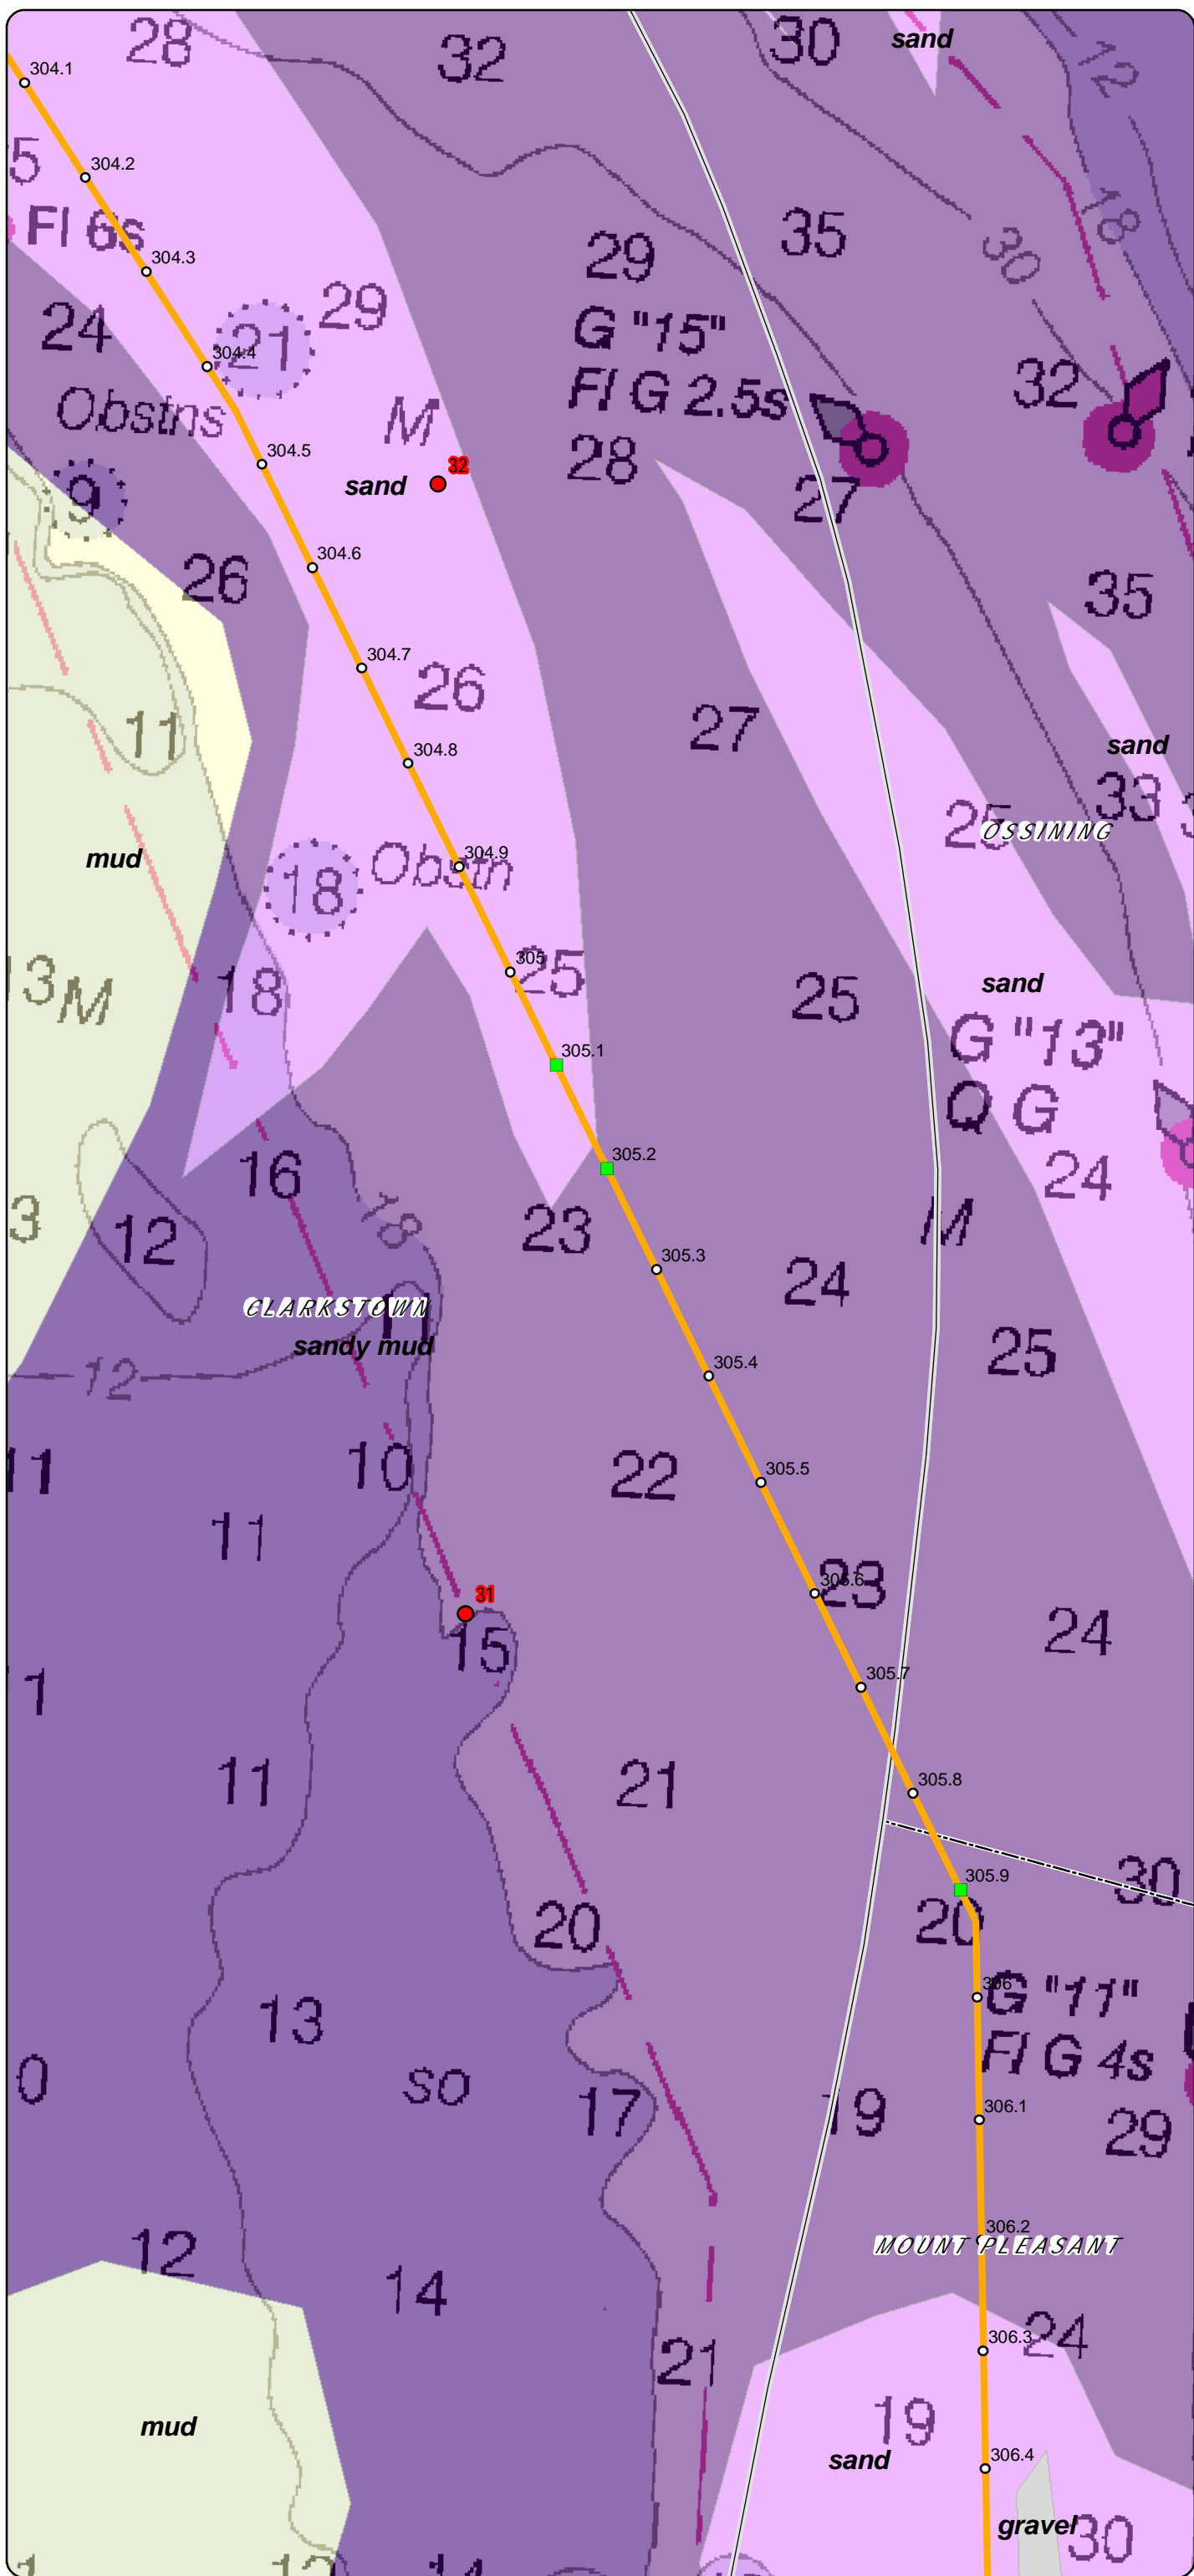

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- 1 CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

0 750  
Feet

**Transmission Developers Inc.**

Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*

---



**Hudson River Project Route**

Sheet 35 of 43

---

Created: 6/18/2014

by: &

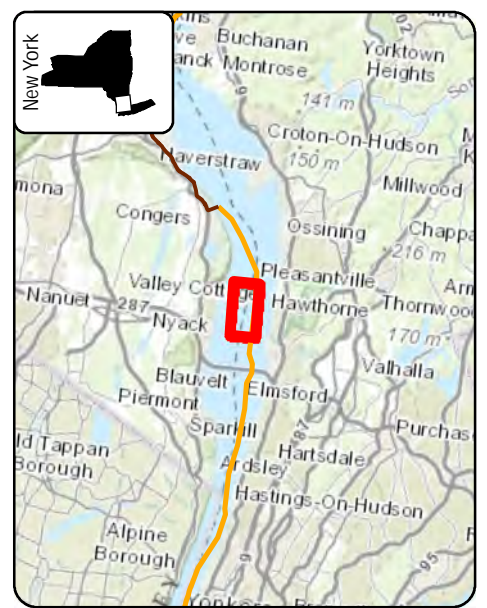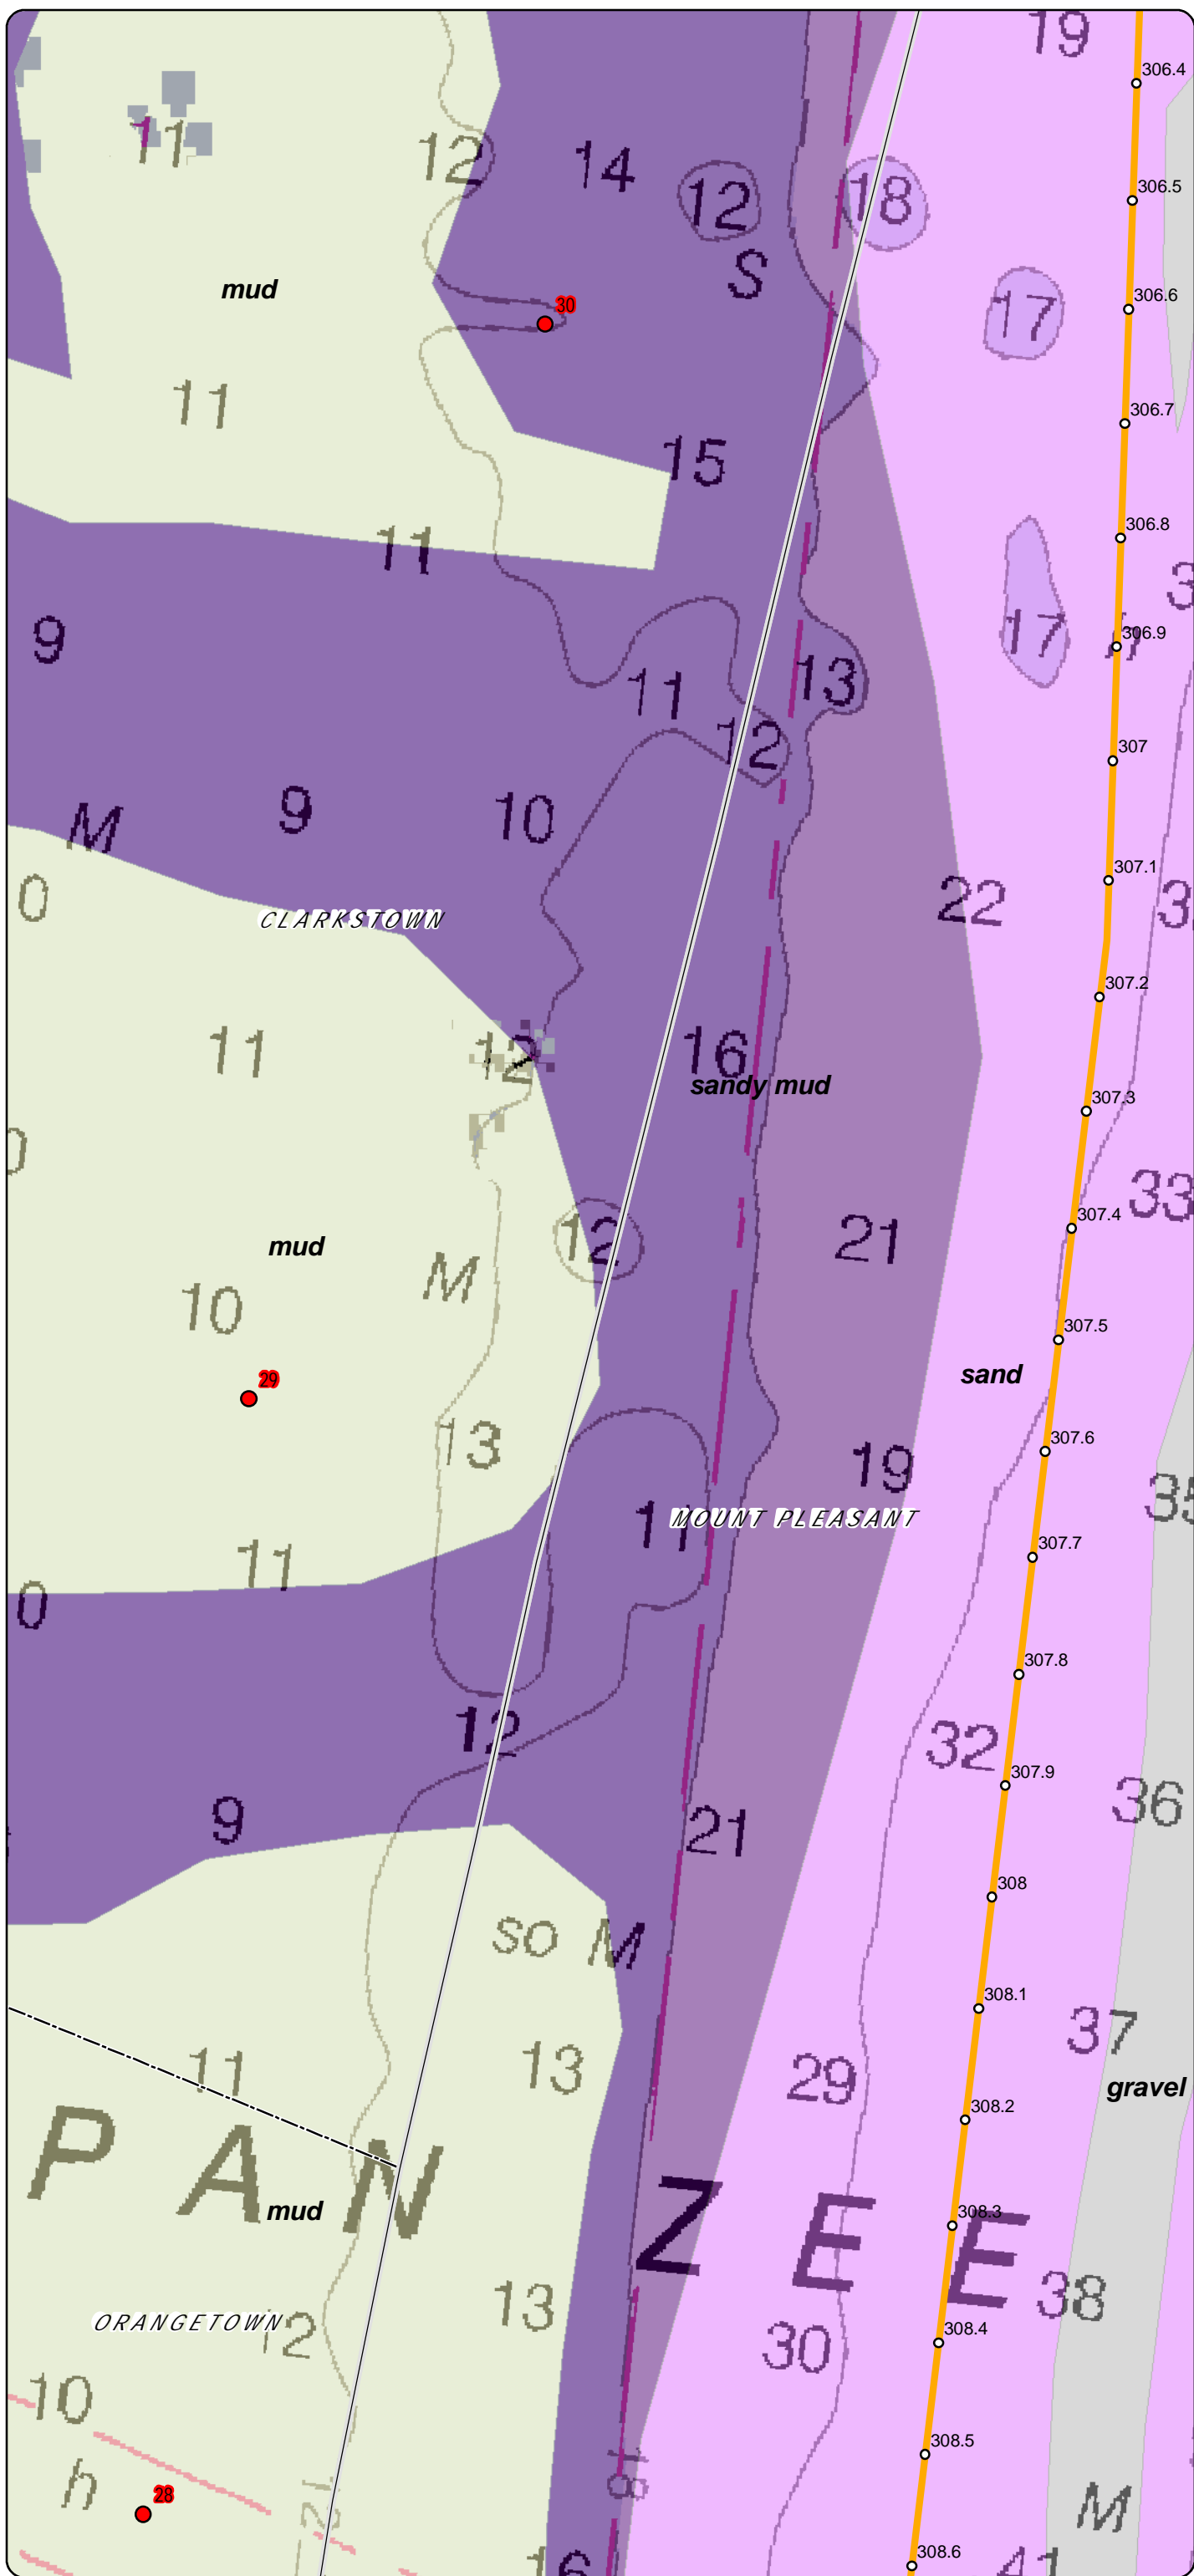

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary



Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*

---

**Hudson River Project Route**  
 Sheet 36 of 43

---

Created: 6/18/2014  
 by: &

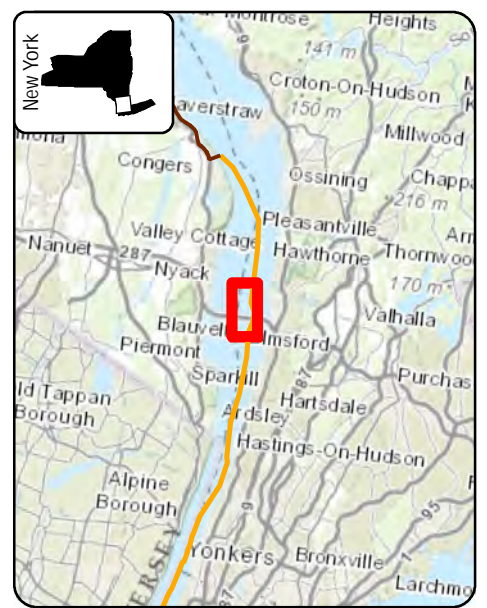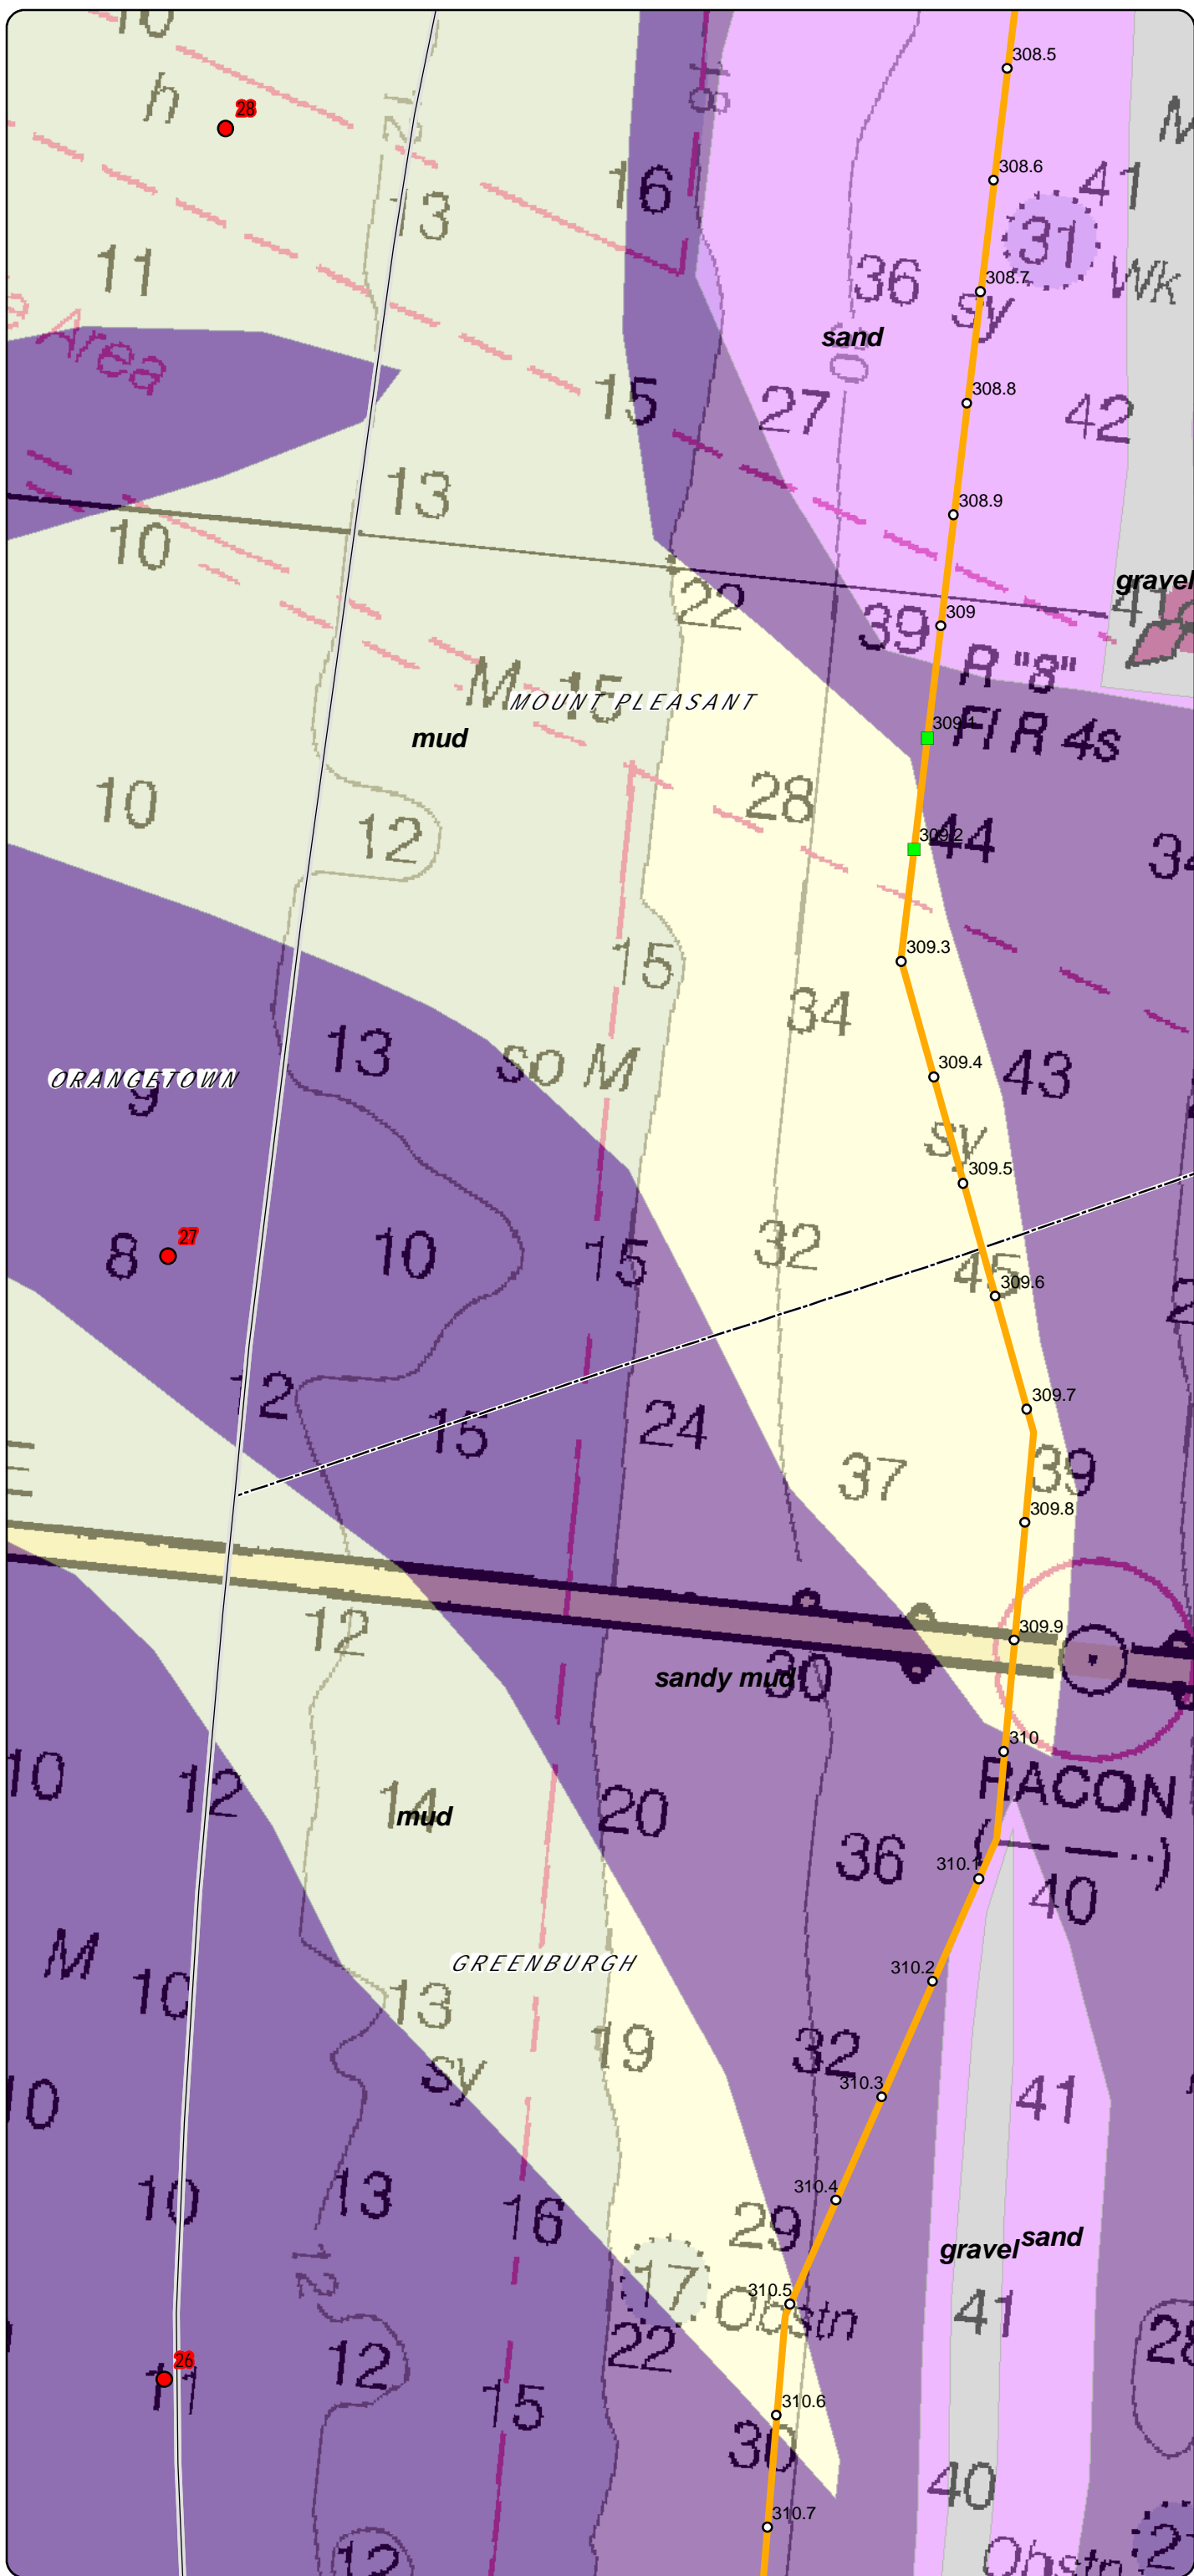


**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC)  Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

  
 0 750  
 Feet

  
**Transmission Developers Inc.**  
 Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*  



---

**Hudson River Project Route**  
 Sheet 37 of 43  


---

 Created: 6/18/2014  
 by:   & 



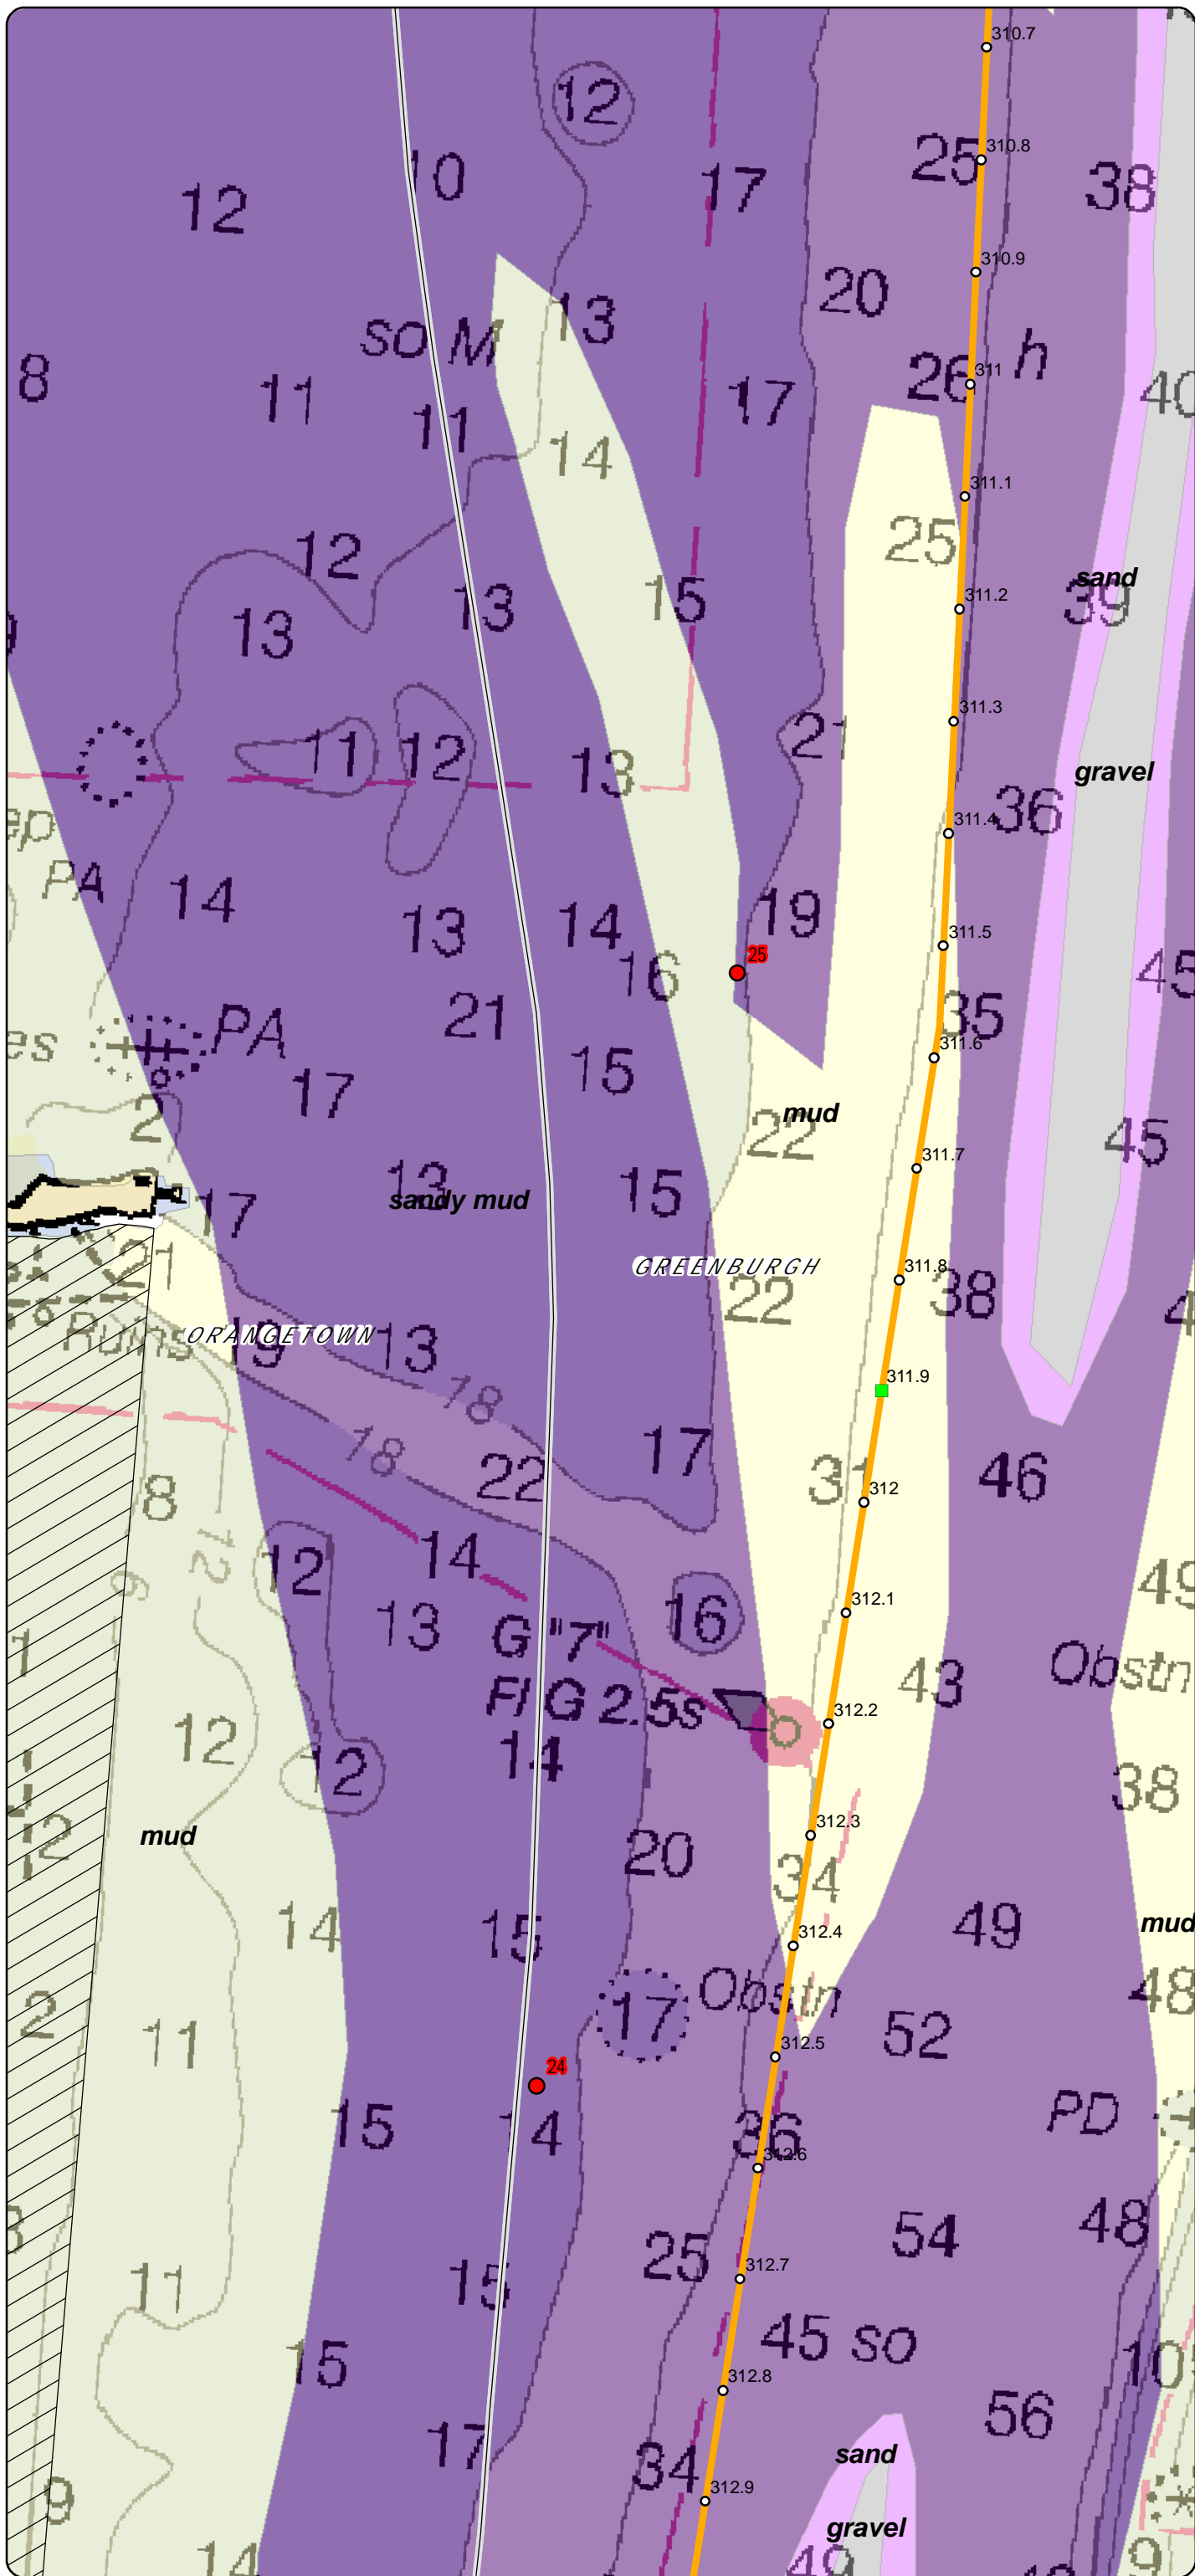


**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- 1 CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary



0 750  
Feet



**Transmission Developers Inc.**

Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*

---



**Hudson River Project Route**

Sheet 38 of 43

---

Created: 6/18/2014

by: **HDR** **UTA** & **CTRC**

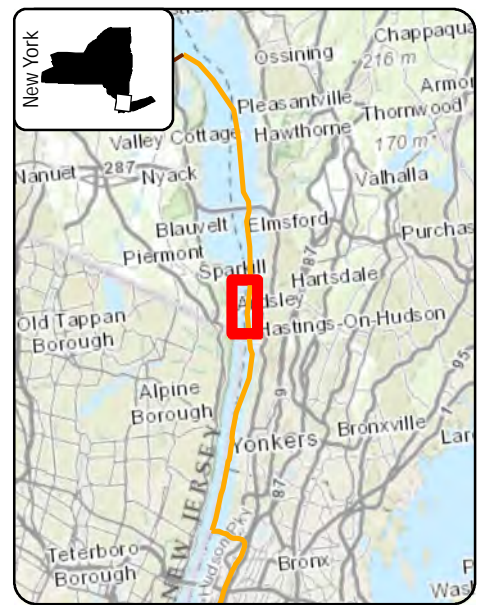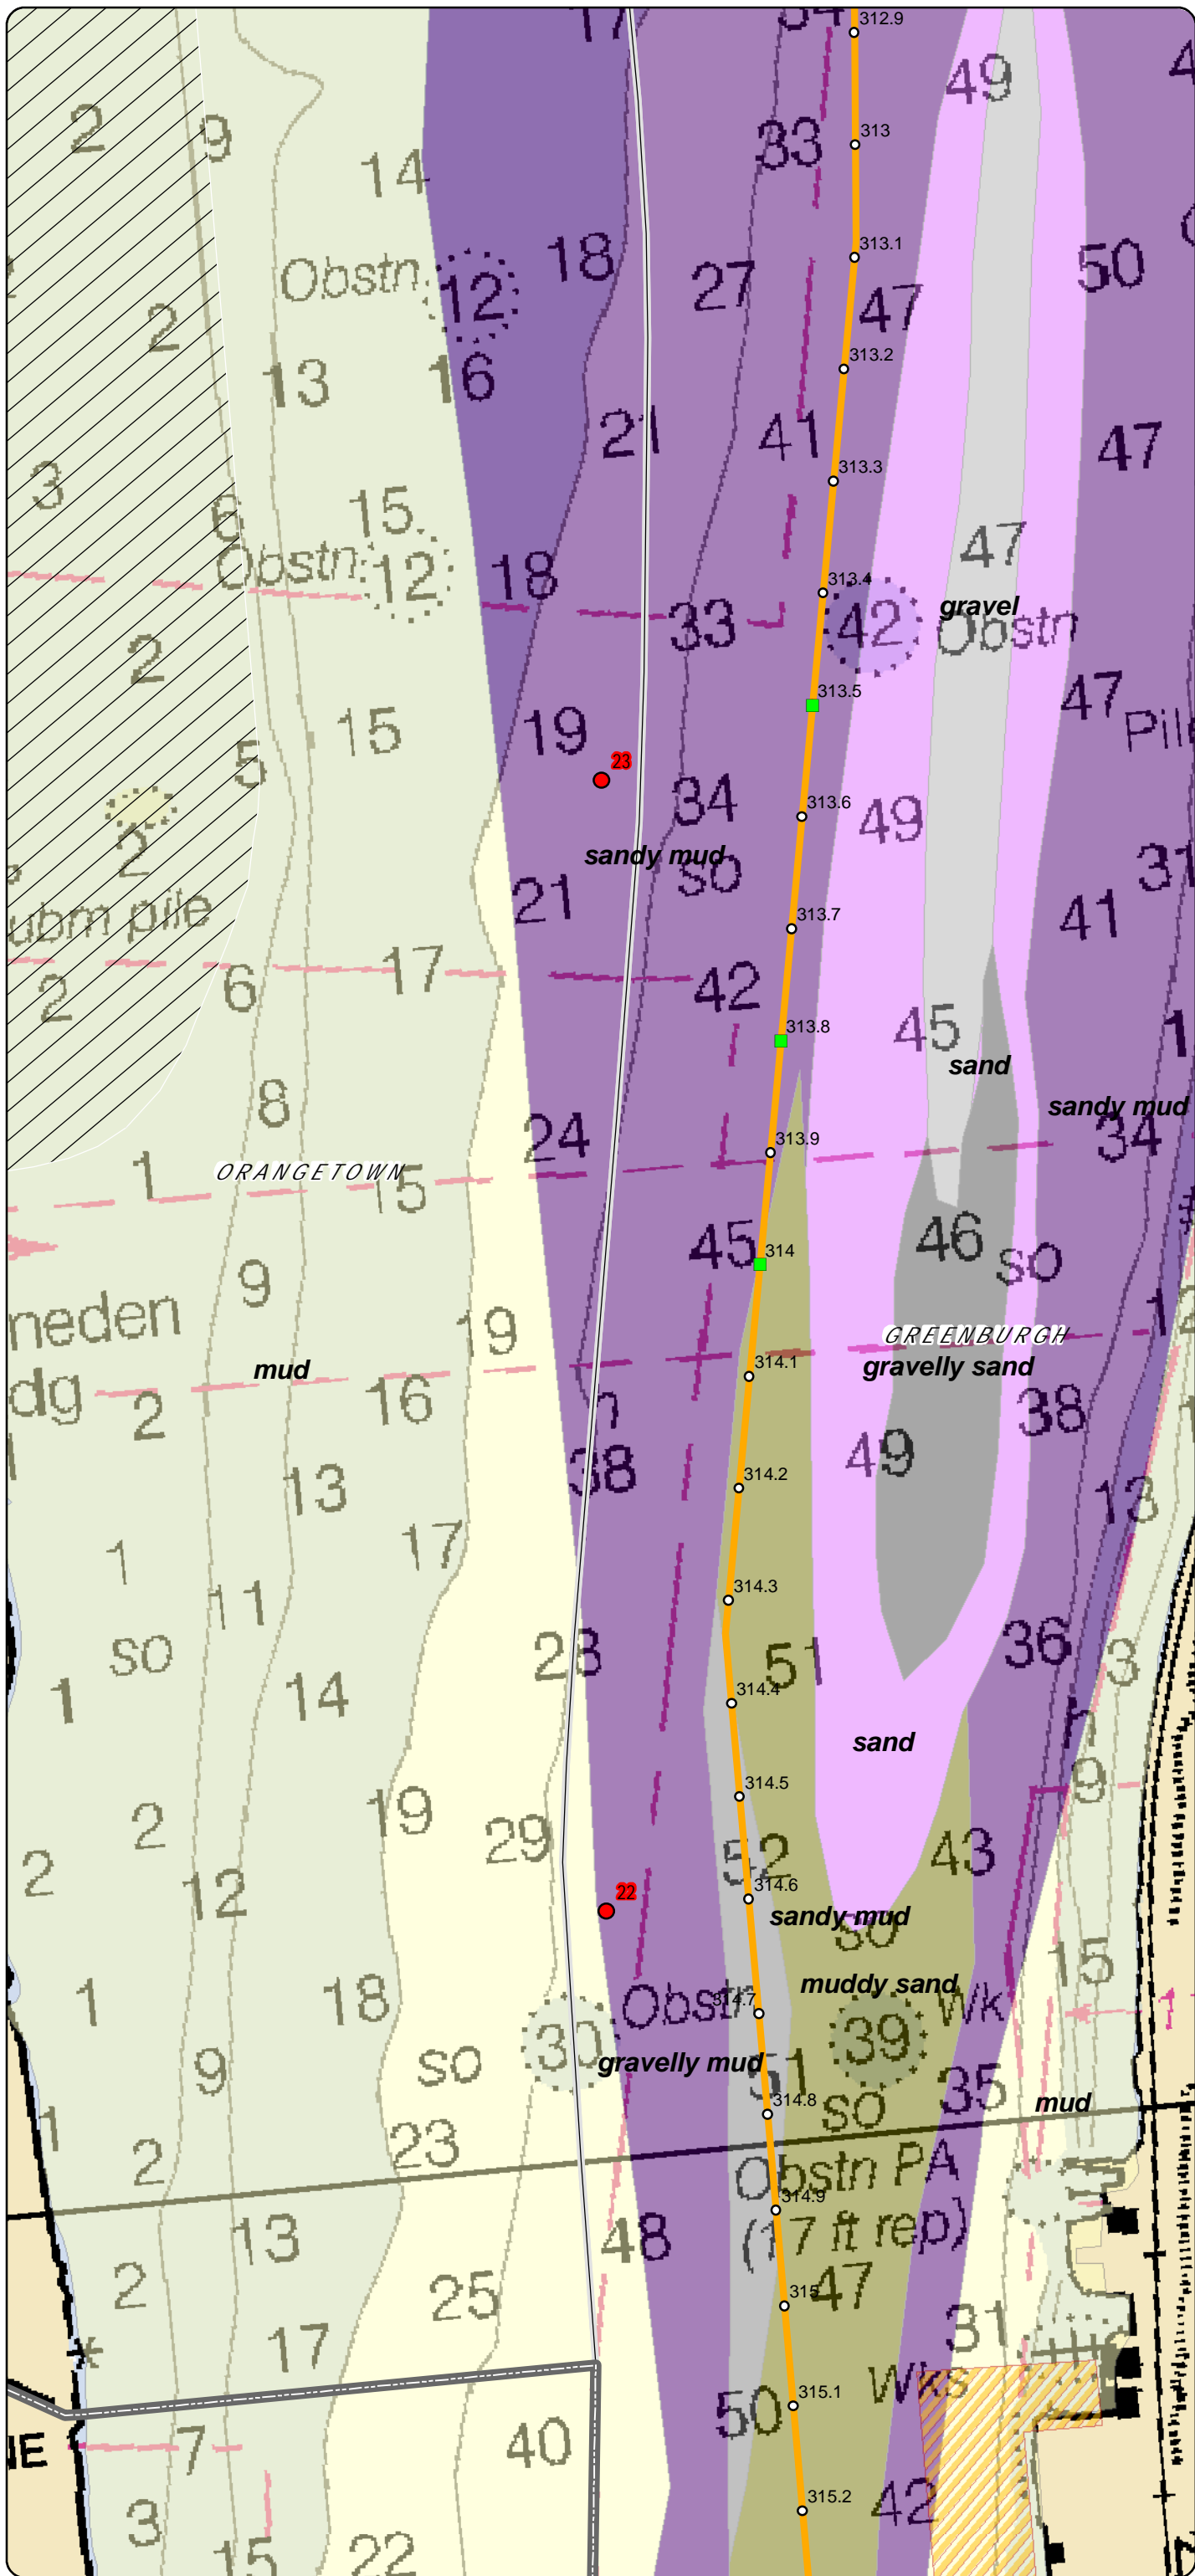

### LEGEND

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC)  Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

### Sediment Type - NYSDEC Hudson River Estuary Program

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud
- State Boundary
- County Boundary
- Town Boundary

0 750  
Feet

**Transmission Developers Inc.**

Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*

---

**Hudson River Project Route**



Sheet 39 of 43

---

Created: 6/18/2014

by: **HDR** **UTA** & **CTRC**



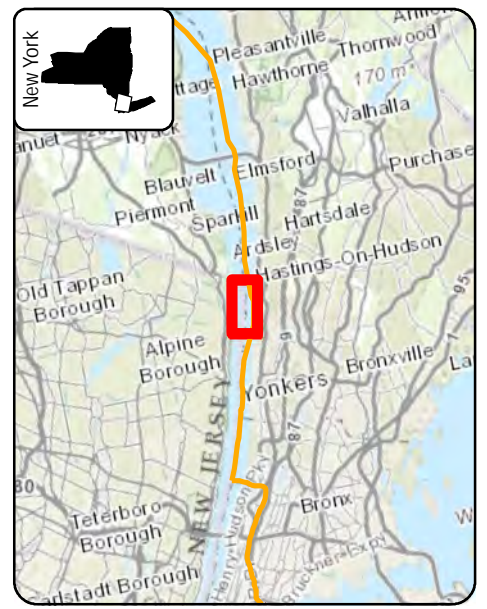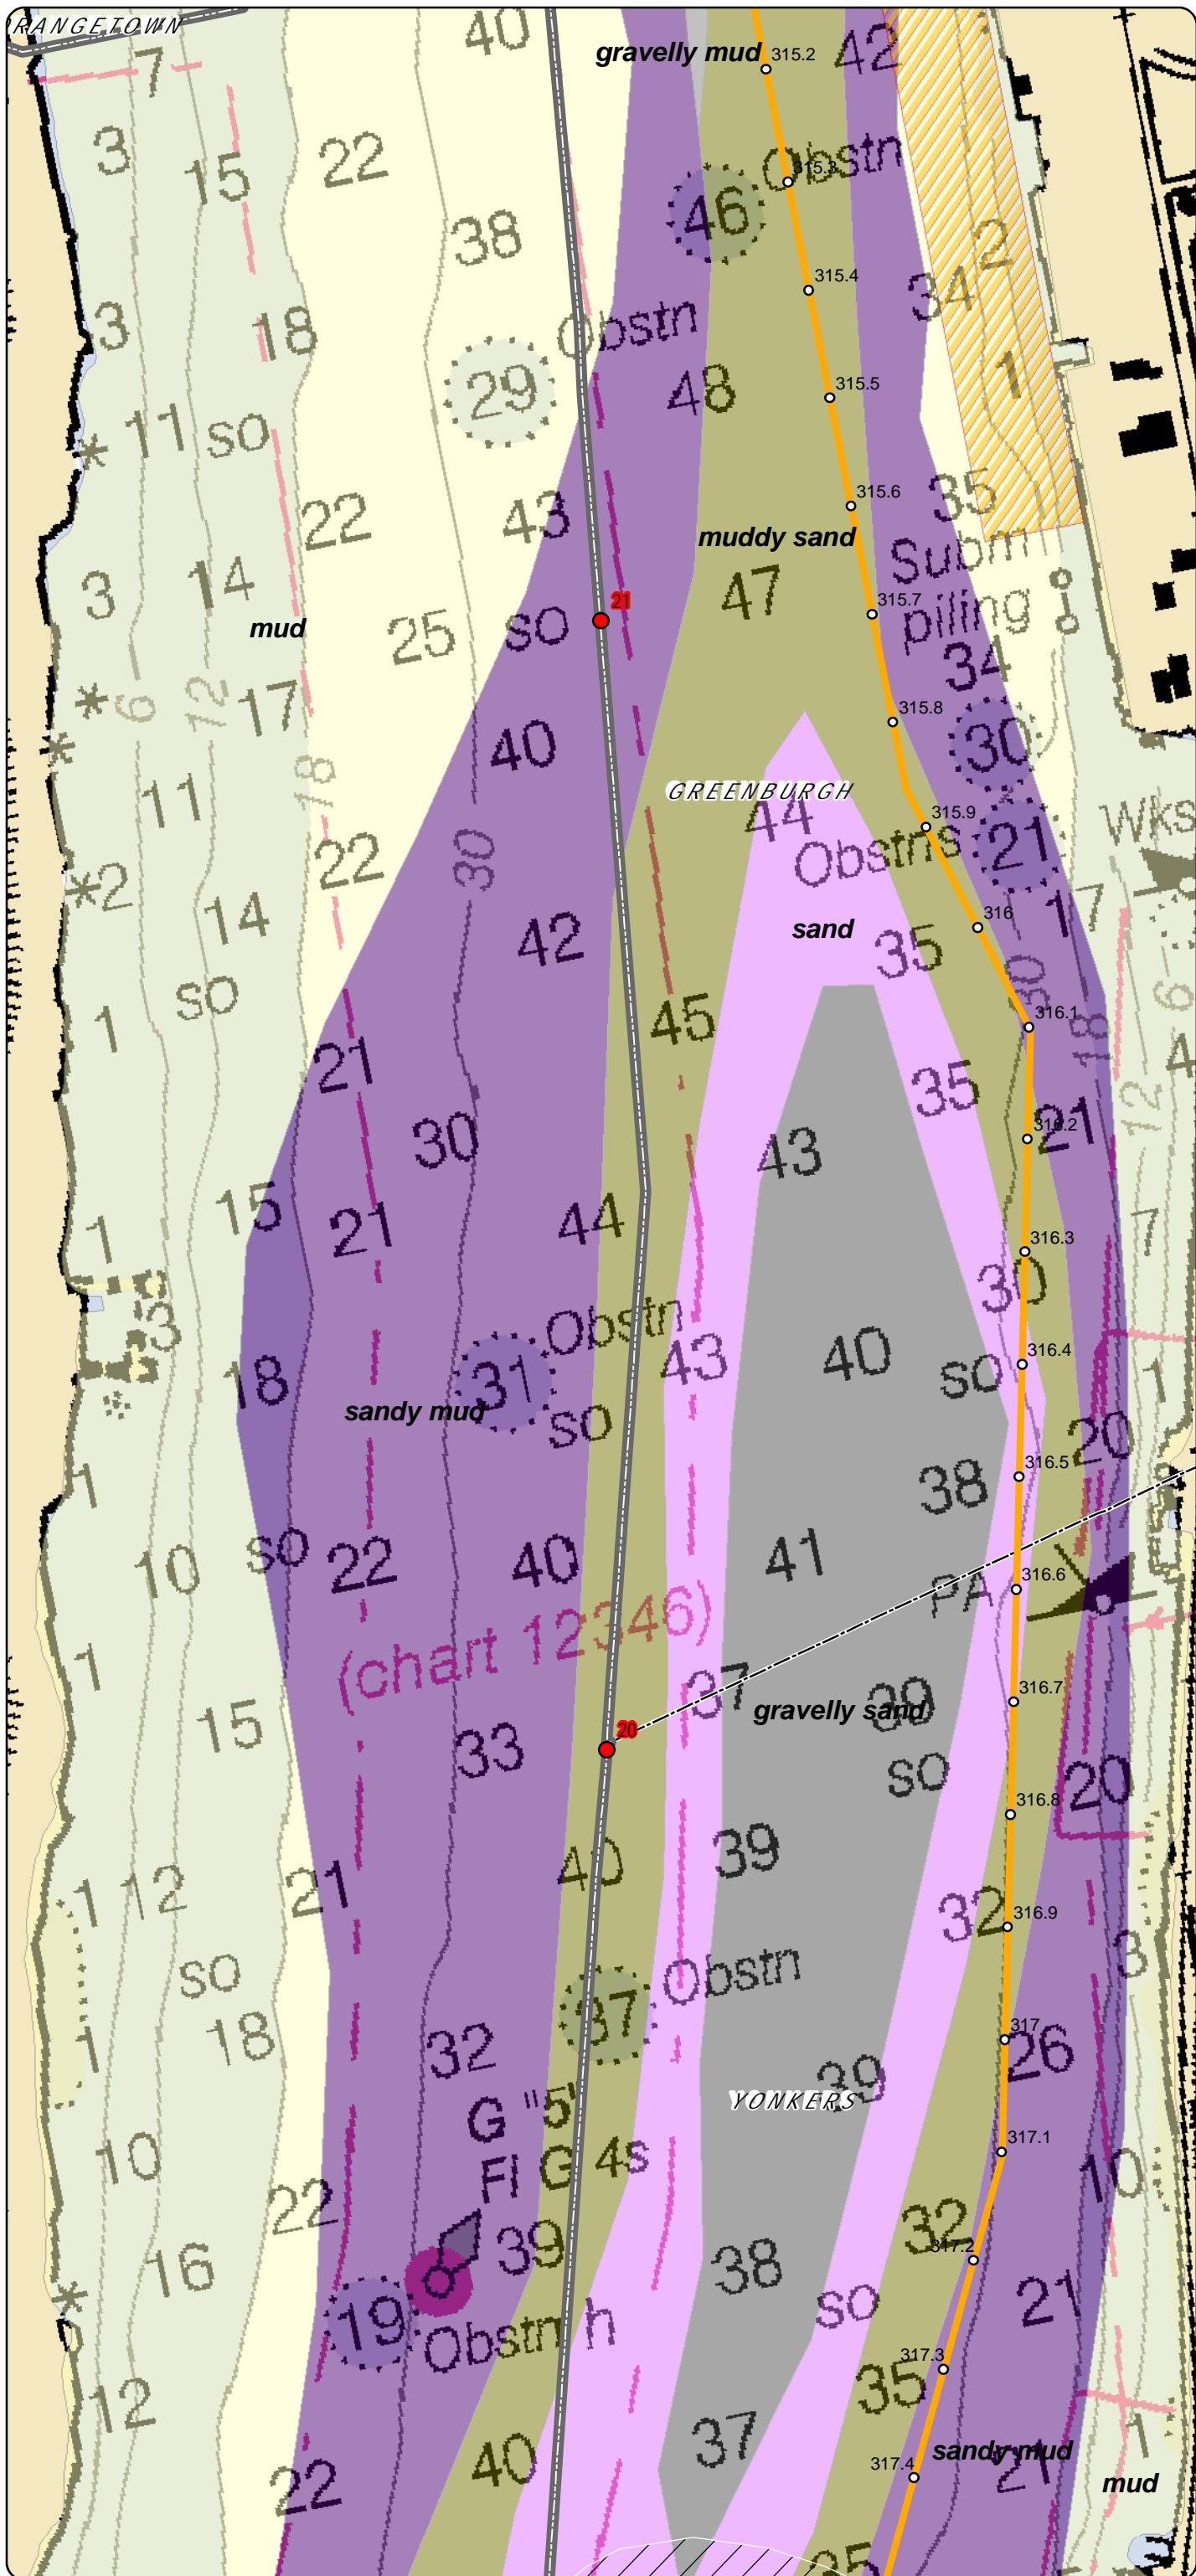

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary


0 N 750  
Feet

  
**Transmission Developers Inc.**  
 Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*  




---

**Hudson River Project Route**  
 Sheet 40 of 43  


---

 Created: 6/18/2014  
 by:   & 



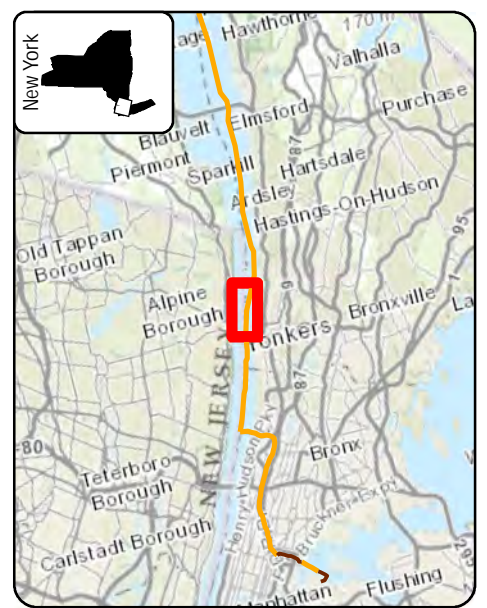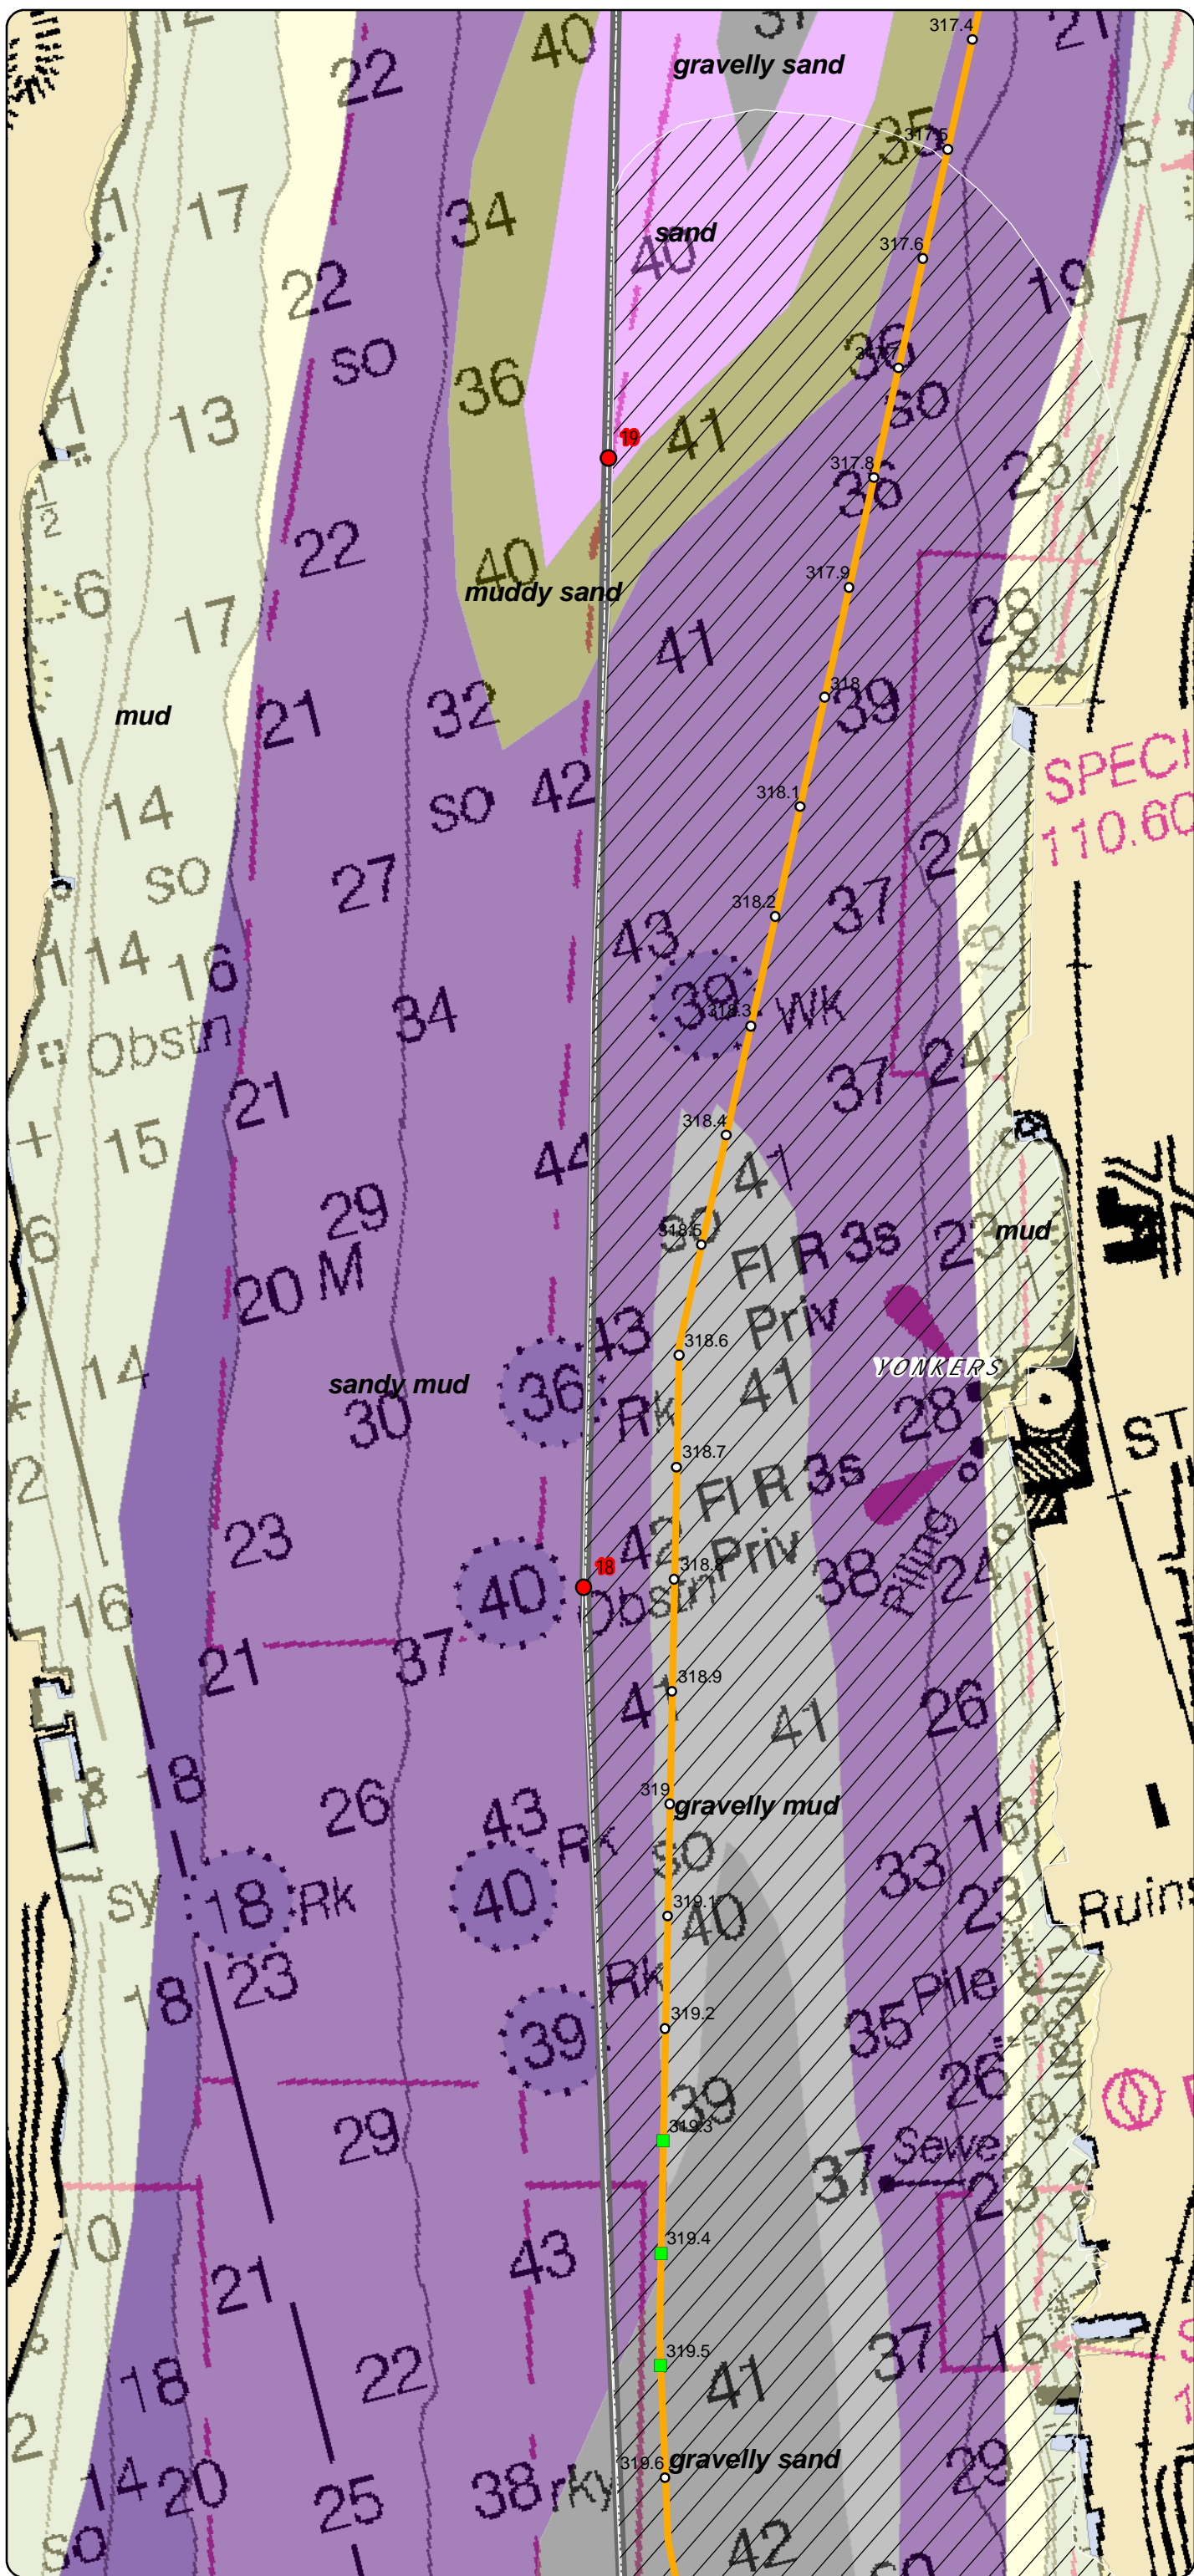


### LEGEND

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

#### Sediment Type - NYSDEC Hudson River Estuary Program

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary



0 750  
Feet



**Transmission Developers Inc.**

Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*

---

**Hudson River Project Route**



Sheet 41 of 43

---

Created: 6/18/2014

by: **HDR** **UTA** & **CTRC**



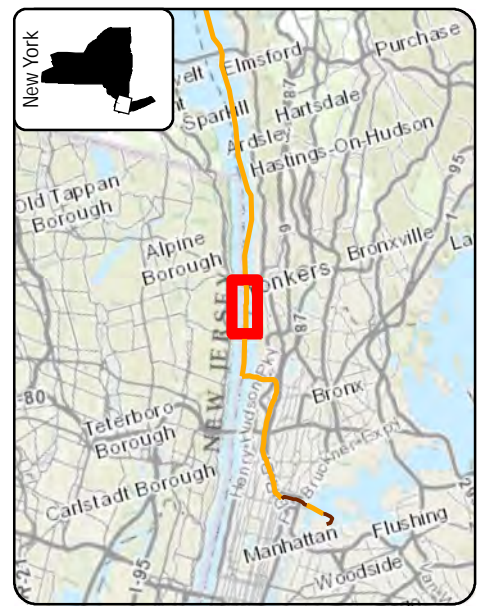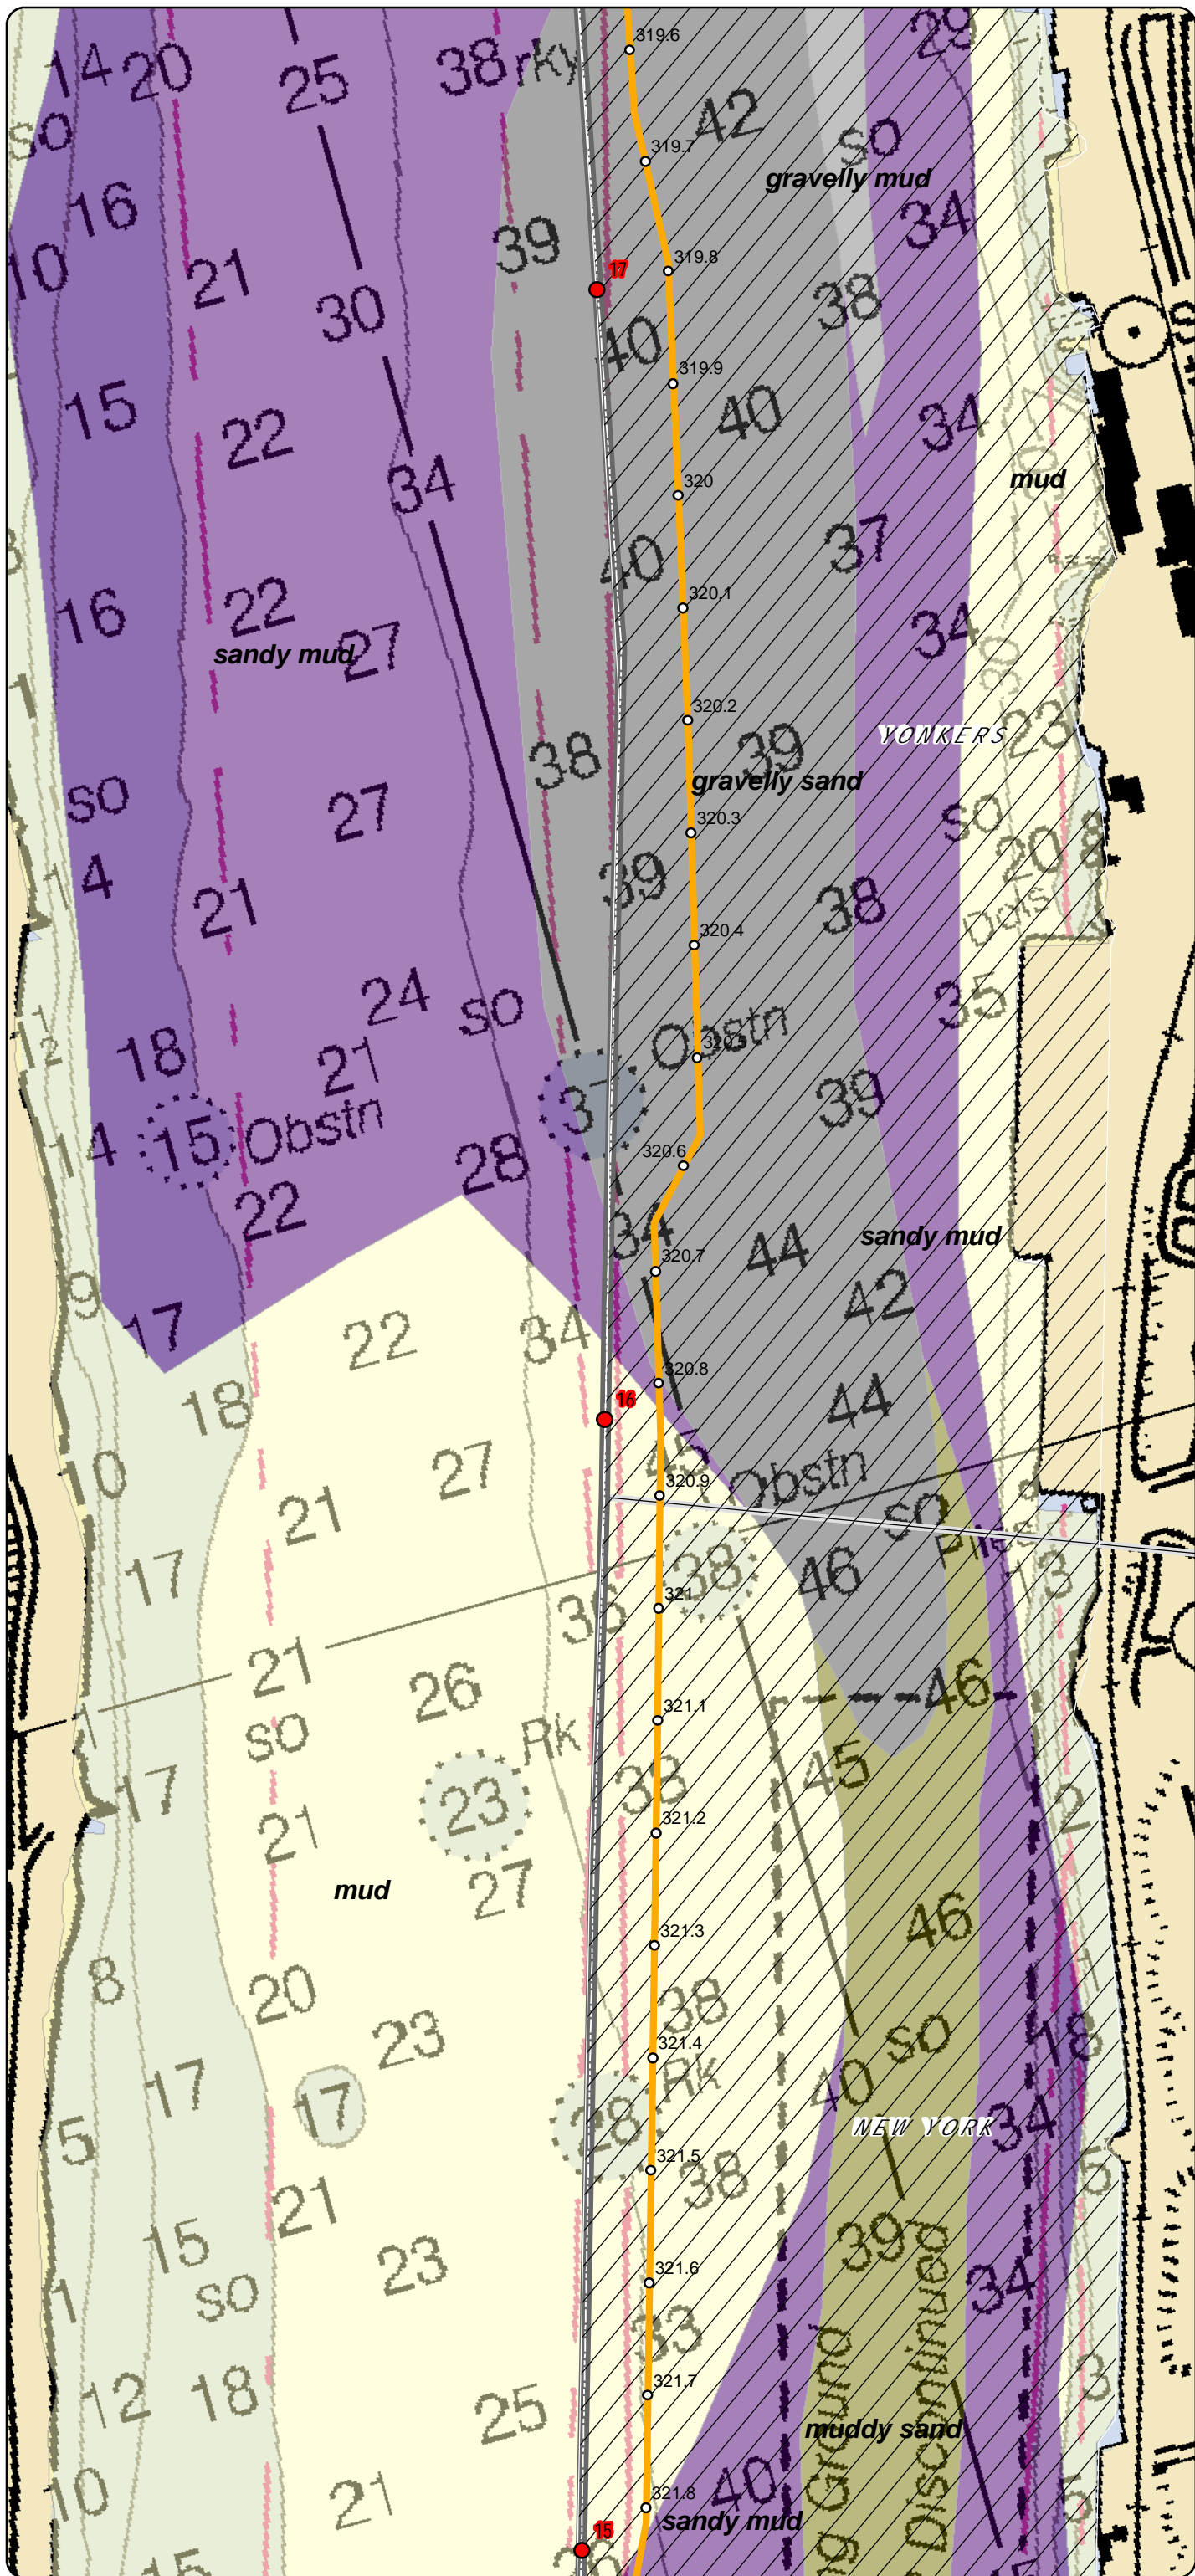

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud
- State Boundary
- County Boundary
- Town Boundary

0 750  
Feet

  
**Transmission Developers Inc.**  
 Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*  



---

**Hudson River Project Route**  
 Sheet 42 of 43  


---

 Created: 6/18/2014  
 by:   & 



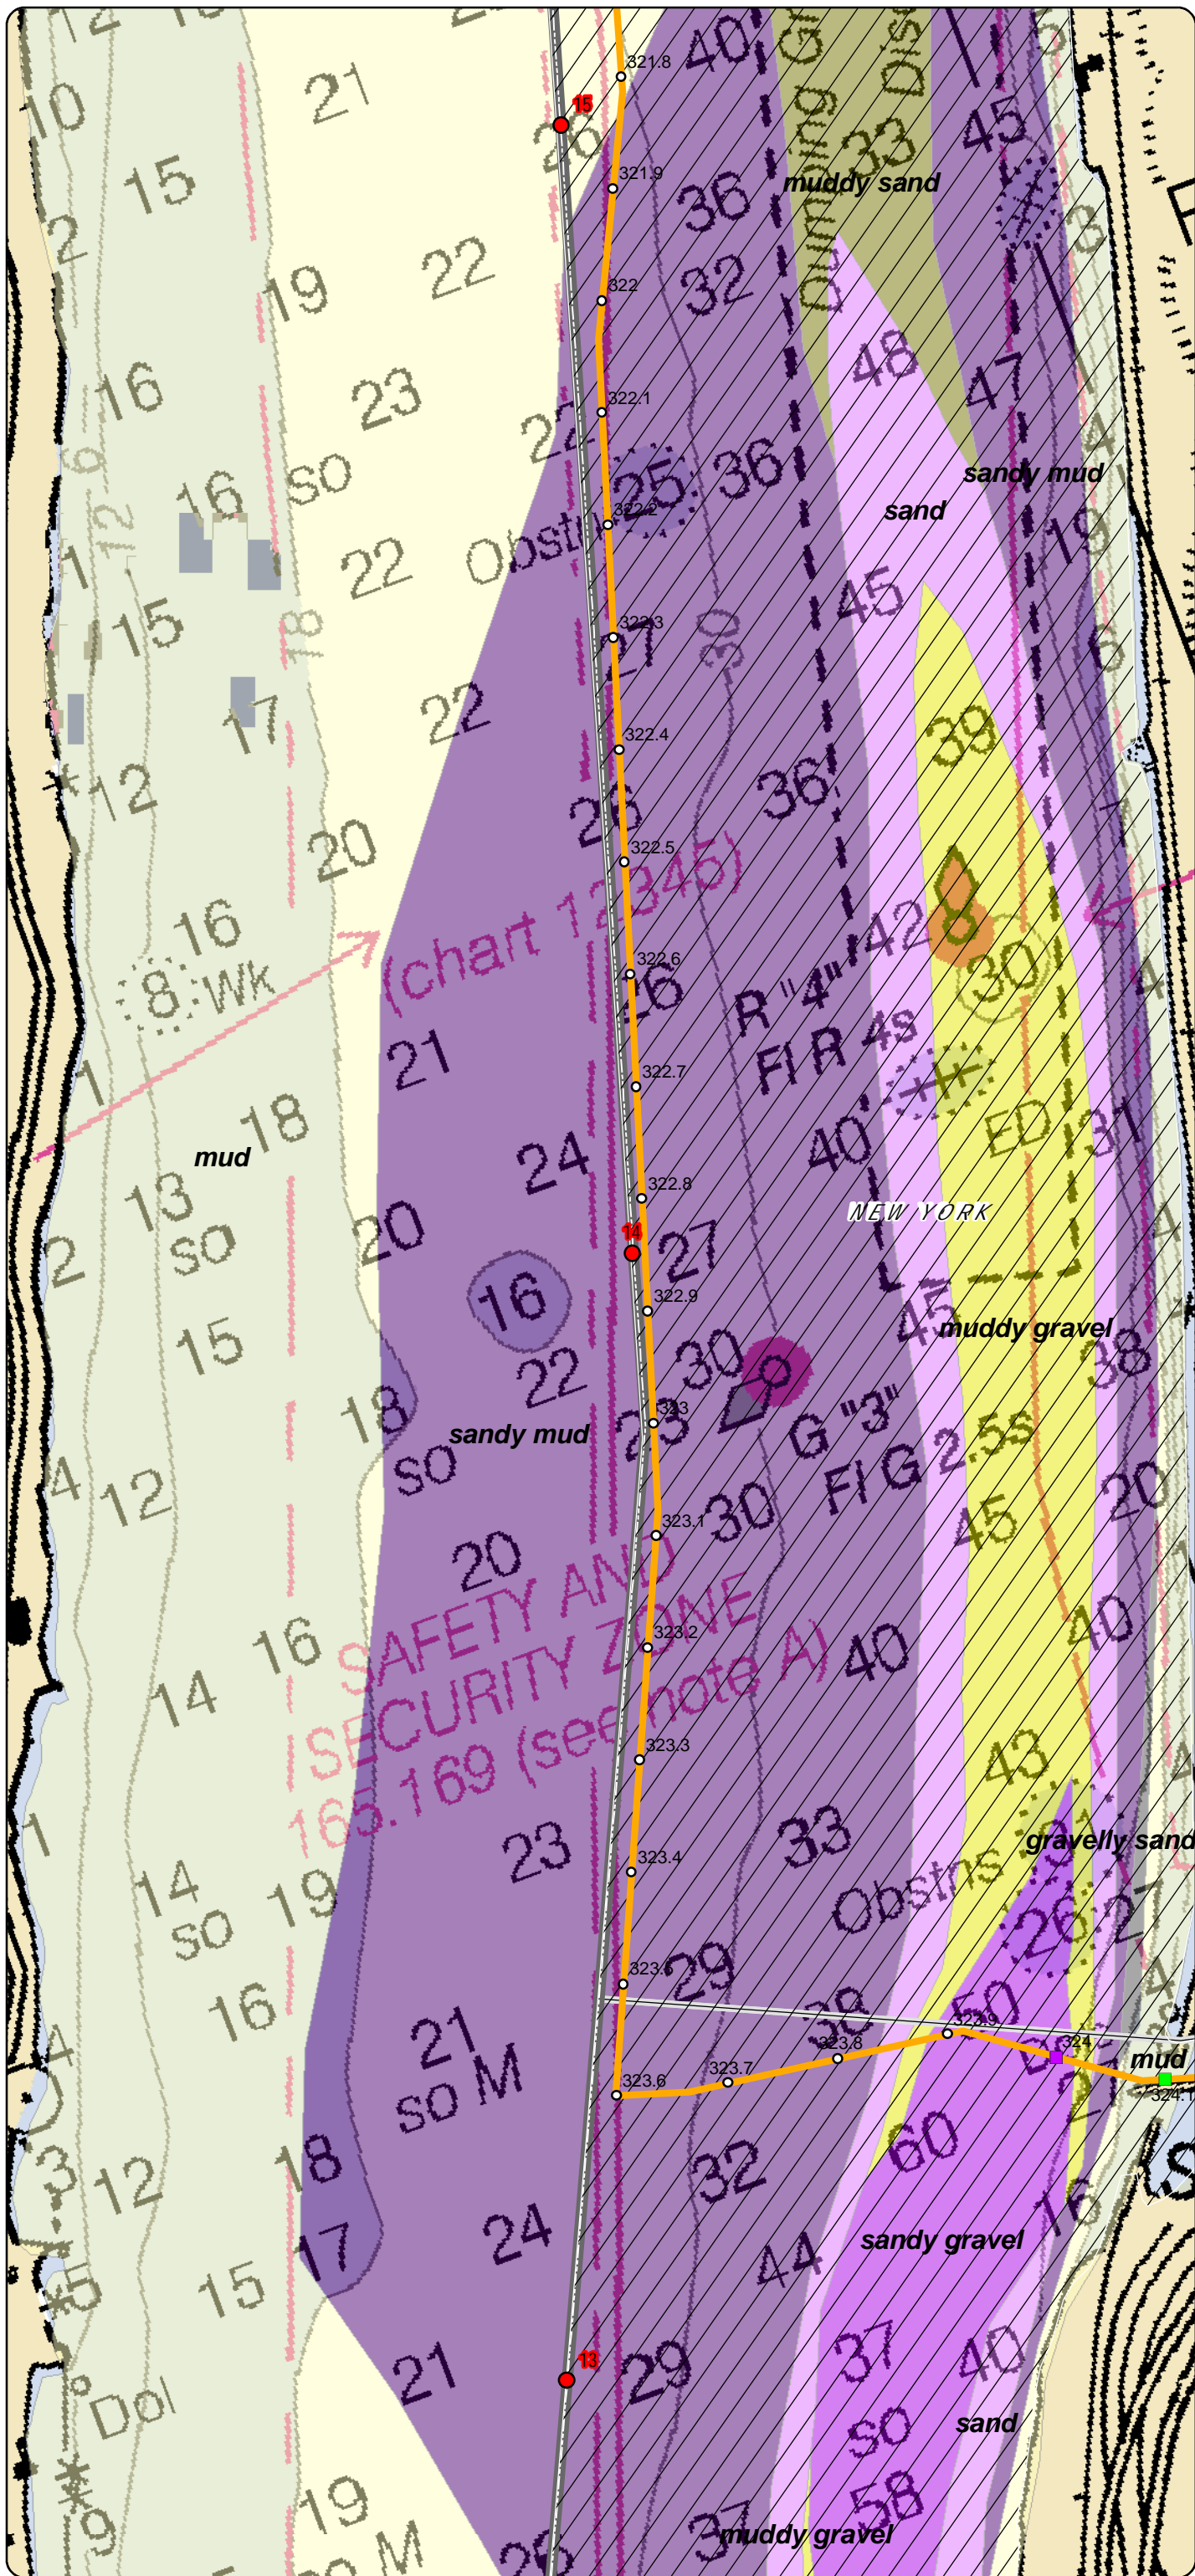

**LEGEND**

- 1 Hudson River Miles
- Potential Mattress (Rock or Stiff Soils)
- Potential Mattress (Utility Crossings)
- CHPE Route Mileposts
- Proposed CHPE Submarine Route HVDC
- Proposed CHPE Terrestrial Route HVDC
- Cofferdam
- Significant Coastal Fish and Wildlife Habitat
- Exclusion Zones (NYSDEC) 4 Zone Number
- Contamination Site
- NMFS Identified Atlantic Sturgeon Habitat
- Submerged Aquatic Veg: Valsineria (NYSDEC)
- Submerged Aquatic Veg: Trappa (NYSDEC)

**Sediment Type - NYSDEC Hudson River Estuary Program**

- gravel
- gravelly mud
- gravelly sand
- mud
- muddy gravel
- muddy sand
- sand
- sandy gravel
- sandy mud

- State Boundary
- County Boundary
- Town Boundary

**Transmission Developers Inc.**  
 Champlain Hudson Power Express Project  
*Champlain Hudson Power Express Inc.*  


---

**Hudson River Project Route**  
 Sheet 43 of 43  


---

 Created: 6/18/2014  
 by: &



***THIS PAGE INTENTIONALLY LEFT BLANK***